



TALLINN UNIVERSITY OF TECHNOLOGY
SCHOOL OF ENGINEERING
Department of Civil Engineering and Architecture

**EVALUATION OF PROPOSED CHANGES TO THE
FIRE DESIGN MODELS FOR LINEAR GLULAM
MEMBERS IN EUROCODE 5**

**EUROKODEKS 5 LIIMPUIDUST VARRASELEMENTIDE
TULEPÜSIVUSE ARVUTUSMEETODITES KAVANDATUD
MUUDATUSTE HINDAMINE**

MASTER THESIS

Student: Mariliis Reineberg

Student code: 153961EAEI

Supervisor: Professor Alar Just

Tallinn 2021

AUTHOR'S DECLARATION

Hereby I declare, that I have written this thesis independently.

No academic degree has been applied for based on this material. All works, major viewpoints and data of the other authors used in this thesis have been referenced.

"....." 20....

Author:

/signature /

Thesis is in accordance with terms and requirements

"....." 20....

Supervisor:

/signature/

Accepted for defence

"....."20... .

Chairman of theses defence commission:

/name and signature/

Non-exclusive Licence for Publication and Reproduction of Graduation Thesis¹

I, Mariliis Reineberg (date of birth:30.08.1996) hereby

1. grant Tallinn University of Technology (TalTech) a non-exclusive license for my thesis "Evaluation of proposed changes to fire design models for linear glulam members in Eurocode 5", supervised by Alar Just.

1.1 reproduced for the purposes of preservation and electronic publication, incl. to be entered in the digital collection of TalTech library until expiry of the term of copyright;

1.2 published via the web of TalTech, incl. to be entered in the digital collection of TalTech library until expiry of the term of copyright.

1.3 I am aware that the author also retains the rights specified in clause 1 of this license.

2. I confirm that granting the non-exclusive license does not infringe third persons' intellectual property rights, the rights arising from the Personal Data Protection Act or rights arising from other legislation.

¹ *Non-exclusive Licence for Publication and Reproduction of Graduation Thesis is not valid during the validity period of restriction on access, except the university's right to reproduce the thesis only for preservation purposes.*

_____ (signature)

_____ (date)

THESIS TASK

Student: Mariliis Reineberg, 153961EAEI

Study programme: EAEI02/15 Design of buildings

Supervisor(s): Prof. Alar Just

Thesis topic:

Evaluation of proposed changes to the fire design models for linear glulam members in the Eurocode 5

Thesis main objectives:

1. To perform calculations of load bearing capacities of selected linear glulam members according to EN 1995-1-2:2004 and 3rd Draft of EN 1995-1-2:2020.
2. To compare described design methods and evaluate the changes.
3. Compare calculation results and test results.

Thesis tasks and time schedule:

| No | Task description | Deadline |
|----|---|-----------|
| 1. | Selection of structures and parameters for evaluation | 1.4.2020 |
| 2. | Calculations of glulam members according to existing and new design methods | 1.6.2020 |
| 3. | Comparison of design methods | 1.10.2020 |
| 4. | Comparison with test results | 1.11.2020 |
| 5. | Finalizing the work | 6.1.2021 |

Language: English

Deadline for submission of thesis: 7th January 2021

Student: Mariliis Reineberg ".....".....2021
/signature/

Supervisor: Alar Just ".....".....2021
/signature/

TTÜ Ehituse ja arhitektuuri instituut
LÕPUTÖÖ ÜLESANNE

Üliõpilane: Mariliis Reineberg, 153961EAEI
Õppekava, peeriala: EAEI02/15 – Ehitiste projekteerimine ja ehitusjuhtimine
Juhendaja: Professor Alar Just

Lõputöö teema:

Eurokoodeks 5 liimpuidust varraselementide tulepüsivuse arvutusmeetodites kavandatud muudatuste hindamine

Evaluation of proposed changes to the fire design models for linear glulam members in the Eurocode 5

Lõputöö põhieesmärgid:

1. Teostada valitud puitkonstruktsioonide tulepüsivusarvutused EN1995-1-2:2004 ning sama standardi uue versiooni kavandi arvutusmeetodite järgi.
2. Võrrelda tulepüsivuse arvutusmeetodeid ning hinnata muutusi võrreldes olemasolevaga.

Lõputöö etapid ja ajakava:

| Nr | Ülesande kirjeldus | Tähtaeg |
|----|---|-----------|
| 1. | Hinnatavate konstruktsioonide ja parameetrite valik | 1.4.2020 |
| 2. | Liimpuitkonstruktsioonide arvutused EN 1995-1-2:2004 ja uute arvutusmeetodite järgi | 1.6.2020 |
| 3. | Analüüs ja järeldused | 1.10.2020 |
| 4. | Võrdlus katsetulemustega | 1.11.2020 |
| 5. | Töö vormistamine | 6.1.2021 |

Töö keel: inglise **Lõputöö esitamise tähtaeg: "7" jaanuar 2021.a**

Üliõpilane: **Mariliis Reineberg** "....."2021.a
/allkiri/

Juhendaja: **Alar Just** "....."2021.a
/allkiri/

CONTENTS

| | |
|--|----|
| PREFACE..... | 9 |
| List of abbreviations and symbols..... | 10 |
| 1. INTRODUCTION..... | 13 |
| 2. REVISION OF EUROCODE 5 PART 1-2..... | 17 |
| 3. DESIGN ACCORDING TO EN 1995-1-2:2004..... | 19 |
| 3.1 Strength of timber in fire..... | 19 |
| 3.2 Charring depth of initially unprotected member..... | 20 |
| 3.3 Charring depth of initially protected member..... | 20 |
| 3.3.1 Variations of charring depth with time for initially protected member..... | 21 |
| 3.3.2 Start time of charring of protective layer..... | 22 |
| 3.3.3 Failure time of protective layer..... | 23 |
| 3.3.4 The time limit t_a | 23 |
| 3.4 Effective cross-section of the member..... | 24 |
| 4. DESIGN ACCORDING TO EN 1995-1-2:2020..... | 26 |
| 4.1 Strength of timber in fire..... | 26 |
| 4.2 Charring depth..... | 27 |
| 4.2.1 Notional charring depth and rate..... | 27 |
| 4.2.1.3 Modification factors..... | 27 |
| 4.3 Initially unprotected sides of members..... | 28 |
| 4.4 Initially protected sides of members..... | 29 |
| 4.4.1 Charring phases of initially protected members..... | 29 |
| 4.4.2 The failure time of the fire protection system..... | 31 |
| 4.4.3 The start time of charring..... | 32 |
| 4.4.4 Time of reaching the encapsulated phase..... | 33 |
| 4.5 Effective cross-section of linear members..... | 33 |
| 5. CALCULATIONS NOT BASED ON EN 1995-1-2..... | 35 |
| 6. COMPARISON OF EN 1995-1-2:2004 AND EN 1995-1-2:2020..... | 38 |
| 6.1 Differences in calculations of glulam linear members..... | 38 |
| 6.2 Load-bearing capacity of beams..... | 41 |
| 6.2.1 The change of maximum bending moments..... | 42 |
| 6.2.2 Effective depth of char layer on beams..... | 44 |
| 6.3 Load-bearing capacity of columns..... | 48 |

| | |
|--|-----|
| 6.3.1 The change of maximum compressive forces | 48 |
| 6.3.2 Effective depth of char layer on columns..... | 51 |
| 7. COMPARISON OF FIRE RESISTANCE IN TESTS AND CALCULATION | |
| MODELS..... | 55 |
| 8. USER EXPERIENCE EVALUATION | 59 |
| 8.1 Improvements in EN 1995-1-2:2020 | 59 |
| 8.2 Deficiencies in EN 1995-1-2:2020 | 60 |
| SUMMARY | 62 |
| KOKKUVÕTE | 63 |
| LIST OF REFERENCES | 64 |
| APPENDICES..... | 65 |
| Appendix 1 Calculations of the strength parameters according to 2004 version of Eurocode 5..... | 66 |
| Appendix 2 Calculations of unprotected glulam beam according to 2004 version of Eurocode 5..... | 67 |
| Appendix 3 Calculations of glulam beam with one layer of GtA 12,5 according to 2004 version of Eurocode 5..... | 69 |
| Appendix 4 Calculations of glulam beam with one layer of GtF 15 according to 2004 version of Eurocode 5..... | 73 |
| Appendix 5 Calculations of unprotected glulam column according to 2004 version of Eurocode 5..... | 77 |
| Appendix 6 Calculations of glulam column with one layer of GtA 12,5 according to 2004 version of Eurocode 5..... | 81 |
| Appendix 7 Calculations of glulam column with one layer of GtF 15 according to 2004 version of Eurocode 5..... | 86 |
| Appendix 8 Calculations of the strength parameters according to 2020 version of Eurocode 5..... | 91 |
| Appendix 9 Calculations of unprotected glulam beam according to 2020 version of Eurocode 5..... | 92 |
| Appendix 10 Calculations of glulam beam with one layer of GtA 12,5 according to 2020 version of Eurocode 5..... | 96 |
| Appendix 11 Calculations of glulam beam with one layer of GtF 15 according to 2020 version of Eurocode 5..... | 101 |

| | |
|---|-----|
| Appendix 12 Calculations of unprotected glulam column according to 2020 version of Eurocode 5..... | 106 |
| Appendix 13 Calculations of glulam column with one layer of GtA 12,5 according to 2020 version of Eurocode 5..... | 111 |
| Appendix 14 Calculations of glulam column with one layer of GtF 15 according to 2020 version of Eurocode 5..... | 117 |
| Appendix 15 Calculations of tested beams..... | 123 |
| Appendix 16 Interview with Alar Just..... | 127 |

PREFACE

I take this opportunity to express my gratitude to everyone that has supported me through studies and thesis writing. Especially, I would like to thank my supervisor Alar Just for suggesting the topic of this thesis and for his guidance. His support and encouragement has been beyond my expectations.

I am thankful for my family and friends for supporting me through studies, especially Jane, Leena and Eliise.

In this thesis, fire resistances of glulam beams and columns are calculated according to EN 1995-1-2:2004 and EN 1995-1-2:2020. Results are compared to the test results. In addition, user experience of EN 1995-1-2:2004 and :2020 is evaluated.

Keywords: fire resistance, glulam, Eurocode 5, linear member

List of abbreviations and symbols

Latin upper case letters

| | |
|--------------|---|
| A | the area of effective cross-section |
| $E_{0,05}$ | the fifth percentile value of the modulus of elasticity parallel to the grain |
| $E_{d,fi}$ | design effect of actions for the fire situation |
| GtA | gypsum plasterboard type A |
| GtF | gypsum plasterboard type F |
| I_y | the moment of inertia |
| $M_{max,fi}$ | maximum bending moment in fire situation |
| $N_{max,fi}$ | maximum compressive force in fire situation |
| $R_{d,t,fi}$ | design resistance in the fire situation |
| W_{ef} | second modulus of effective cross-section |

Latin lower case letters

| | |
|--------------|---|
| b | width of the initial cross-section |
| b_{ef} | effective width of the effective cross-section |
| d_0 | zero-strength layer depth |
| $d_{char,n}$ | notional charring depth |
| d_{ef} | effective charring depth |
| f_{20} | the 20% fractile of a strength property at normal temperature |
| $f_{c,0,d}$ | the design compressive strength along the grain |
| $f_{c,0,k}$ | the compressive strength along the grain |
| $f_{d,fi}$ | design strength in fire |
| f_k | characteristic strength |
| h | height of the initial cross-section |
| h_{ef} | effective height of the effective cross-section |
| h_p | thickness of protective panel |
| i_y | the radius of gyration |
| k_0 | coefficient |
| k_2 | protection factor |
| k_3 | post-protection factor |
| k_4 | consolidation factor |
| $k_{c,y}$ | the instability factor |

| | |
|-------------------|---|
| | modification factor for a strength or stiffness property for the fire situation |
| k_{fi} | |
| k_{gd} | modification factor considering grain direction |
| k_i | modification factors |
| $k_{j,i}$ | joint coefficient for layer i |
| $k_{mod,fi}$ | modification factor for fire |
| k_n | conversion factor |
| | position coefficient that takes into account the influence of layers preceding the layer considered |
| $k_{pos,exp,i}$ | |
| | position coefficient that takes into account the influence of layers backing the layer considered |
| $k_{pos,unexp,i}$ | |
| k_{sides} | number of respective sides exposed to fire |
| k_y | the instability factor |
| | temperature-dependent reduction factor for a strength or stiffness property |
| k_{θ} | |
| l_{ef} | the effective length of member |
| t | time of fire exposure |
| t_a | Time to reach the consolidated charring phase; |
| t_{ch} | Start time of charring; |
| t_f | Failure time of the fire protection system, in min. |
| $t_{f,pr}$ | Failure time of the fire protection system, in min. |
| $t_{prot,0,i}$ | basic protection time of the considered layer i |
| t_{prot} | protection time of each layer i in the heat flux |

Greek upper case letters

| | |
|-------------------|--|
| $X_{d,fi}$ | Design value of a strength or stiffness property for fire temperature design |
| X_k | normal temperature design |
| Δt_i | correction time for the considered layer i |
| Σt_{prot} | sum of protection time |

Greek lower case letters

| | |
|--------------------|--|
| β_0 | basic design charring rate |
| β_n | notional charring rate within one charring phase |
| $\beta_{n,Phase2}$ | notional charring rate during the protection phase (phase 2) |
| $\beta_{n,Phase3}$ | notional charring rate during the protection phase (phase 3) |
| $\beta_{n,Phase4}$ | notional charring rate during the protection phase (phase 4) |

| | |
|-------------------|---|
| $\gamma_{M,fi}$ | partial factor for the relevant mechanical material property for the fire situation |
| $\lambda_{rel,y}$ | the relative slenderness ratio |
| λ_y | slenderness ratio corresponding to bending about the y-axis |
| μ | the support factor |
| $\sigma_{c,0,d}$ | the design compressive stress along the grain |

1. INTRODUCTION

Timber has been used as a construction material for centuries. However, many regulations and standards restrict the use of timber in construction due to the combustibility of timber [1]. European countries have different limitations for the number of storeys permitted in load bearing structures as can be seen in Figure 1.1.


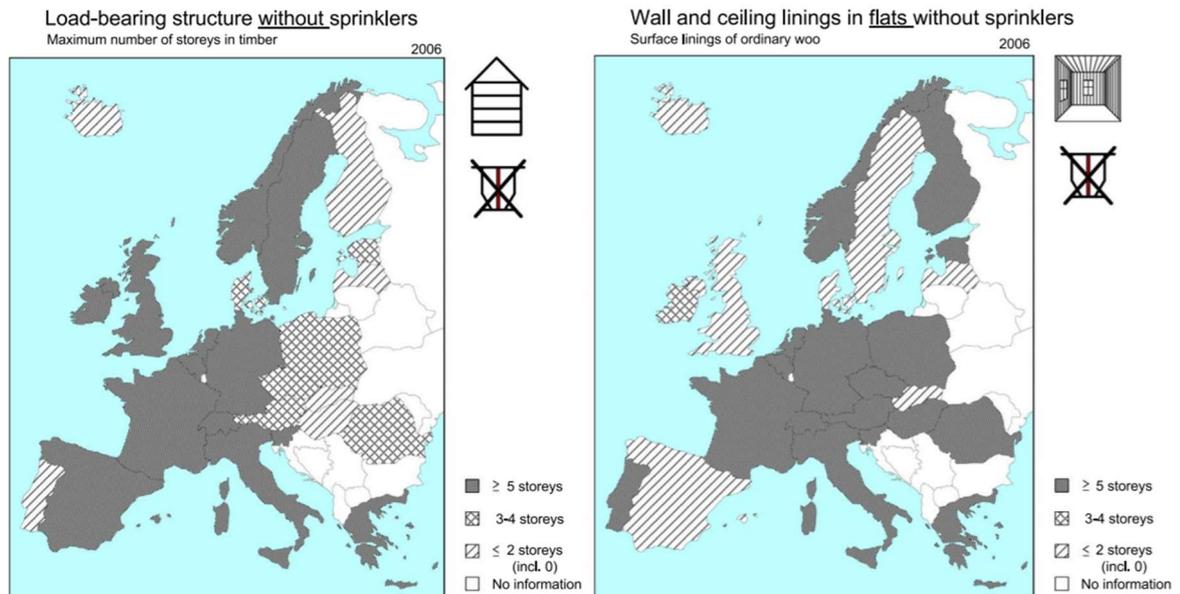


Figure 1.1 Restricted use of load-bearing timber structures and visible wood set by national prescriptive regulations [2]


An important prerequisite in the more extensive use of timber in construction is adequate fire safety. Numerous research projects have been conducted and fire tests have been performed to collect data and information. According to the collected data, novel fire design models have been developed [1]. The improvements in the fire design models have led to the new version of Eurocode 5 part 1-2.

In this thesis, the fire resistance of glulam beams and columns are calculated according to EN 1995-1-2:2004 and EN 1995-1-2:2020. The results are compared to the test results. In addition, the user experiences of EN 1995-1-2:2004 and :2020 are evaluated. The examined beams and columns are shown in Figure 1.2 and Figure 1.3. 4 cross-sections were chosen for beams and 3 for columns. All the members were examined with 3 different protective layers: no protective layer, one layer of GtA 12,5 and one layer of GtF 15. The types of gypsum plasterboards are specified in EN 520+A1:2010 [3]. Fire resistance after 30, 60 and 90 minutes was calculated for all the different combinations of members and protective layers.

no protection

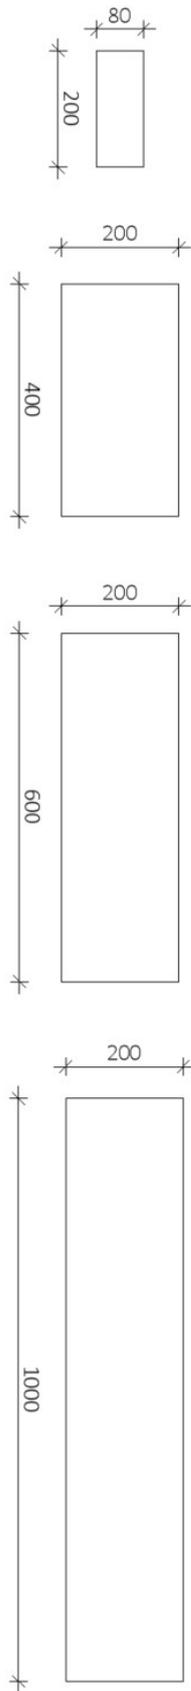

1xGtA 12,5

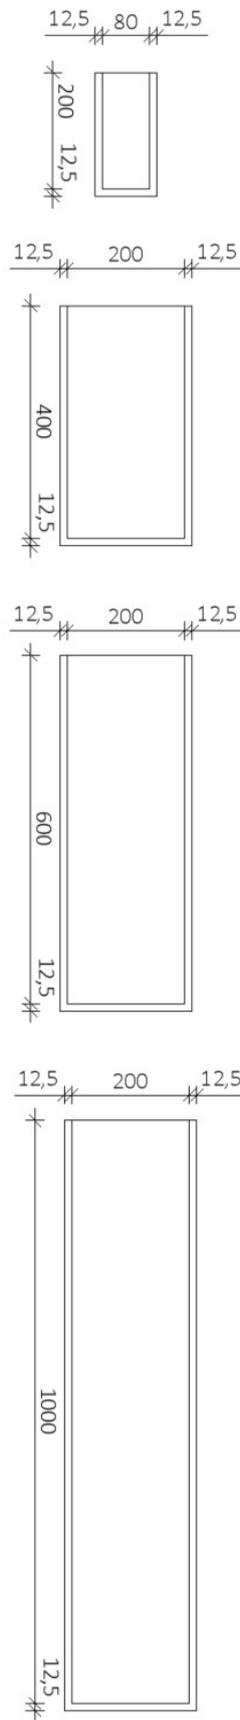

1xGtF 15

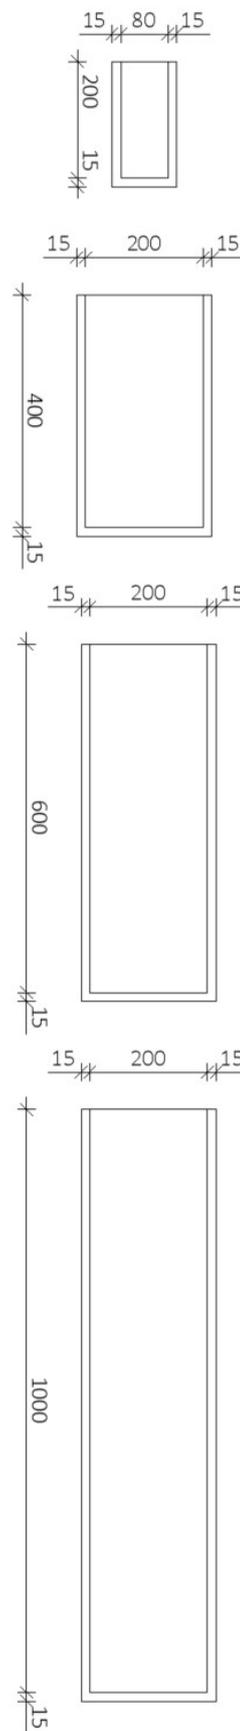


Figure 1.2 Cross-sections of beams used in this thesis

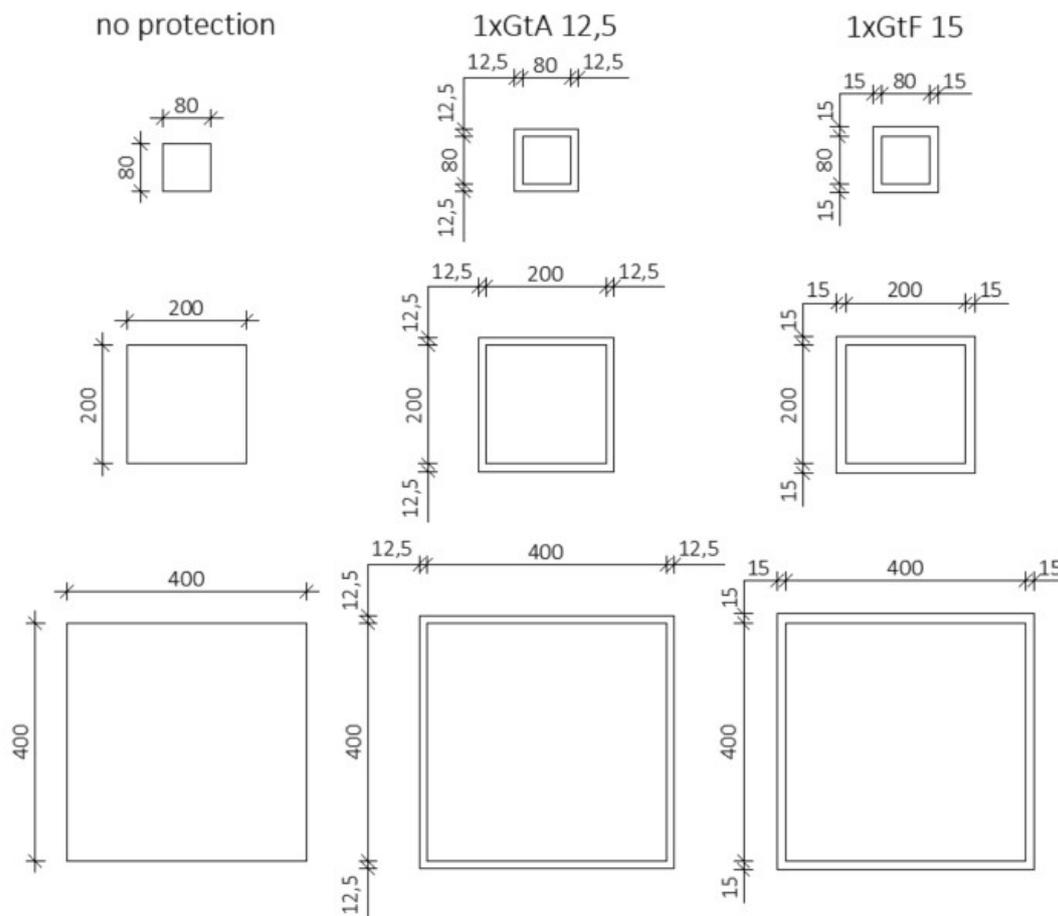


Figure 1.3 Cross-sections of columns used in this thesis

The topic was suggested by Alar Just. As this thesis was written during the revision of Eurocode 5 part 1-2, the results of the thesis can be used as feedback for the revision. This research presents how the proposed changes in Eurocode 5 part 1-2 affect the calculations of glulam beams and columns. The comparison with the test results evaluates whether the proposed changes give more realistic results than EN 1995-1-2:2004. The evaluation of user experience can be an useful information for the Project Team 4 of CEN TC250 SC5 and helps determine whether improvements could be added to EN 1995-1-2:2020.

In this thesis, the reduced cross-section method is used to evaluate fire resistance. A reduced cross-section is an initial cross-section without an effective char layer that, in addition to the char layer, considers the layer beneath it with reduced stiffness and strength properties [4]. A working platform has been created in Excel for calculations.

The main body of this thesis consists of two larger parts: an overview of the calculation methods and analysis.

Chapters 2-5 give an overview of the calculation methods. Chapter 2 covers the revision of the Eurocode 5 part 1-2. Chapters 3 and 4 elaborate on the calculation methods according to EN 1995-1-2:2004 and EN 1995-1-2:2020, respectively. Chapter 5 consists of the formulas used in this thesis from sources other than Eurocode 5 part 1-2.

The analysis consists of 3 parts: analysis of the calculation results, comparison with test results and user experience. Chapter 6 gives an analysis of the calculations. It covers the differences in calculation methods among EN 1995-1-2:2004 and EN 1995-1-2:2020 and the results of the calculations of the examined beams and columns that are shown in Figure 1.2 and Figure 1.3. Chapter 7 consists of a comparison of test results and calculations. Unfortunately, only limited data is available for compressed members in fire [5]. Therefore, Chapter 7 consists only of a comparison with beams. Chapter 8 evaluates the user experience according to the improvements and deficiencies of the user experience in EN 1995-1-2:2020.

This thesis includes 16 Appendices. Appendices 1-14 include calculation examples and the calculations of the results of all the examined members. Appendices 1-7 give calculations according to EN 1995-1-2:2004 and appendices 8-14 include calculations according to EN 1995-1-2:2020. Appendix 15 consists of calculations with the parameters of the tested beams and Appendix 16 gives an interview with Alar Just.

2. REVISION OF EUROCODE 5 PART 1-2

Revision process and proposed changes are described in this chapter. Grate amount of information in this chapter is based on the interview with Alar Just, presented in Appendix 16.

Revision of Eurocode 5 Part 1-2

The revision of Eurocode 5 began in 2012. The background research for the revised fire part of Eurocode 5 (EN 1995-1-2) was collected and discussed at CEN TC250 SC5 WG4 (Fire). The revised fire part of Eurocode 5 has been drafted by Project Team 4 of CEN TC250 SC5 (Andrea Frangi, Alar Just, Jouni Hakkarainen, Norman Werther, Joachim Schmid).

The first draft of the revised EN 1995-1-2 was published in May 2019. The second draft was published in May 2020 followed by the third draft in October 2020. The third draft of EN 1995-1-2 is the basis of this master thesis. The Final version of the EN 1995-1-2 is delivered by the Project Team in May 2021. Subsequent to this, the balloting, commenting, technical review and synchronising with other parts of Eurocodes will follow. The publishing of the revised Eurocode 5 Part 1-2 is expected in 2025.

Hereafter the currently valid Eurocode 5 Part 1-2 is referred to as **EN 1995-1-2:2004** and the proposal for the revised Eurocode 5 Part 1-2 as **EN 1995-1-2:2020** (dated 30.10.2020).

Revision of the design models

In EN 1995-1-2:2004, the European Charring Model is used for charring calculations. There are no significant changes in the charring rate values. However, the terms and symbols are slightly changed. In EN 1995-1-2:2020, the basic design charring rates are given in Table 5.2. The notional design charring rate is calculated by taking the relevant influencing coefficients into account [6].

The European Charring Model consists of different charring phases as follows [6]:

- **normal charring phase (Phase 1)** for initially unprotected sides of timber members and for initially protected sides of timber members,
- **encapsulated phase (Phase 0)** is the phase when no charring occurs,
- **protected charring phase (Phase 2)** is the phase when charring occurs behind the protection while the system is still in place,

- **post-protected charring phase (Phase 3)** is the phase after failure of the protection before a fully developed char layer has been formed,
- **consolidated charring phase (Phase 4)** is the phase with a fully developed char layer.

For the protected timber members there are time limits between the phases defined. For the calculation of start time of charring the Separating Function Method from EN 1995-1-2:2020 is used [6]. The design values for start time of charring are slightly different compared to EN 1995-1-2:2004.

EN 1995-1-2:2020 contains the generic failure times of gypsum boards, Type F [6]. These failure times are not included in EN 1995-1-2:2004. The thesis includes failure times from Fire Safety in Timber Buildings (2010) when using the design model of EN 1995-1-2:2004.

Calculation of the consolidation time is similar for EN 1995-1-2:2004 and EN 1995-1-2:2020.

For the charring of glulam members, the bondline integrity is assumed to be maintained.

In EN 1995-1-2:2004, the load-bearing capacity of glulam members can be calculated by using the Reduced Properties Method or the Effective Cross-Section Method (previously called the Reduced Cross-Section Method). In the revision process, TC250 SC5 WG4 made a decision that only the Effective Cross-section Method will be included in the revised version of EN 1995-1-2:2020. The Reduced Properties Method has not been further improved.

Many studies have shown that the load bearing capacity of the linear timber members in fire, calculated according to EN 1995-1-2:2004, can deliver overestimated fire resistance [7] [8]. The zero-strength layer of 7 mm according to EN 1995-1-2:2004 is not sufficient to compensate the stress loss of heated timber. The zero-strength layer values proposed in EN 1995-1-2:2020 are increased compared to EN 1995-1-2:2004.

3. DESIGN ACCORDING TO EN 1995-1-2:2004

Main parameters for design of glulam members in fire according to EN 1995-1-2:2004 are described in the following chapters.

3.1 Strength of timber in fire

The strength of timber is not constant in all conditions. The design strength of timber in fire is also different from the design strength of timber under normal temperatures [9]. The design value of the strength of material in case of fire should be calculated according to formula (3.1) [10].

$$f_{d,fi} = k_{mod,fi} \frac{f_{20}}{\gamma_{M,fi}}, \quad (3.1)$$

where $f_{d,fi}$ – design strength in fire, N/mm²,

$k_{mod,fi}$ – modification factor for fire,

f_{20} – the 20% fractile of a strength property at normal temperature, N/mm²,

$\gamma_{M,fi}$ – the partial safety factor for timber in fire.

It is recommended, that $\gamma_{M,fi} = 1,0$, unless a different value is given in the National Annex [10]. As the calculations are based on an effective cross-section method, the modification factor for fire is $k_{mod,fi} = 1,0$ [10]. The 20% fractile of strength property at normal temperature f_{20} is calculated according to formula (3.2) [10].

$$f_{20} = k_{fi} f_k, \quad (3.2)$$

where k_{fi} – coefficient,

f_k – characteristic strength, N/mm².

The value of coefficient k_{fi} for glue-laminated timber is 1,15 [10]. The characteristic strength of glue-laminated timber is taken from European standard EN 14080:2013 [11].

3.2 Charring depth of initially unprotected member

As the initially unprotected members are exposed to fire from the beginning of the fire, the charring process also starts with the fire. The charring rate for initially unprotected members is constant throughout the fire exposure [10]. See Figure 3.1.

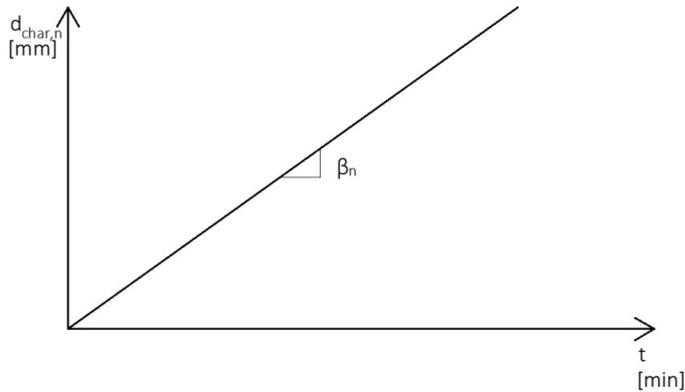


Figure 3.1 Relationship for initially unprotected members throughout the time of fire exposure [10]

In this research, all members are exposed to fire from more than 2 sides. Consequently, the notional charring rate should be taken into consideration. The notional charring rate includes the effect of corner roundings and fissures. It is calculated according to formula (3.3) [10]

$$d_{char,n} = \beta_n t, \quad (3.3)$$

where $d_{char,n}$ – notional charring depth, mm,

β_n – notional charring rate, mm/min

t – time of fire exposure, min.

The notional charring rate β_n for glued laminated timber with a characteristic density of $\geq 290 \text{ kg/m}^3$ is 0,7 mm/min. The permission of 3.4.2 (3) is not applied in this thesis [10].

3.3 Charring depth of initially protected member

If the timber member is protected from direct fire exposure, the start of charring is delayed until time t_{ch} . Other important moments for the charring of initially protected

members are the failure of protection t_f and time limit t_a [10]. For calculation of t_{ch} see 3.3.2, for calculation of t_f see 3.3.3 and for t_a see 3.3.4.

3.3.1 Variations of charring depth with time for initially protected member

The charring of initially protected members has different variations. Those variations are presented in Figure 3.2, Figure 3.3 and Figure 3.4.

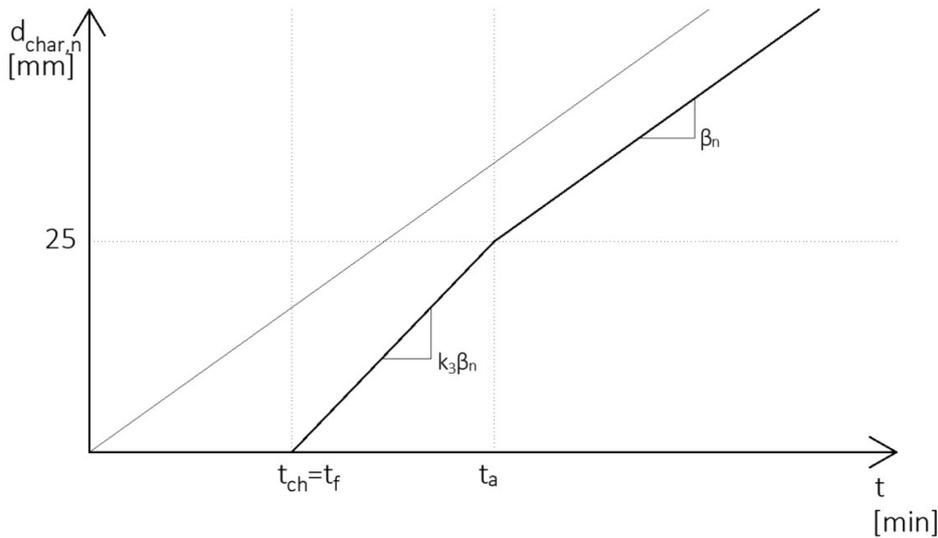


Figure 3.2 Determination of charring depth with time when $t_{ch} = t_f$ and the charring depth at time t_a is at least 25 mm. Reference line is charring of initially unprotected member. [10]

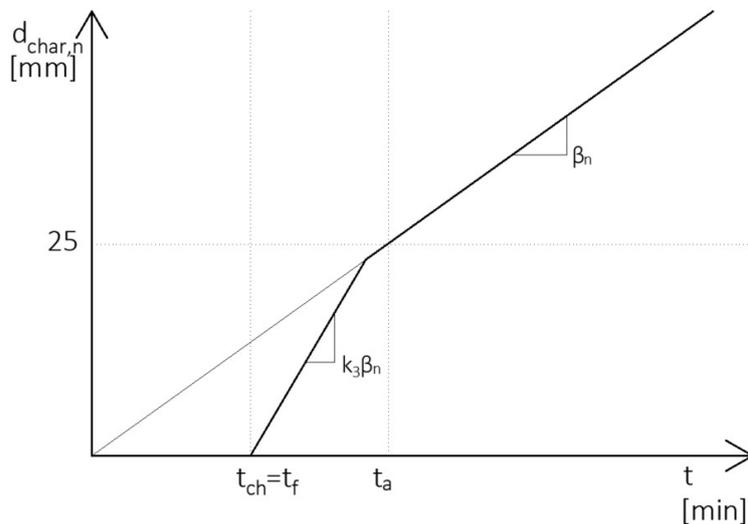


Figure 3.3 Determination of charring depth with time when $t_{ch} = t_f$ and the charring depth at time t_a is less than 25 mm. Reference line is charring of initially unprotected member. [10]

As seen in figures 3.2 and 3.3, an initially protected member that has the start time of charring equal with the failure time of protection, has 2 different charring rates. Between t_{ch} and t_a the member chars at a higher rate. The notional charring rate β_n is

multiplied by a factor $k_3 = 2$. After t_a the member chars at the same rate as the initially unprotected member, which in this research is 0,7 mm/min [10].

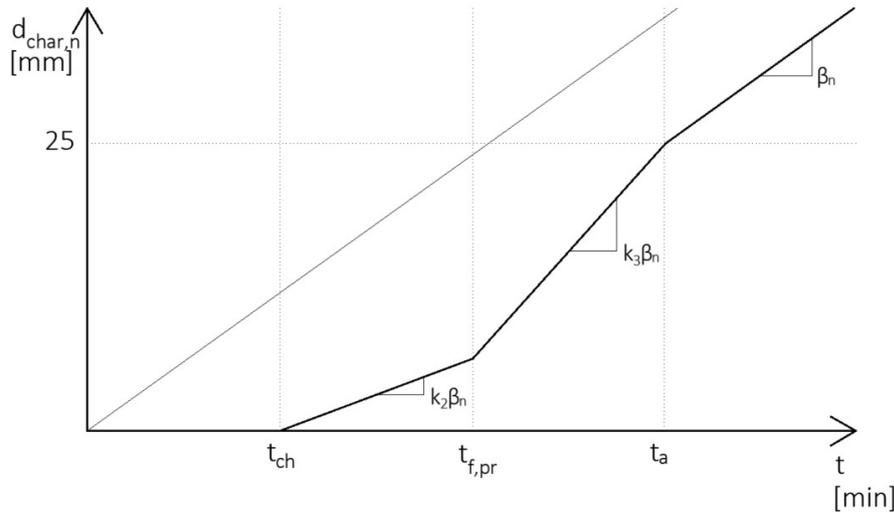


Figure 3.4 Determination of charring depth with time when $t_{ch} < t_f$. Reference line is charring of initially unprotected member. [10]

If $t_{ch} < t_f$, between t_{ch} and t_f , the member chars at a lower rate. Then the notional charring rate β_n is multiplied by a factor k_2 . For gypsum plasterboard type F, k_2 should be calculated using formula (3.4) [10].

$$k_2 = 1 - 0,018h_p, \quad (3.4)$$

where h_p – thickness of protective layer, mm.

After t_f , charring occurs similarly to members with $t_{ch} = t_f$ [10].

3.3.2 Start time of charring of protective layer

In this research, the protective layer consists of one layer of gypsum plasterboard type A or F. For claddings made of one layer of gypsum plasterboard type A or F with unfilled joints with a width less than 2mm, the start of charring should be taken as in the equation (3.5) [10].

$$t_{ch} = 2,8 h_p - 14 \quad (3.5)$$

where h_p – thickness of layer, mm.

3.3.3 Failure time of protective layer

The failure time of gypsum plasterboard type A should be calculated according to the formula (3.6) [10].

$$t_f = t_{ch} \quad (3.6)$$

The standard EN 1995-1-2:2004 does not give a value or equation for the failure time of gypsum plasterboard type F. In this research, the failure time of gypsum plasterboard type F is taken as equation (3.7) follows [12].

$$t_f = 4,5h_p - 24 \quad (3.7)$$

3.3.4 The time limit t_a

The time limit t_a is the moment, when the depth of the char layer reaches 25 mm or the charring depth of the same member without fire protection [10].

If $t_{ch} = t_f$, the time t_a is calculated according to formula (3.8) [10].

$$t_a = \min \left\{ \begin{array}{l} 2t_f \\ \frac{25}{k_3\beta_n} + t_f \end{array} \right. \quad (3.8)$$

where t_f – failure time of the fire protection, min,

k_3 – post-protection coefficient,

β_n – notional charring rate, mm/min.

If $t_{ch} < t_f$, time t_a is calculated according to formula (3.9) [10].

$$t_a = \frac{25 - (t_f - t_{ch})k_2\beta_n}{k_3\beta_n} + t_f \quad (3.9)$$

where t_f – failure time of the fire protection, min,

t_{ch} – start of charring, min,

k_3 – post-protection coefficient,

k_2 – insulation coefficient,

β_n – notional charring rate, mm/min.

3.4 Effective cross-section of the member

An effective cross-section of the member is an initial cross-section reduced by effective charring depth d_{ef} from all fire exposed sides. An effective cross-section is calculated using the formula (3.10) [10].

$$d_{ef} = d_{char,n} + k_0 d_0 \quad (3.10)$$

where d_0 – depth of zero-strength layer, mm,

k_0 – coefficient,

$d_{char,n}$ – notional charring depth, mm.

Value of the depth of zero-strength layer is 7 mm [10].

The coefficient k_0 is a variable coefficient. For unprotected members and initially protected members with the start of charring $t_{ch} < 20$ min, k_0 is calculated according to equation (3.11) [10].

$$k_0 = \begin{cases} \frac{t}{20} & \text{if } t < 20 \text{ min} \\ 1,0 & \text{if } t \geq 20 \text{ min} \end{cases} \quad (3.11)$$

For initially protected members with the start of charring $t_{ch} \geq 20$ min, k_0 is calculated according to formula (3.12) [10].

$$k_0 = \begin{cases} \frac{t}{t_{ch}} & \text{if } t < t_{ch} \text{ min} \\ 1,0 & \text{if } t \geq t_{ch} \text{ min} \end{cases} \quad (3.12)$$

The measurements of the effective cross-section are an effective height h_{ef} and an effective width b_{ef} . In this research, beams are open to fire from 3 sides. In that case, the measurements of the effective cross-section is shown in Figure 3.6 and is calculated according to formula (3.13) [10].

$$\begin{aligned} h_{ef} &= h - d_{ef} \\ b_{ef} &= b - 2d_{ef} \end{aligned} \quad (3.13)$$

where h_{ef} – effective height of cross-section, mm,

h – initial height of cross-section, mm,

b_{ef} – effective width of cross-section, mm,
 b – initial width of cross-section, mm.

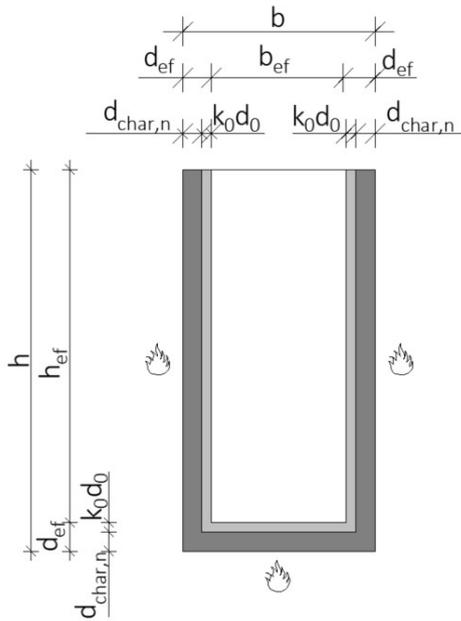


Figure 3.5 Effective cross-section for beams

In this research, columns are open to fire from 4 sides. In that case, the measurements of the effective cross-section is shown in Figure 3.6 and is calculated according to formula (3.14) [10].

$$\begin{aligned} h_{ef} &= h - 2d_{ef} \\ b_{ef} &= b - 2d_{ef} \end{aligned} \quad (3.14)$$

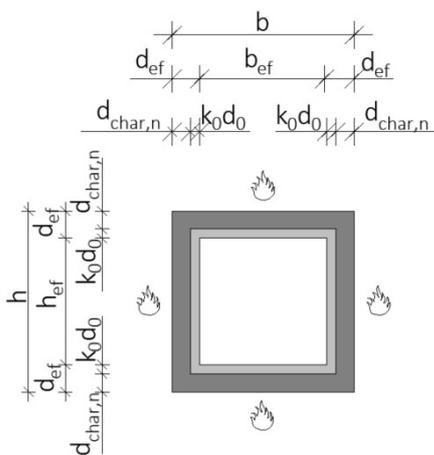


Figure 3.6 Effective cross-section for columns

4. DESIGN ACCORDING TO EN 1995-1-2:2020

Main parameters for design of glulam members in fire according to EN 1995-1-2:2004 are described in the following chapters.

4.1 Strength of timber in fire

In the 2020 version of Eurocode 5 the strength property for the fire situation is calculated according to formula (4.1) [6].

$$X_{d,fi} = \frac{k_{\theta} k_{fi} X_k}{\gamma_{M,fi}}, \quad (4.1)$$

- where $X_{d,fi}$ – design value of strength property for the fire situation, N/mm²,
 k_{θ} – temperature-dependent reduction factor for strength,
 k_{fi} – modification factor for a strength property for the fire situation,
 X_k – characteristic value of a strength property for normal temperature, N/mm²,
 $\gamma_{M,fi}$ – partial factor for the relevant mechanical material property for the fire situation.

The value of modification factor k_{fi} for glued laminated timber is 1,15 [6].

In this thesis, the maximum mechanical resistance at the required time is calculated. The design resistance has to satisfy the following condition (4.2) [6].

$$E_{d,fi} \leq R_{d,fi}, \quad (4.2)$$

- where $E_{d,fi}$ – design effect of actions for fire situation, N/mm²,
 $R_{d,fi}$ – design resistance in the fire situation, N/mm².

4.2 Charring depth

4.2.1 Notional charring depth and rate

The notional charring depth is a charring depth that includes the effect of corner roundings. It is calculated for all charring phases according to the formula (4.3) [6].

$$d_{char,n} = \beta_n t, \quad (4.3)$$

where $d_{char,n}$ – notional design charring depth, mm,

β_n – notional design charring rate, which includes the effect of corner roundings and fissures,

t – the time of fire exposure, min.

The notional charring rate varies and it is calculated for respective charring phase according to formula (4.4) [6].

$$\beta_n = \prod_{k_i} k_i \beta_0, \quad (4.4)$$

where $\prod_{k_i} k_i$ – product of applied modification factors,

β_0 – basic design charring rate, mm/min.

4.1.3 Modification factors

Modification factors are used in the calculation of the notional charring rate.

Modification factor k_{gd} takes into account the increased heat flux in the grain direction as equation (4.5) follows [6].

$$k_{gd} = \begin{cases} 1,0 & \text{for heat flux perpendicular to the grain direction} \\ 2,0 & \text{for heat flux in the grain direction} \end{cases} \quad (4.5)$$

In this thesis, heat flux is perpendicular to the grain direction; therefore $k_{gd} = 1,0$ [6].

Another modification factor is k_n . It is the conversion factor that considers the effect of corner roundings and the effect of cracks and fissures on the surface of the linear

member. The value for k_n for other than circular members should be taken as in equation (4.6) [6].

$$k_n = \begin{cases} 1,23 & \text{for solid linear timber members made of softwood} \\ & \text{and beech} \\ 1,08 & \text{for all other linear timber members} \end{cases} \quad (4.6)$$

This research is about glulam linear members; therefore, $k_n = 1,08$ [6].

4.3 Initially unprotected sides of members

Initially unprotected sides of glued and solid members with maintained glue line integrity have one linear charring phase as shown in Figure 4.1 [6].

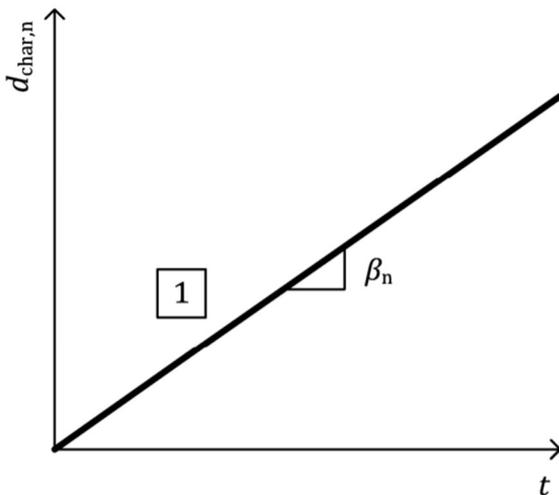


Figure 4.1 Charring depth of initially unprotected member:

1 – normal charring phase (phase 1), t – time, $d_{char,n}$ – notional charring depth, β_n – notional charring rate.

For initially unprotected members, the notional charring rate β_n should be calculated using formula (4.7) [6].

$$\beta_n = \prod_{k_i} k_i \beta_0 = k_{gd} k_n \beta_0, \quad (4.7)$$

4.4 Initially protected sides of members

Initially protected sides of members have up to 4 charring phases [6]. The phases and the calculation of the charring depth of initially protected members are elaborated on in the next sections.

4.4.1 Charring phases of initially protected members

As previously mentioned, initially protected members have more charring phases than initially unprotected members. Encapsulated, protected, post-protected and consolidated are the charring phases that occur in the charring of initially protected members. The encapsulated phase (Phase 0) is the phase when no charring occurs. The protected phase (Phase 2) is the phase when charring occurs behind the protection. The post-protected phase (Phase 3) is the phase after the failure of protection and before the char layer is fully developed. The consolidated phase (Phase 4) is the phase after the char layer is fully developed [6].

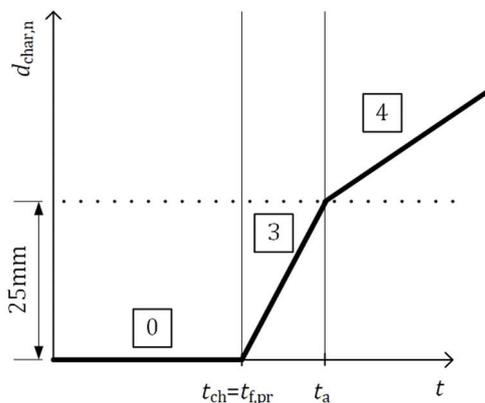


Figure 4.2 Charring of initially protected sides of timber members when $t_{f,pr}=t_{ch}$ and the charring depth at t_a is 25 mm [6]

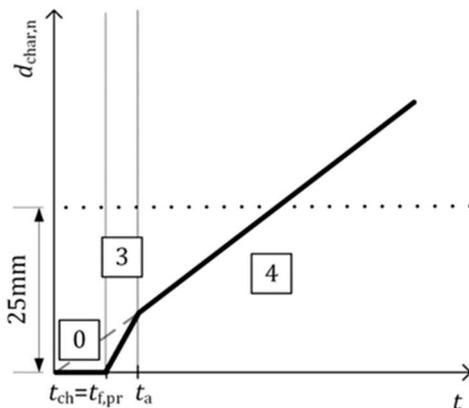


Figure 4.3 Charring of initially protected sides of timber members when $t_{f,pr}=t_{ch}$ and the charring depth at t_a is less than 25 mm [6]

As can be seen in Figure 4.2 and Figure 4.3, an initially protected member that has the start time of charring equal with the failure time of protection has 3 different charring phases. The encapsulated phase spans from the beginning of the fire until time t_{ch} . The charring begins after time t_f , when the failure of the protective layer occurs. This is followed by phase 3, where charring takes place at a higher rate than the charring in phase 1. The notional charring rate in phase 3 is calculated according to formula (4.8) [6].

$$\beta_{n,phase3} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_3 \beta_0, \quad (4.8)$$

For members that are not in timber frame assemblies, the post-protection factor k_3 for the post-protective phase should be taken as equation (4.9) states [6].

$$k_3 = 2,0. \quad (4.9)$$

The phase 3 ends at t_a and then phase 4 begins. The notional charring rate in phase 4 is calculated according to the following formula (4.10) [6].

$$\beta_{n,phase4} = \prod_{k_i} k_i \beta_0 = k_{gd} k_4 \beta_0, \quad (4.10)$$

The consolidation factor k_4 should be taken as equation (4.11) follows [6].

$$k_4 = 1,0. \quad (4.11)$$

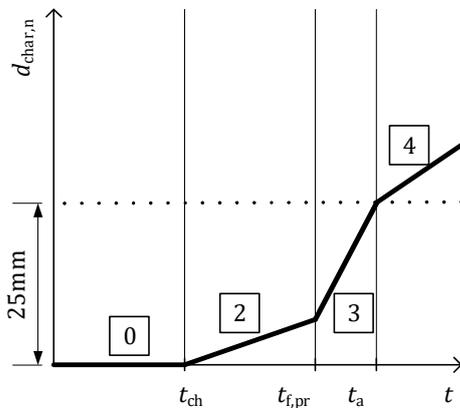


Figure 4.4 Charring of initially protected sides of timber members when $t_{f,pr} > t_{ch}$ [6]

If $t_{ch} < t_f$ as in Figure 4.4, then there is also phase 2 in addition to phases 0, 3 and 4. During the protected phase, the notional charring rate is lower than in phases 1, 3 and 4. The notional charring rate in phase 2 is calculated according to formula (4.12) [6].

$$\beta_{n,phase2} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_2 \beta_0, \quad (4.12)$$

where k_2 – the modification factor.

If gypsum fibreboards or gypsum plasterboards are used, k_2 should be calculated using the formula (4.13) [6].

$$k_2 = 1 - \frac{h_p}{55}, \quad (4.13)$$

where h_p – the thickness of the gypsum plasterboards or gypsum fibreboards, mm.

4.4.2 The failure time of the fire protection system

The failure time $t_{f,pr}$ of the fire protection systems depends on the type of protection and the number of protective layers. If the protection time is applied to linear members, then the failure time is increased by 20% [6]. In this thesis, 20% increased formulas for walls are used for columns and 20% increased formulas for ceilings are used for ceilings as shown in Table 4.1 [6].

Table 4.1 Failure times of protection [6]

| | | |
|-----------------------------|-------------------------------|--------|
| One layer of GtF for column | $t_{f,pr} = 1,2(3,9h_p - 16)$ | (4.14) |
| One layer GtA for column | $t_{f,pr} = 1,2(1,8h_p - 5)$ | (4.15) |
| One layer of GtF for beam | $t_{f,pr} = 1,2(1,6h_p + 3)$ | (4.16) |
| One layer GtA for beam | no formula | |

where h_p – thickness of layer, mm.

If there is no rule given for the failure time $t_{f,pr}$, the failure time is taken as the formula (4.17) follows [6]. In this research, this formula is used in the failure time calculations of one layer of GtA on a beam.

$$t_{f,pr} = t_{ch} = \sum t_{prot}, \quad (4.17)$$

where $\sum t_{prot}$ – the sum of protection times of the fire protection system for separating function, min,

t_{ch} – the start time of charring, min.

4.4.3 The start time of charring

The time of the beginning of charring behind the protection system should be calculated based on the following formula (4.18) [6].

$$t_{ch} = \min \left\{ \sum t_{prot}, t_{f,pr} \right\}, \quad (4.18)$$

The protection time is calculated according to the following formula (4.19) [6].

$$t_{prot,i} = (t_{prot,0,i} \cdot k_{pos,exp,i} \cdot k_{pos,unexp,i} + \Delta t_i) \cdot k_{j,i}, \quad (4.19)$$

where $t_{prot,0,i}$ – the basic protection time of the considered layer I, min,

$k_{pos,exp,i}$ – position coefficient that takes into account the influence of layers preceding the layer considered,

$k_{pos,unexp,i}$ – position coefficient that takes into account the influence of layers backing the layer considered,

Δt_i – the correction time for layer i, min.

$k_{j,i}$ – the joint coefficient for the layer.

As in this thesis $\Delta t_i=0$ and all the other components of the formula other than $t_{prot,0,i}$ are equal to 1, the protection time can be taken equal with $t_{prot,0,i}$ [6]. In this research only one layer and one type of protective layer at time is used on the members. Consequently, the sum of protection times of the fire protection system can be calculated according to formula (4.20) [6].

$$\sum t_{prot} = t_{prot,0,i} = 30 \left(\frac{h_p}{15} \right)^{1,2}, \quad (4.20)$$

where h_p – thickness of layer, mm.

4.4.4 Time of reaching the encapsulated phase

The time t_a , when the char layer is fully developed, should be calculated using the following formula (4.21) [6].

$$t_a = \min \left\{ t_{f,pr} + \frac{2 t_{f,pr}}{25 - (t_f - t_{ch})\beta_{n,phase2}}, \right. \quad (4.21)$$

The char layer has fully developed if the depth of the char layer reaches 25mm or the depth of the char layer of the initially unprotected member [6].

4.5 Effective cross-section of linear members

The effective charring depth for each fire exposed side should be calculated according to formula (4.22) [6].

$$d_{ef} = d_{char,n} + d_0, \quad (4.22)$$

where d_{ef} – the effective charring depth, mm,

$d_{char,n}$ – the notional charring depth, mm,

d_0 – depth of zero-strength layer, mm.

The depth of the notional char layer is calculated according to the previous sections. The zero-strength layer depth is taken in accordance with Table 4.2 and Figure 4.5.

Table 4.2 Values of zero-strength layer depth d_0 for linear members [6].

| Stress | R30 / mm | R60 and more / mm |
|-------------|----------|-------------------|
| Bending | 7 | 10 |
| Compression | 14 | 16 |

For fire resistance between 30 and 60 minutes, values of zero-strength layer depth may be interpolated linearly [6]. The permission is not applied in this thesis.

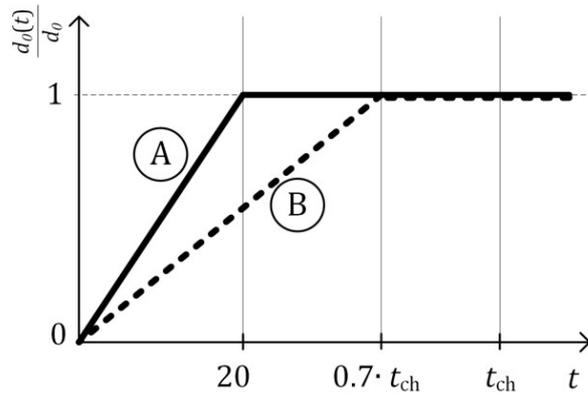


Figure 4.5 Determination of the value of zero-strength layer depth d_0 as a function of the time, A – increase of the zero-strength layer depth for initially unprotected members, B – increase of the zero-strength layer depth for initially protected members

The effective width of an effective cross-section shall be calculated as formula (4.23) follows [6].

$$b_{ef} = b - k_{sides}d_{ef}, \quad (4.23)$$

where b_{ef} – the effective width of effective cross-section, mm,

b – the initial width of cross-section, mm,

d_{ef} – effective depth of charring, mm.

The effective height of an effective cross-section should be calculated according to formula (4.24) [6].

$$h_{ef} = h - k_{sides}d_{ef}, \quad (4.24)$$

where h_{ef} – the effective height of effective cross-section, mm,

h – the initial height of cross-section, mm,

k_{sides} – number of respective opposite sides exposed to fire,

5. CALCULATIONS NOT BASED ON EN 1995-1-2

In this research, columns are subjected to compression.

Stability of members

The stability of members is not covered in EN 1995-1-2 but is in EN 1995-1-1. As there was no accessibility to the EN 1995-1-1:2020 draft, the stability calculations are based on EN 1995-1-1:2005. As the columns have equal height and width, it is necessary to evaluate the slenderness corresponding to bending only in one direction.

The moment of inertia for rectangular members is calculated according to formula (5.1) [13].

$$I_y = \frac{bh^3}{12}, \quad (5.1)$$

where b – the width of cross-section, mm,

h – the height of cross-section, mm.

As we are analysing the stability of a charred member, the formula (5.1) takes a formation of formula (5.2), where the dimensions of cross-section are replaced with the effective height and effective width of a charred member.

$$I_y = \frac{b_{ef}h_{ef}^3}{12}, \quad (5.2)$$

where I_y – the moment of inertia, mm⁴,

b_{ef} – the effective width of effective cross-section, mm,

h_{ef} – the effective height of effective cross-section, mm.

As we know the effective cross-section and the moment of inertia, it is possible to calculate the radius of gyration, using the formula (5.3) [13].

$$i_y = \sqrt{\frac{I_y}{A}}, \quad (5.3)$$

where i_y – the radius of gyration, mm,

I_y – the moment of inertia, mm⁴,

A – the area of effective cross-section, mm².

The relative slenderness ratio $\lambda_{rel,y}$ is calculated according to formula (5.4) [14].

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,0,k}}{E_{0,05}}}, \quad (5.4)$$

where λ_y – slenderness ratio corresponding to bending about the y-axis,

$f_{c,0,k}$ – the compressive strength along the grain,

$E_{0,05}$ – the fifth percentile value of the modulus of elasticity parallel to the grain.

The slenderness ratio corresponding to bending about the y-axis is calculated as the formula (5.5) follows [13].

$$\lambda_y = \frac{l_{ef}}{i_y}, \quad (5.5)$$

where l_{ef} – the effective length of member, mm.

The effective length is calculated according to formula (5.6) [13].

$$l_{ef} = \mu l, \quad (5.6)$$

where μ – the support factor.

In this thesis, $\mu = 0,7$ [9].

If the relative slenderness ratio satisfies condition $\lambda_{rel,y} \leq 0,3$, then the stresses should satisfy the following condition (5.7) [9].

$$\sigma_{c,0,d} \leq f_{c,0,d}, \quad (5.7)$$

where $\sigma_{c,0,d}$ – the design compressive stress along the grain, N/mm²,

$f_{c,0,d}$ – the design compressive strength along the grain, N/mm².

If the relative slenderness ratio does not satisfy the condition, then the stress should satisfy the following condition (5.8) [9].

$$\sigma_{c,0,d} \leq k_{c,y} f_{c,0,d}, \quad (5.8)$$

where $k_{c,y}$ – instability factor.

The instability factor $k_{c,y}$ is calculated according to formula (5.9) [14].

$$k_{c,y} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}, \quad (5.9)$$

To calculate the instability factor $k_{c,y}$, another instability factor k_y is needed. The instability factor k_y is calculated according to formula (5.10) [14].

$$k_y = 0,5(1 + \beta_c(\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2), \quad (5.10)$$

where $\lambda_{rel,y}$ – relative slenderness ratio,

β_c – straightness factor.

The straightness factor β_c for glulam timber is 0,1 [14].

6. COMPARISON OF EN 1995-1-2:2004 AND EN 1995-1-2:2020

6.1 Differences in calculations of glulam linear members

Strength parameters

As in fire design the strength parameters are not the same as in the normal temperature design, it is necessary to calculate the strength parameters. The calculations of strength parameters are presented in Appendix 1 in this thesis for the 2004 version of Eurocode 5 and in Appendix 8 for the 2020 version of Eurocode 5.

In this thesis, the values of the fire design strength parameters are the same in calculations according to the 2004 and 2020 versions of Eurocode 5. However, the formulas have changed in the 2020 version and therefore the calculations are different. In the 2004 version of Eurocode 5, formula (3.2) is used to calculate the 20% fractile of strength property and then the result is used in formula (3.1) to calculate the design strength in fire. In the 2020 version of Eurocode 5, the 20% fractile is not calculated separately, but the 2 formulas are combined in one formula (4.1). Furthermore, in the 2020 version, instead of modification factor $k_{mod,fi}$, the temperature-dependent reduction factor for a strength and stiffness k_{θ} is used. However, both factors are taken as 1,0 for the Effective Cross-Section Method.

Charring of unprotected member

The principles of the charring process of unprotected linear members are the same in both versions of Eurocode 5. Nevertheless, the charring rate has slightly changed. While the notional charring rate for glulam in the 2004 version was given as 0.7 mm/min, in the 2020 version it is calculated according to the formula (4.7). As seen in Appendix 9, according to the 2020 version, the notional charring rate for glulam linear members is 0,702 mm/min, which is 0,002 mm/min higher than in the previous version. The change is still very small.

Start time of charring

If the timber member has a protective layer on it, then the start of charring is delayed until the time t_{ch} . In this research, 2 types of protection were used – 1 layer of GtA 12,5 and 1 layer of GtF 15. The 2004 version of Eurocode 5 uses formula (3.5) to calculate the start time of charring for claddings made of gypsum plasterboard type A

and type F. In the 2020 version, the calculation of the start time of charring is performed by formulas (4.18)-(4.19) and is more complex. While one formula is suited for all GtA and GtF claddings in EN 1995-1-2:2004, GtA and GtF claddings have different formulas for the start time of charring in the new Eurocode 5. In this thesis, formula (4.20) is used in the case of 1 layer of GtA on the beam; in other cases, (4.18) and (4.14)-(4.16) are applied. In the 2020 version, there are also different rules for the failure time of the fire protection system of walls and ceilings. Those rules can be applied to linear members by increasing the results by 20% and the formulas are used to calculate the start time of charring. If the 20% increased start time of charring exceeds failure time of protection, the start time of charring is taken equal to the failure time of protection.

Failure time of protection

In the fire design models, an important point is the failure time of the protection system. In EN 1995-1-2:2004 the failure times of protection were not provided unless the failure time was taken equal to start time of charring. In the 2020 version, the failure time of protection is used in calculating the start time of charring. As analysed in the previous point, in the 2020 version, the failure time of the fire protection system of walls and ceilings have different rules for GtA and GtF protection systems and can be applied to linear members as presented in formulas (4.14)-(4.16). In case of 1 layer of GtA on beam, the failure time is equal to the start time of charring as formula (4.17) states.

In the 2004 version of Eurocode 5, the formula (3.6) states that the failure time of the protection system made of GtA is equal to the start time of charring. However, the 2004 version has no rule for the failure time of the protective cladding made of GtF. In this research, formula (3.7) was used to calculate the failure time of a fire protection system made of GtF cladding.

According to the 2020 version the failure time of the fire protection system applied to linear members may be increased by 20%.

Time of reaching the consolidated charring phase

After the failure time of protection, the next important point is the time of reaching the consolidated charring phase. The concept of phases is introduced in EN 1995-1-2:2020. In EN 1995-1-2:2004 phases were described by the start and end time of the phase and as a relationship between $d_{char,n}$ and time.

In the 2004 version of Eurocode 5, it is calculated according to formula (3.8) for members without protected charring phase and according to formula (3.9) for members

with a protected charring phase. In the 2020 version, those 2 formulas are combined into one (4.21) and there is no longer a difference in the t_a calculation for members with or without a protected charring phase. Furthermore, a part of formula (3.8) is no longer used. The calculation process for the time of reaching the consolidated phase is easier for the user in the 2020 version, as there are fewer rules to be followed.

Protected charring phase

If the start time of charring and the failure time are not equal, then the charring occurs behind the protective cladding. In the protected charring phase, the charring rate is lower than in the unprotected charring. In the 2004 version of Eurocode 5, the given notional charring rate was multiplied by the factor k_2 calculated according to formula (3.4). In the 2020 version, the charring rate is calculated according to formula (4.12) and (4.13). In addition to the changes that also occur in the calculation process of an unprotected member, there is a change in the k_2 formula. Nevertheless, the change does not affect the result. In the newer version of the Eurocode 5, the coefficient that is multiplied by the thickness of protective cladding is given as a fraction and not as a decimal, as was the case in the previous version.

Post-protected charring phase

After the failure of protection, the charring occurs in a higher rate than the charring of an unprotected member. In this charring phase, in the 2004 version the notional charring rate is multiplied by k_3 and in the 2020 version, the notional charring rate is calculated according to the formula (4.8). As the coefficient k_3 is the same in both versions of the Eurocode 5, the only differences that occur are the same that are also in the charring of unprotected member that is analysed afore.

Consolidated charring phase

The last charring phase of protected members is the consolidated charring phase. In the 2004 version, the charring rate in this phase equals the charring rate of the unprotected member. In 2020 version, in the consolidated phase the charring rate is multiplied by coefficient k_4 , that equals 1. Again, the only differences that occur are the same that also occur in the charring of unprotected member.

Effective cross-section

In both versions, the effective cross-section is calculated by removing the effective charring depth from the initial cross-section. The calculation of the depth of the char layer is done according to the charring phases, charring rate and the duration of fire

exposure. In the 2004 version of Eurocode 5, the effective charring depth is calculated using formula (3.10) and it consists of the sum of the notional charring depth and a multiplication of the depth of zero-strength layer d_0 and coefficient k_0 . In that version, the depth of the zero-length layer is constant and coefficient k_0 is a variable from 0 to 1, which depends on the existence of the protection and the time of fire exposure. In the 2020 version, the effective depth of the char layer is calculated according to the formula (4.22). The depth of the zero-strength layer is no longer multiplied by a variable coefficient, but the zero-strength layer is a variable instead. The zero-strength layer varies according to the time of fire exposure and the type of stress. While the multiplication of d_0 and k_0 varied from 0 to 7 mm in the 2004 version, in the 2020 version d_0 varies from 7 to 16 mm. Consequently, the fire resistance of timber members according to the 2020 version of the Eurocode 5 is lower than it is according to the 2004 version.

6.2 Load-bearing capacity of beams

In this research, the beams are made of combined glulam from strength class GL24c. The applied force causes bending stress in the beams. The aim of the calculations is to find the highest applicable forces that do not cause a failure of the beams. The beams are exposed to fire from 3 sides. The time of standard fire in the calculations is 30, 60 and 90 minutes. The calculation examples are in appendices and the results are presented in Table 6.2. In the table and figures, EC5:2004 stands for EN 1995-1-2:2004 and EC5:2020 for EN 1995-1-2:2020. The references to Appendices consisting of calculation examples and results for beams are shown in Table 6.1.

Table 6.1 References to calculations about beams

| Content | EC5:2004 | EC5:2020 |
|--|-----------------|-----------------|
| Calculations of the strength parameters | Appendix 1 | Appendix 8 |
| Calculations of initially unprotected glulam beam | Appendix 2 | Appendix 9 |
| Calculations of glulam beam with one layer of GtA 12,5 | Appendix 3 | Appendix 10 |
| Calculations of glulam beam with one layer of GtF 15 | Appendix 4 | Appendix 11 |

6.2.1 The change of maximum bending moments

Table 6.2 Maximum bending moments on beams in kilonewtonmeters

| Time | | 30 min | | 60 min | | 90 min | |
|------------------|---------------|----------|----------|----------|----------|----------|----------|
| Protective layer | Cross-section | EC5:2004 | EC5:2020 | EC5:2004 | EC5:2020 | EC5:2004 | EC5:2020 |
| None | 80x200 | 3.2 | 3.2 | 0 | 0 | 0 | 0 |
| | 200x400 | 91.6 | 91.5 | 57.8 | 53.3 | 30 | 26.3 |
| | 200x600 | 216.7 | 216.5 | 142.4 | 132.2 | 77.5 | 68.4 |
| | 200x1000 | 625.8 | 625.2 | 424.3 | 395.7 | 238.7 | 211.9 |
| GtA 12,5 | 80x200 | 6.1 | 7.7 | 0 | 0 | 0 | 0 |
| | 200x400 | 107 | 115.3 | 61 | 59.7 | 32.6 | 31.5 |
| | 200x600 | 249.1 | 266.4 | 149.7 | 146.7 | 83.9 | 81.1 |
| | 200x1000 | 710.9 | 755.8 | 444.7 | 436.3 | 257.4 | 249.2 |
| GtF 15 | 80x200 | 10.8 | 11.3 | 1.2 | 0 | 0 | 0 |
| | 200x400 | 130 | 132.1 | 79.6 | 67.6 | 47.8 | 37.9 |
| | 200x600 | 296.5 | 300.8 | 190.8 | 164.4 | 119.7 | 96.5 |
| | 200x1000 | 832.6 | 843.6 | 556.7 | 485 | 360.6 | 294 |

As can be seen in Table 6.2, after 30 minutes of fire, the maximum bending forces on initially unprotected beams have stayed the same and on initially protected beams they have increased. However, after 60 and 90 minutes of fire, according to EN 1995-1-2:2020 all beams examined in this thesis have smaller maximum bending forces than according to EN 1995-1-2:2004.

To have a better overview of the size of the change, the results of calculations according to 2020 version of Eurocode 5 were examined as a percentage of the results of calculations according to the 2004 version. The percentage was calculated according to formula (6.1) and the results are shown in Figure 6.1.

$$\frac{EC5:2020}{EC5:2004} \cdot 100\%, \quad (6.1)$$

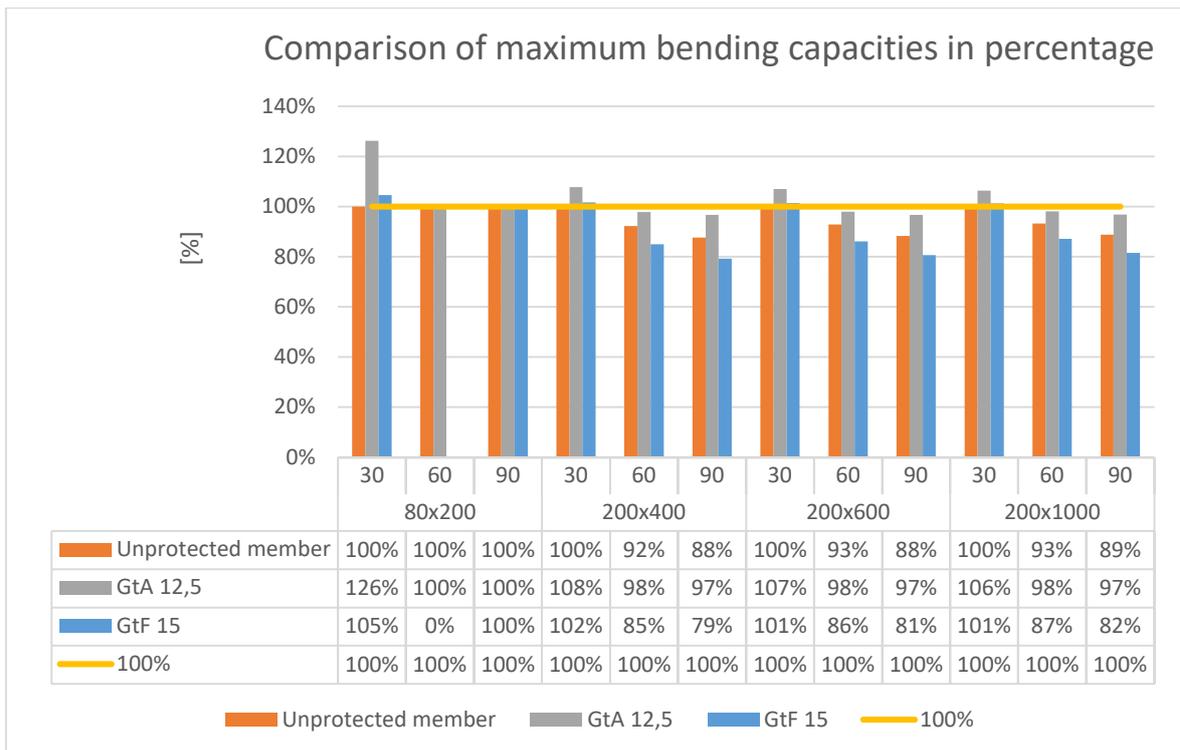


Figure 6.1 Comparison of maximum bending capacities on beams in percentage

As can be seen in Figure 6.1, after 30 minutes of fire the maximum bending capacities on initially unprotected beams have stayed the same. This is due to the same depth of the zero-strength layer and the same notional charring rate. After 60 minutes of fire, the maximum bending capacities have decreased on all other cross-sections but 80x200. The 80x200 cross-section has stayed the same, because the cross-section is fully charred by 60 minutes of fire and does not bear any loads. The maximum bending capacities on larger cross-sections have decreased because of the change in the depth of the zero-strength layer.

Figure 6.1 also shows, that the maximum bending capacities are the most significant among beams with one layer of GtA 12,5. After 30 minutes of fire, the maximum bending capacity according to EN 1995-1-2:2020 on the 80x200 cross-section is even 126% of the capacity according to EN 1995-1-2:2004. As the design strength of timber is the same according to both versions of Eurocode 5, the change is due to the effective depth of the cross-section and is the same in all cross-sections. The difference is smaller among larger cross-sections as the larger cross-sections can bear larger forces therefore, small changes affect the cross-section less. After 60 minutes of fire, the maximum bending capacity has decreased on cross-sections that have not completely charred yet.

The increase of the maximum bending capacities can be noticed among beams with one layer of GtF after 30 minutes. Again, after 60 minutes of fire, the maximum bending capacity has decreased. The decrease is proportionally biggest on the 80x200 cross-section because, as can be seen in Table 6.2, the maximum compressive force in this situation according to EN 1995-1-2:2004 is 1,2 kNm but is 0 kNm according to EN 1995-1-2:2020. The other cross-sections have a decrease in the maximum bending force due to the larger effective depth of the char layer. The effective depth of the char layer is examined more thoroughly in the next section.

6.2.2 Effective depth of char layer on beams

The effective depth of the char layer consists of the depth of the notional char layer and the depth of the zero-strength layer. Figure 6.2 presents the change of notional charring depth on investigated types of beams in time according to both EN 1995-1-2:2004 and EN 1995-1-2:2020.

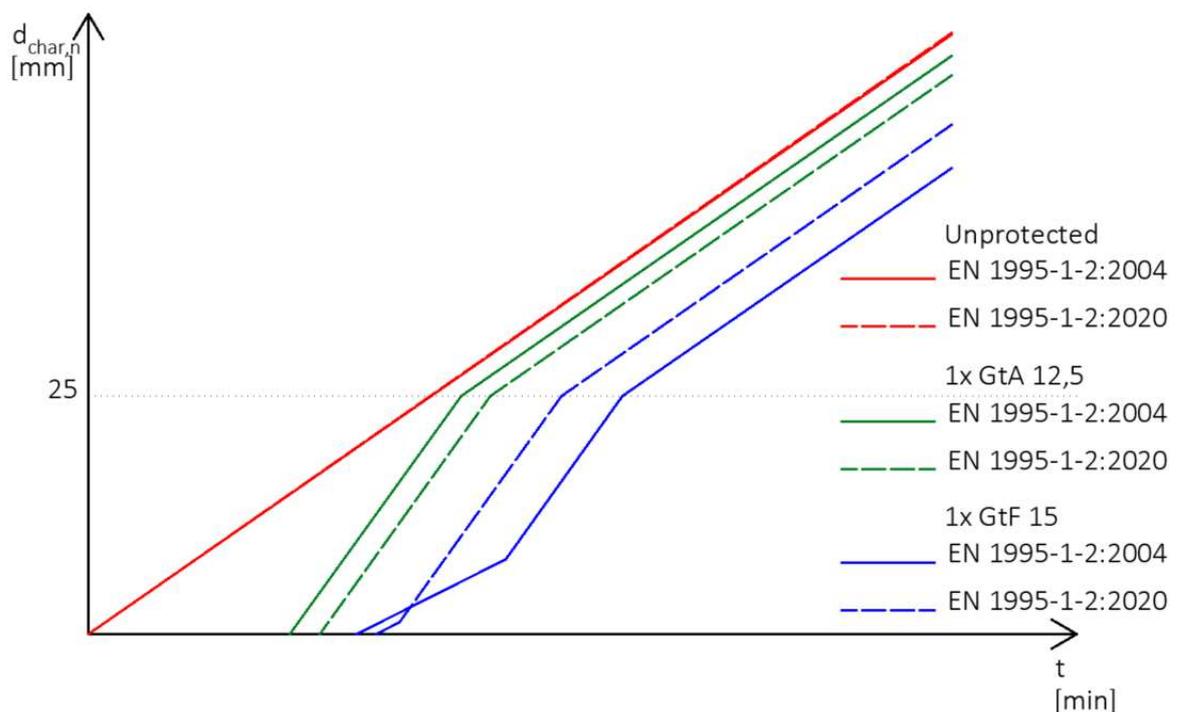


Figure 6.2 Charring depth of beams presented in this thesis:
 $d_{char,n}$ – notional design charring depth.

As can be seen in Figure 6.2, the notional charring depth for initially unprotected beams has not significantly changed when comparing the 2004 and the 2020 versions of Eurocode 5. There is a small change due to the charring rate (see section 6.1.2). However, this change is very small.

On the other hand, the notional charring depth for initially protected beams has changed significantly. As shown in Figure 6.2, the notional charring depth for beams with one layer of gypsum plasterboard type A according to EN 1995-1-2:2020 is smaller than the notional charring depth according to EN 1995-1-2:2004. This is because, according to EN 1995-1-2:2020 t_{ch} and t_f have larger values than according to the 2004 version of Eurocode 5. The charring rate has changed marginally in all phases for beams with one layer of GtA 12,5.

Moreover, the notional charring rate for beams with protective system of one layer of GtF has changed. If for beams with one layer of GtA it has decreased for all moments throughout charring, then for beams with one layer of GtF it differs through the charring process. The start time of charring is earlier in calculations according to EN 1995-1-2:2004. As the difference in charring rate is marginal, then in the beginning of charring, the notional charring depth is larger in calculations according to EN 1995-1-2:2004.

Nevertheless, the failure time of protective cladding is much smaller in calculations according to EN 1995-1-2:2020. Due to this and the higher charring rate in phase 3, between the failure times, the notional charring depth according to EN 1995-1-2:2020 becomes deeper than the notional charring depth according to EN 1995-1-2:2004. For both versions, the consolidated charring phase begins when the depth of the notional charring is 25 mm. However, as in phase 3, the notional charring depth is deeper in calculations according to EN 1995-1-2:2020; therefore, the beams calculated according to the 2020 version of Eurocode 5 reach the consolidated phase earlier than the beams calculated according to EN 1995-1-2:2004.

As mentioned above, the effective charring depth includes the depth of the zero-strength layer in addition to the notional charring depth. The depths of the zero-strength layer for members with bending stress are presented in Table 6.3.

Table 6.3 Depth of zero-strength layer for beams

| time / min | $k_0 d_0$ (EC:2004) / mm | d_0 (EC:2020) / mm |
|-------------------|--|--|
| 30 | 7 | 7 |
| 60 | 7 | 10 |
| 90 | 7 | 10 |

As can be seen in Table 6.3, the zero-strength layer in EN 1995-1-2004 is constant. However, this has changed in EN 1995-1-2:2020. Therefore, after 60 minutes of fire, the zero-strength layer increases by 3 mm from 7 mm to 10 mm.

The results of the effective depth of the char layer for beams are shown in Table 6.4

Table 6.4 Effective depth of char layer for beams

| Protective layer | time / min | EC:2004 / mm | EC:2020 /mm |
|-------------------------|-------------------|---------------------|--------------------|
| None | 30 | 28.00 | 28.06 |
| | 60 | 49.00 | 52.12 |
| | 90 | 70.00 | 73.18 |
| GtA 12,5 | 30 | 19.60 | 15.28 |
| | 60 | 46.80 | 47.70 |
| | 90 | 67.80 | 68.76 |
| GtF 15 | 30 | 8.02 | 7.00 |
| | 60 | 35.01 | 42.49 |
| | 90 | 56.01 | 63.55 |

As can be seen in Table 6.4, the effective depth of the char layer has stayed almost the same for an initially unprotected beam after 30 minutes of fire. The 0,06 mm change comes from the difference in the charring rate. At 60 minutes, the depth of the zero strength layer increases by 3 mm, and that change can be seen in the effective depth of the char layer in initially unprotected members after 60 and 90 minutes of fire.

The effective depth of char layer of the beam with one layer of GtA 12,5 has decreased in calculations according to EN 1995-1-2:2020 after 30 minutes of fire. That is due the difference in the start time of charring. However, after 60 minutes, when the depth of the zero-strength layer increases, the effective depth of char layer of the beam with one layer of GtA 12,5 is bigger in calculations according to EN 1995-1-2:2020.

The effective depth of the char layer on beams with one layer of GtF 15 in calculations according to EN 1995-1-2:2020 after 30 minutes of fire consists only of the depth of the zero-strength layer. According to EN 1995-1-2:2004, however, the charring has already started and the effective depth of the char layer is larger and consists of both the zero-strength layer and the notional char layer; therefore, it is deeper. After 60 minutes of fire, the effective depth of the charring is deeper in calculations according to EN 1995-1-2:2020. The difference is caused by the 3 mm difference in the depth of the zero-strength layer and the notional charring depth.

The graphs of the effective depths of charring in all the beams examined in this research are shown in Figure 6.3.

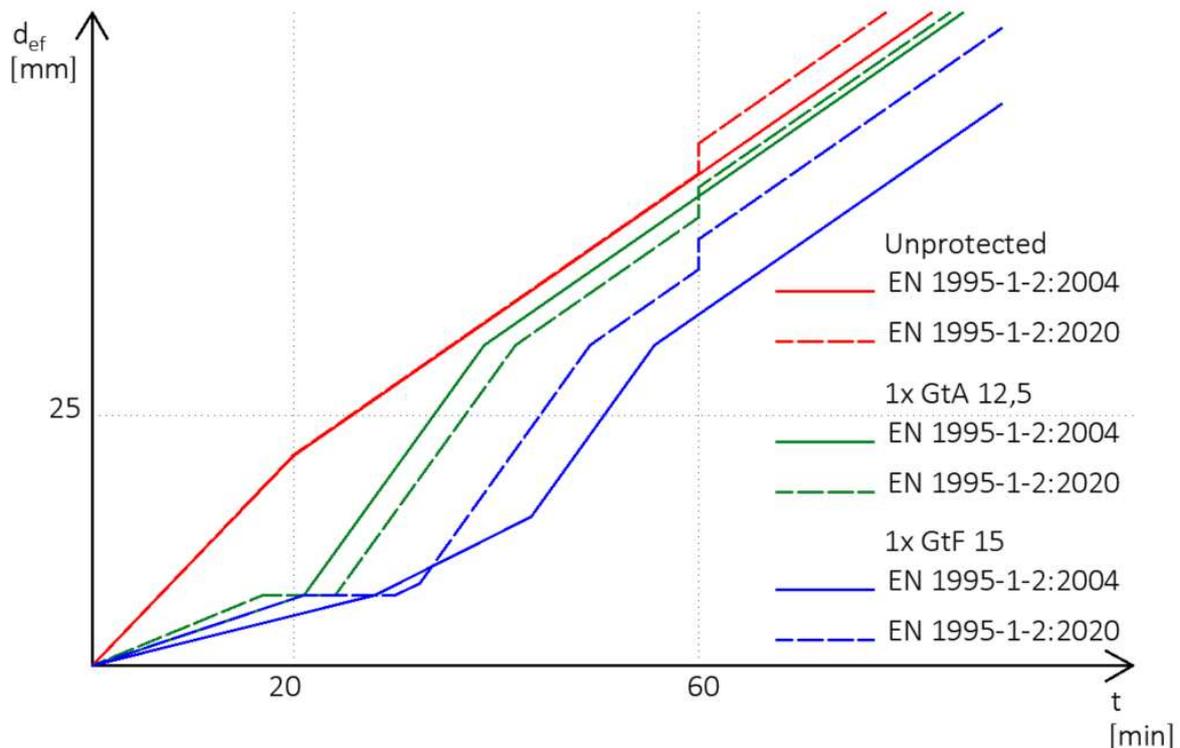


Figure 6.3 The change of the effective depth of the char layer on beams over time, d_{ef} – effective charring depth.

As can be seen in Figure 6.3 and as mentioned above, the effective depth of the char layer is almost the same for initially unprotected beams until 60 minutes of fire. Subsequently, according to EN 1995-1-2:2020, the depth of the zero-strength layer increases. Therefore, the effective depth of the char layer is deeper in calculations based on EN 1995-1-2:2020 after 60 minutes of fire.

The effective depth of the char layer on beams initially protected with one layer of gypsum plasterboard type A is deeper in calculations based on EN 1995-1-2:2020 at the beginning of charring. This is because, according to EN 1995-1-2:2020 the zero-strength layer develops faster than according to EN 1995-1-2:2004. The start of charring for beams with one layer of GtA occurs earlier according to EN 1995-1-2:2004, the depth of the zero-strength layer is equal. Because of that, the depth of the effective char layer is deeper in the phase 3 according to EN 1995-1-2:2004. The effective depth of the char layer is deeper again according to EN 1995-1-2:2020 from 60 minutes of fire, as then the depth of the zero-strength layer increases by 3 mm and the difference in the notional charring depth is less than 3 mm.

Similarly, the effective char layer in phase 0 on beams with one layer of GtF is also larger in calculations according to EN 1995-1-2:2020. However, as in calculations according to EN 1995-1-2:2004, the start time of charring is earlier and the failure time

later than in calculations according to EN 1995-1-2:2020. In calculations according to EN 1995-1-2:2004, the effective depth of the char layer in phase 2 is deeper. After that, due to the earlier failure time in EN 1995-1-2:2020, the effective depth of the char layer is deeper in calculations according to EN 1995-1-2:2020.

6.3 Load-bearing capacity of columns

In this research, the columns are made of homogenous glulam from strength class GL24h. The length of the columns is 3 m. Buckling length is considered 2,1 m. The applied force causes compressive stress in the member. The aim of the calculations is to find the highest applicable load that does not result in failure of the member. The columns are exposed to fire from all 4 sides. The time of standard fire in the calculations is 30, 60 and 90 minutes. The calculation examples are in appendices and the results are presented in Table 6.6. In the table and in the figures, EC5:2004 stands for the 2004 version of Eurocode 5 and EC5:2020 for the 2020 version of Eurocode 5. The references to Appendices consisting calculation examples and results for columns are shown in Table 6.5.

Table 6.5 References to calculations about columns

| Content | EC5:2004 | EC5:2020 |
|--|------------|-------------|
| Calculations of the strength parameters | Appendix 1 | Appendix 8 |
| Calculations of initially unprotected glulam column | Appendix 5 | Appendix 12 |
| Calculations of glulam column with one layer of GtA 12,5 | Appendix 6 | Appendix 13 |
| Calculations of glulam column with one layer of GtF 15 | Appendix 7 | Appendix 14 |

6.3.1 The change of maximum compressive forces

Table 6.6 Maximum compressive forces on columns in kilonewtons

| Time | | 30 min | | 60 min | | 90 min | |
|------------------|---------------|----------|----------|----------|----------|----------|----------|
| Protective layer | Cross-section | EC5:2004 | EC5:2020 | EC5:2004 | EC5:2020 | EC5:2004 | EC5:2020 |
| None | 80x80 | 0.5 | 0 | 0 | 0 | 0 | 0 |
| | 200x200 | 406.1 | 317 | 157.8 | 78.4 | 21.8 | 5.1 |
| | 400x400 | 2538.9 | 2331.2 | 1946.8 | 1713.8 | 1432.3 | 1231.7 |
| GtA 12,5 | 80x80 | 4.7 | 0.8 | 0 | 0 | 0 | 0 |
| | 200x200 | 520.7 | 424.1 | 180.9 | 95.1 | 28.7 | 7.7 |
| | 400x400 | 2797.6 | 2580.1 | 2005.1 | 1769.7 | 1482.5 | 1279.3 |
| GtF 15 | 80x80 | 27.9 | 12.4 | 0 | 0 | 0 | 0 |
| | 200x200 | 696.3 | 603 | 317.6 | 264.9 | 94 | 58.5 |
| | 400x400 | 3169.5 | 2975.2 | 2332.6 | 2207.9 | 1766.4 | 1637 |

As can be seen in Table 6.6, maximum compressive forces are lower in calculations according to the 2020 version of Eurocode 5 than they are in calculations according to the 2004 version of Eurocode 5. To have a better overview of the size of the change the results of calculations according to the 2020 version of Eurocode 5 were examined as a percentage of the results of calculations according to the 2004 version. The percentage was calculated according to the formula (6.1) and the results are shown in Figure 6.4.

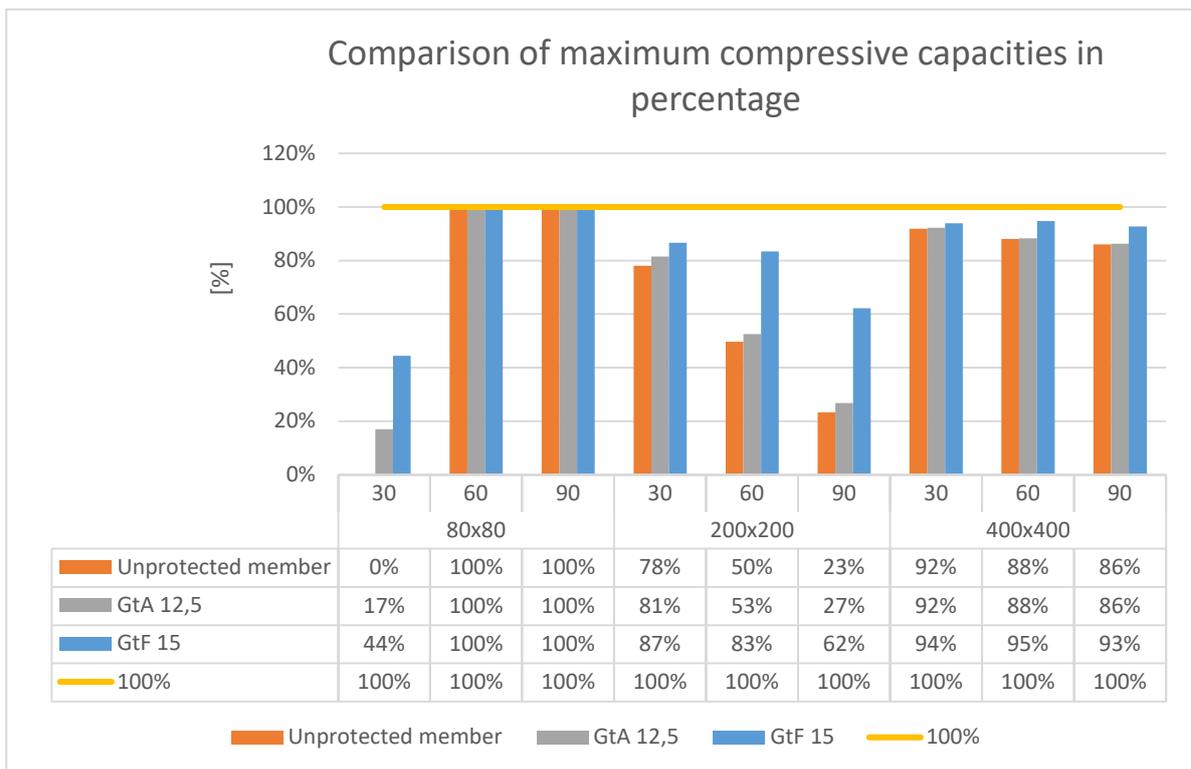


Figure 6.4 Comparison of maximum compressive capacities on columns in percentage

As seen in Figure 6.4 and in Table 6.6, all the results have decreased in calculations according to EN 1995-1-2:2020. The results that have stayed the same (the percentage is 100%) have the value of 0 kN.

According to Figure 6.4, the smaller the cross-section, the bigger the difference in maximum compressive capacities. For example, the result of calculations according to EN 1995-1-2:2020 for a column with a protective layer of GtA and the initial cross-section of 400x400 after 30 minutes of standard fire is 92% of the result of calculations according to EN 1995-1-2:2004. Members exposed to the same duration of fire and with the same protective system but with initial cross-sections of 200x200 and 80x80 have the percentages of 81% and 17%, respectively. That correlation applies to all the protective systems. Although the difference in maximum compressive capacities in the larger cross-sections is proportionally small, the difference is still significant as larger cross-sections can take larger loads.

Figure 6.4 also shows that out of all the protection systems examined in this research the difference in results is smallest among members with a protective system made of one layer of GtF 15, and the change is largest among initially unprotected members. The results for columns with different protective layers are examined more thoroughly in the following sections.

Table 6.7 Change of maximum compressive capacities in percentage

| Protective layer | initial cross-section | time / min | EC:2004 / kN | EC:2020 / kN | Change |
|------------------|-----------------------|------------|--------------|--------------|---|
| | | | | | $\left(\frac{EC:2020 - EC:2004}{EC:2004} \right) / \%$ |
| none | 80x80 | 30 | 0.5 | 0 | 100% |
| | | 60 | 0 | 0 | 0% |
| | | 90 | 0 | 0 | 0% |
| | 200x200 | 30 | 406.1 | 317 | 22% |
| | | 60 | 157.8 | 78.4 | 50% |
| | | 90 | 21.8 | 5.1 | 77% |
| | 400x400 | 30 | 2538.9 | 2331.2 | 8% |
| | | 60 | 1946.8 | 1713.8 | 12% |
| | | 90 | 1432.3 | 1231.7 | 14% |
| GtA 12,5 | 80x80 | 30 | 4.7 | 0 | 100% |
| | | 60 | 0 | 0 | 0% |
| | | 90 | 0 | 0 | 0% |
| | 200x200 | 30 | 520.7 | 424.1 | 19% |
| | | 60 | 180.9 | 95.1 | 47% |
| | | 90 | 28.7 | 7.7 | 73% |
| | 400x400 | 30 | 2797.6 | 2580.1 | 8% |
| | | 60 | 2005.1 | 1769.7 | 12% |
| | | 90 | 1482.5 | 1279.3 | 14% |
| GtF 15 | 80x80 | 30 | 27.9 | 12.4 | 56% |
| | | 60 | 0 | 0 | 0% |
| | | 90 | 0 | 0 | 0% |
| | 200x200 | 30 | 696.3 | 603 | 13% |
| | | 60 | 317.6 | 264.9 | 17% |
| | | 90 | 94 | 58.5 | 38% |
| | 400x400 | 30 | 3169.5 | 2975.2 | 6% |
| | | 60 | 2332.6 | 2207.9 | 5% |
| | | 90 | 1766.4 | 1637 | 7% |

As can be seen in Table 6.7, unless the cross-section has fully charred, maximum compressive capacity has changed the most among smaller cross-sections. This is due the depth of the effective char layer. Timber does not char in accordance with the dimensions of the column, but the effective char layer has an equal depth for all the cross-sections as can be seen in Appendices. Therefore, the char layer of larger cross-

sections is proportionally smaller than the char layer of smaller cross-sections. This means that the larger the cross-section, the smaller is the change. That correlation applies to all the protective systems. If 80x80 cross-sections are completely charred between 30 and 60 minutes, larger cross-sections still have the load bearing cross-section after 90 minutes of fire. Nevertheless, it can be seen, that after 30 minutes of fire, the change is biggest among 80x80 cross-section and smallest among 400x400 cross-section.

6.3.2 Effective depth of char layer on columns

According to formulas (3.10) and (4.21), the effective charring depth is a sum of notional charring depth and a layer that is under the char layer and has zero strength. Figure 6.5 presents the change of notional charring depth in time according to both EN 1995-1-2:2004 and EN 1995-1-2:2020.

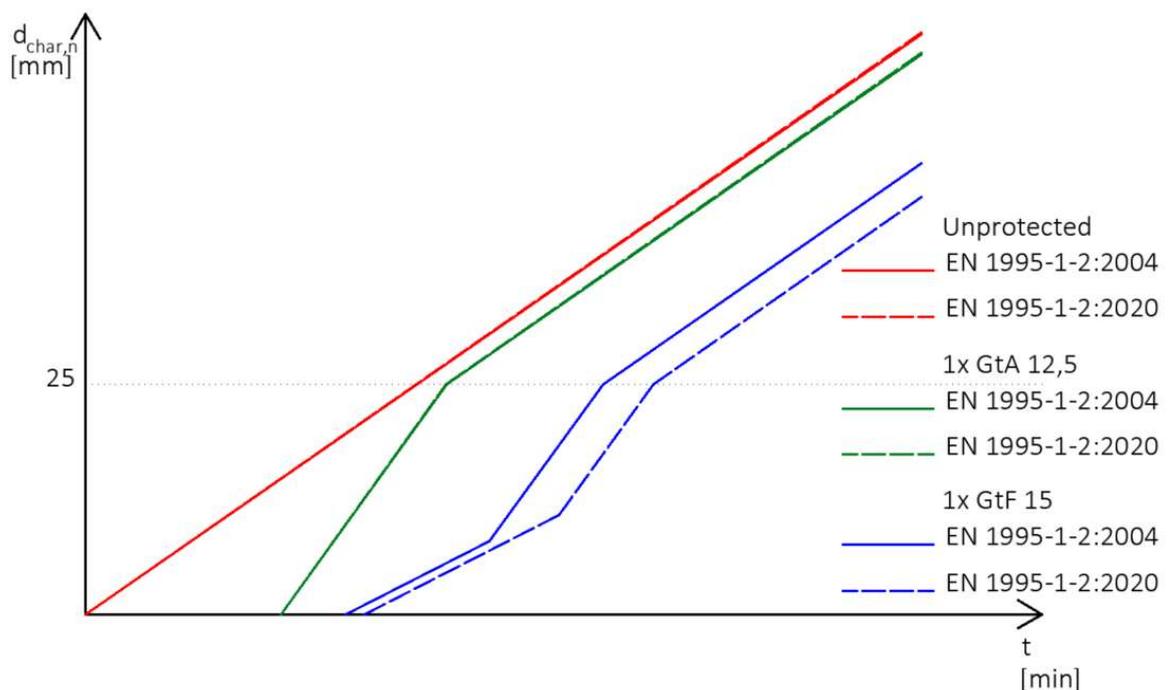


Figure 6.5 Charring depth of columns presented in this thesis, $d_{char,n}$ – notional design charring depth.

As can be seen in Figure 6.5, the notional charring rate for initially unprotected columns has changed marginally. The notional charring rate for initially unprotected columns according to the 2020 version of Eurocode 5 is slightly larger than according to the 2004 version. That change is examined more thoroughly in section 6.1.2. However, this change is very small and does not significantly affect the results.

Similarly, the charring of columns with protective system of one layer of GtA 12,5 has changed insignificantly. The start of charring and the time of reaching the consolidated phase are the same according to both versions of Eurocode 5, at 21 minutes and 38,8 minutes, respectively. There is a slight change in the notional charring rate that is similar to the notional charring rate for an unprotected column.

On the other hand, the charring of initially protected columns with protective layer made of one layer of GtF 15 has changed. As seen in Appendix 7, the start time of the charring of columns with one layer of GtF 15 according to the 2004 version of Eurocode 5 is after 28 minutes of fire, and is after 30 minutes of fire according to the information presented in Appendix 14. As examined in section 6.1.3, in EN 1995-1-2:2004 one formula was used to calculate the start of charring for both GtA and GtF protective layers. In EN 1995-1-2:2020, this is based on the failure time of protection and the sum of protection times of the fire protection system. As can be seen in Figure 6.5, this change affects the depth of the notional char layer. According to EN 1995-1-2:2004, the char layer is thicker than calculations according to EN 1995-1-2:2020, as the charring starts earlier in the 2004 version.

What is more, the failure time of the GtF layer has changed from 43,5 minutes according to EN 1995-1-2:2004 to 51 minutes according to the 2020 version. As examined in section 6.1.4, the 2004 version of Eurocode 5 does not have a formula for the failure time of GtF layer. This has changed in the EN 1995-1-2:2020 version. The newer version of Eurocode 5 has formulas for t_f for different situations (depending on whether GtF is on the wall, ceiling, linear member, how many layers of GtF is used, etc.). As can be seen in Figure 6.5, these changes affect the depth of the notional char layer of columns. The depth of the notional char layer is smaller according to EN 1995-1-2:2020 than the depth of the notional char layer according to EN 1995-1-2:2004.

As mentioned before, the depth of the effective char layer is a sum of $d_{char,n}$ and the zero-strength layer. The values for the zero strength-layer are presented in Table 6.8.

Table 6.8 Depth of zero-strength layer for columns

| time / min | $k_0 d_0$ (EC:2004) / mm | d_0 (EC:2020) / mm |
|-------------------|--|--|
| 30 | 7 | 14 |
| 60 | 7 | 16 |
| 90 | 7 | 16 |

As can be seen in Table 6.8, the depth of the zero-strength layer has changed significantly. After 30 minutes of fire, the depth of the zero-strength layer according to EN 1995-1-2:2020 is twice as deep as it is according to EN 1995-1-2:2004. When the fire lasts longer at least 60 minutes, the difference is even larger. These changes affect the maximum compressive load that the columns can bear.

The effective depth of the char layer is presented in Table 6.9.

Table 6.9 Effective depth of char layer for columns

| Protective layer | time / min | EC:2004 / mm | EC:2020 /mm |
|-------------------------|-------------------|---------------------|--------------------|
| None | 30 | 28 | 35.06 |
| | 60 | 49 | 58.14 |
| | 90 | 70 | 79.18 |
| GtA 12,5 | 30 | 19.6 | 26.64 |
| | 60 | 46.8 | 55.88 |
| | 90 | 67.8 | 76.94 |
| GtF 15 | 30 | 8.02 | 14 |
| | 60 | 35.01 | 39.4 |
| | 90 | 56.01 | 61.26 |

As can be seen in Table 6.9, in all situations in this thesis, the effective depth of char layer for columns has increased in the calculations based on EN 1995-1-2:2020.

While the notional depth of the char layer for initially unprotected columns and for columns with one layer of GtA did not differ among EN 1995-1-2 versions, the effective depth for these columns is significantly different. This change is due to the difference in the depth of the zero-strength layer.

The effective depth of the char layer has also increased for columns with a GtF 15 layer. Although the notional depth of the char layer for columns with GtF layer was deeper according to the EN 1995-1-2:2004 version, the effective depth of the char layer is deeper in calculations according to EN 1995-1-2:2020.

As has been noted, the effective depth of the char layer has increased for all examined columns. As an initial cross-section is reduced by the depth of the effective char layer, the deeper the effective char layer, the smaller the effective cross-section. As the strength of timber in fire has not changed in the EN 1995-1-2 version, the change of the effective char layer directly affects the final results of calculations – the maximum compressive loads for columns.

The change of effective depth of the char layer over time is shown in Figure 6.6.

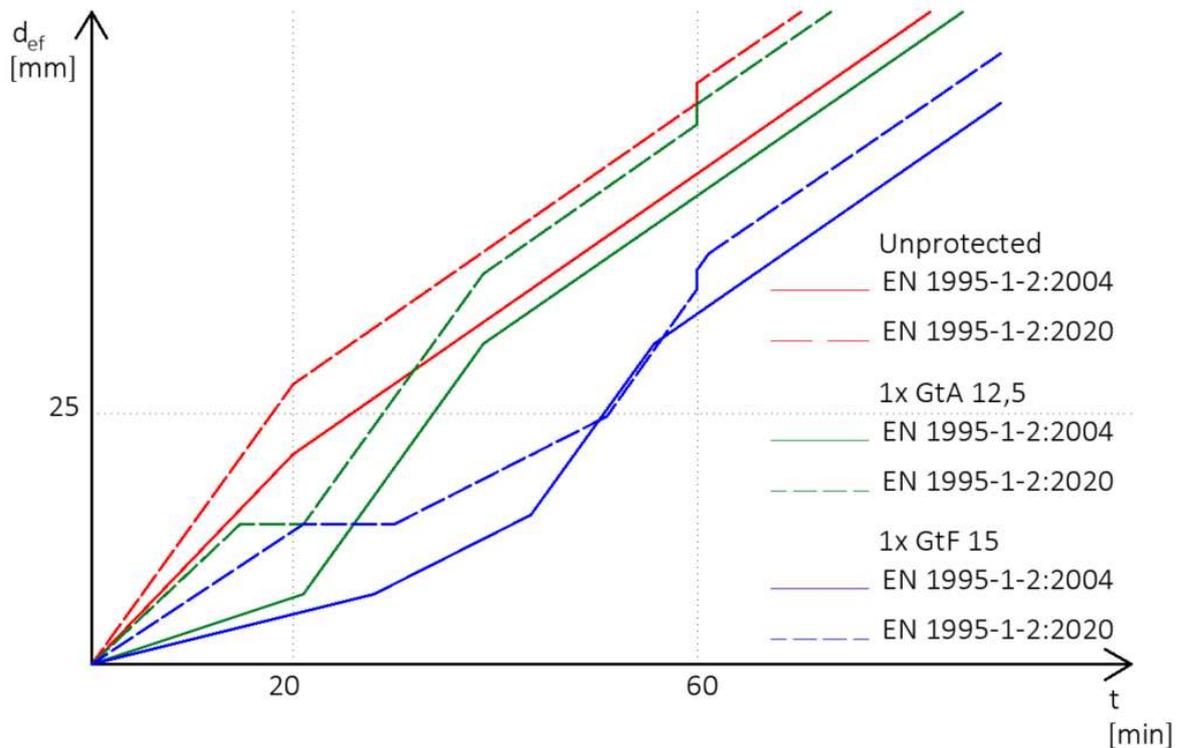


Figure 6.6 The change of the effective depth of the char layer over time, d_{ef} – effective charring depth.

As can be seen in Figure 6.6, the effective depth of the char layer has increased for columns with one layer of GtA and for initially unprotected columns.

However, columns that are initially protected with one layer of GtF, for some time in the 3rd phase have an opposite outcome. The effective depth of the char layer according to EN 1995-1-2:2020 is lower than the effective depth of the char layer according to EN 1995-1-2:2004. This is due to differences in the $d_{char,n}$ as mentioned above.

It can also be noted, that according to EN 1995-1-2:2020 on initially protected columns, the zero-strength layer reaches the full depth before columns calculated according to EN 1995-1-2:2004. Furthermore, according to the 2020 version of Eurocode 5, after reaching the full depth, the zero-strength layer is no longer constant, but at 60 minutes, it increases by 2 mm.

In conclusion, the maximum compressive load for glulam columns has decreased for all the examined columns. This is mainly due to change in the depth of the zero-strength layer.

7. COMPARISON OF FIRE RESISTANCE IN TESTS AND CALCULATION MODELS

In this thesis, 10 beams, previously tested in standard fire, have been compared to the results of calculations. Data and test results are taken from sources [15] and [16]. In Table 7.1, the initial cross-sections of tested beams, the type of protection used on beams and the strength class of beams are shown, in addition to the failure time of beams and the bending moment causing the failure. Beams 1-6 performed the 4-point t-bending tests before the fire tests and the mean bending strengths were determined. For beams from strength class GL24h, the mean strength was $f_m = 31,2 \text{ N/mm}^2$ and for beams from strength class GL36h, the mean strength was $f_m = 39,8 \text{ N/mm}^2$ [15].

Table 7.1 Parameters and results of beams tested in standard fire

| NR | 1 [15] | 2 [15] | 3 [15] | 4 [15] | 5 [15] | 6 [15] | 7 [16] | 8 [16] | 9 [16] | 10 [16] |
|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|---------|
| height / mm | 254 | 256 | 256 | 253 | 253 | 217 | 362 | 600 | 599 | 600 |
| width / mm | 157 | 158 | 158 | 158 | 157 | 157 | 120 | 140 | 140 | 140 |
| Protective layer | none |
| Strength class | GL24h | GL36h | GL36h | GL24h | GL36h | GL36h | GL24h | GL24h | GL32h | GL32h |
| time / min | 52 | 49.25 | 68.88 | 48.1 | 58.28 | 44.4 | 48.2 | 32 | 24.5 | 13.5 |
| bending moment / kNm | 16.4 | 20.7 | 13.9 | 16 | 21 | 14.5 | 23 | 97 | 124.5 | 124.5 |

Calculations were made according to the cross-sections and failure times Table 7.1. The aim of the calculations was to find the maximum bending moment at the time when the tested beams failed. The calculations are shown in Appendix 15. The results are presented in Table 7.2. Figure 7.1 shows the results of calculations compared to the test results in percentage form. The percent in the figure is calculated in accordance with formula (7.1).

Table 7.2 Destructive bending moment and maximum bending moments

| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
|----------------|------|------|------|------|------|------|------|-------|-------|-------|
| Test / kNm | 16.4 | 20.7 | 13.9 | 16 | 21 | 14.5 | 23 | 97 | 124.5 | 124.5 |
| EC5:2004 / kNm | 14.3 | 23.8 | 13.2 | 15.8 | 17.8 | 17.8 | 18.2 | 121.6 | 185.8 | 223.6 |
| EC5:2020 / kNm | 14.2 | 23.7 | 11.1 | 15.8 | 17.7 | 17.7 | 18.1 | 121.3 | 185.6 | 223.5 |

$$\frac{\text{result of calculations}}{\text{result of tests}} \cdot 100\%, \quad (7.1)$$

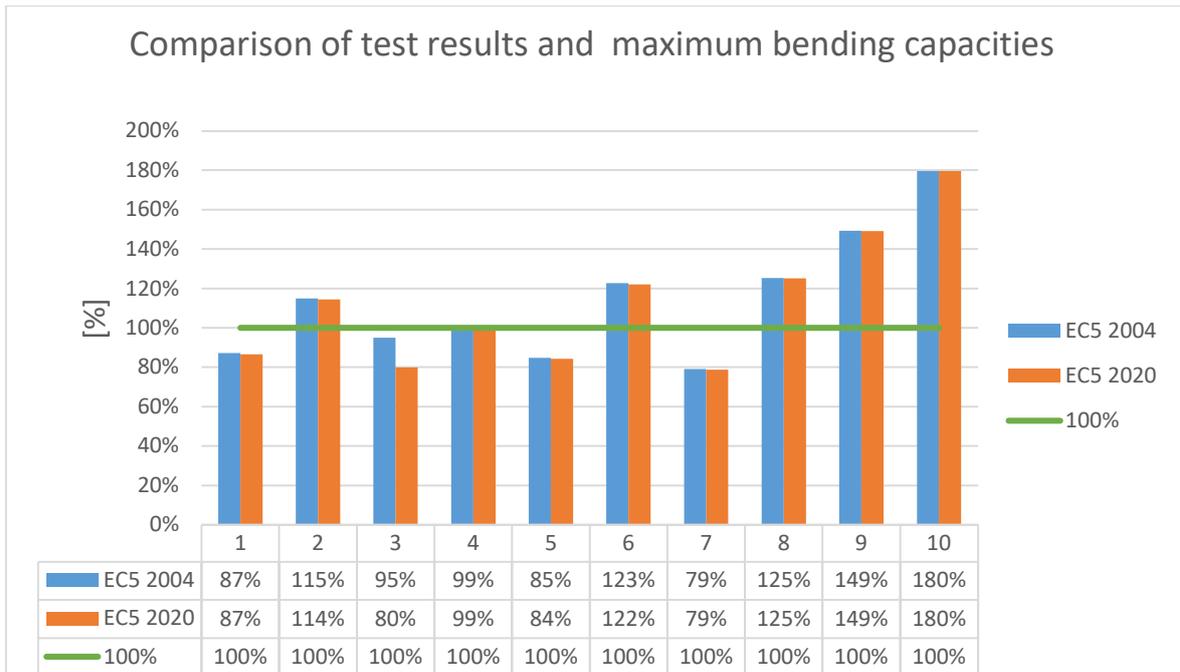


Figure 7.1 Comparison of maximum bending capacities to test results in percentage

As can be seen in Figure 7.1, calculations based on EN 1995-1-2:2020 estimate the maximum bending moment more conservatively than calculations based on EN 1995-1-2:2004. As the beams are initially unprotected, and most of the beams failed in tests before 60 minutes, the calculation results are rather similar to each other. However, calculations based on both versions of EN 1995-1-2 give too high maximum bending moments to beam numbers 2, 6 and 8-10. The reason for this could be that the depth of the zero-strength layer is not deep enough. The beams were recalculated according to EN 1995-1-2:2020, but the depth of the zero-strength layer before 60 minutes was taken at 10 mm instead of 7 mm. The results are shown in Table 7.3 and the results are compared to the previously calculated results in Figure 7.2.

Table 7.3 Maximum bending moment according to EN 1995-1-2:2020 when $d_0=10$ mm

| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
|----------------|------|------|------|------|------|------|----|-------|-------|-------|
| EC5:2020 / kNm | 12.6 | 21.2 | 11.1 | 14.1 | 15.5 | 15.9 | 15 | 111.2 | 171.6 | 208.8 |

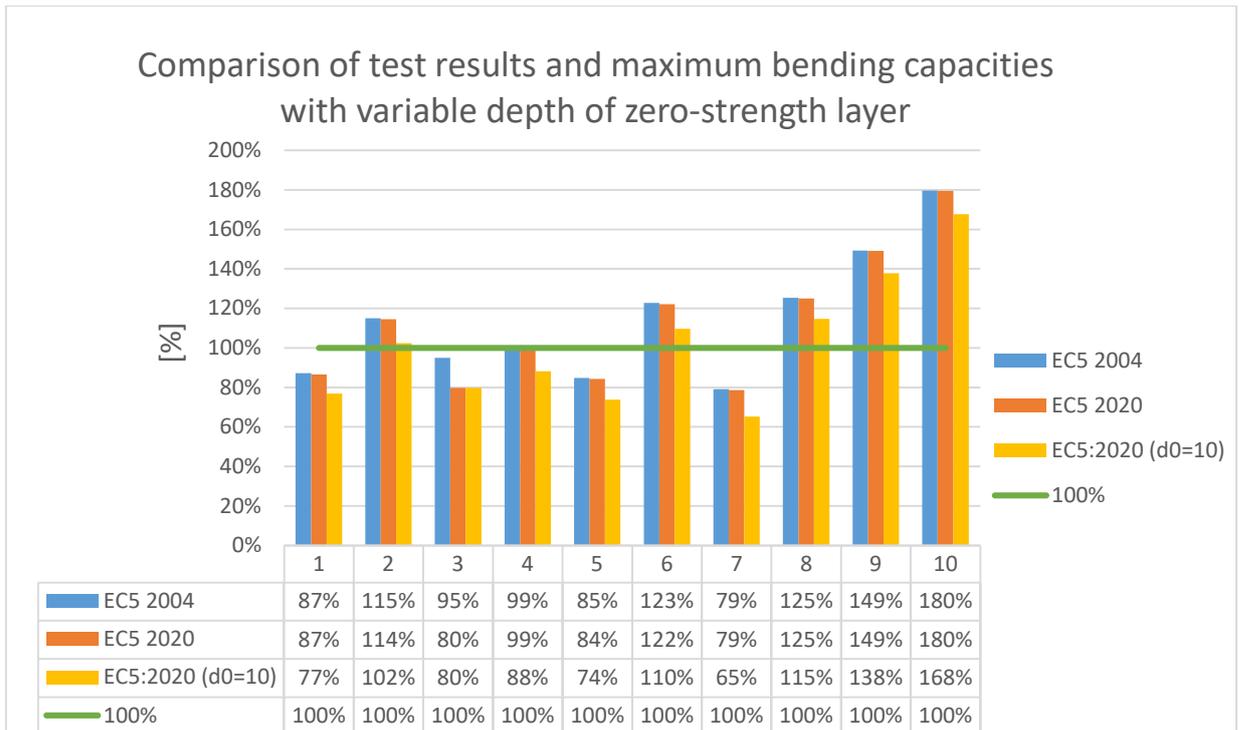


Figure 7.2 Comparison of test results and maximum bending capacities with variable d_0

Figure 7.2 shows that, as expected, the beams that failed before 60 minutes of fire have a lower result according to EN 1995-1-2:2020, with a 10 mm depth of zero-strength layer before 60 minutes of fire than the results of calculations with a 7 mm depth of zero-strength layer before 60 minutes. However, the results that exceeded 100% are still over 100%. Beams 2 and 6 are within a 10% error, but the calculation results for beams 8-10 are up to 168%. The reason could be that those beams did not fail in tests due to bending but instead due to losing their stability. The stability of beams is not considered in the calculations because there is no information of the length of beams 7-10.

During the tests on beams 1-6, the mean value of strength was measured. As the measured mean value of strength is closer to the real strength value of the beam, beams 1-6 were calculated with the mean bending strength value. The results are shown in Table 7.4 and they are compared to the test results according to formula (7.1) in Figure 7.3.

Table 7.4 Maximum bending moment with the mean strength value

| NR | 1 | 2 | 3 | 4 | 5 | 6 |
|----------------------------------|------|------|------|------|------|------|
| EC5:2004 / kNm | 18.6 | 26.3 | 14.6 | 20.6 | 19.7 | 19.7 |
| EC5:2020 / kNm | 18.5 | 26.2 | 12.3 | 20.5 | 19.6 | 19.6 |
| EC5:2020 / kNm ($d_0=10$ mm) | 16.4 | 23.4 | 12.3 | 18.4 | 17.1 | 17.6 |

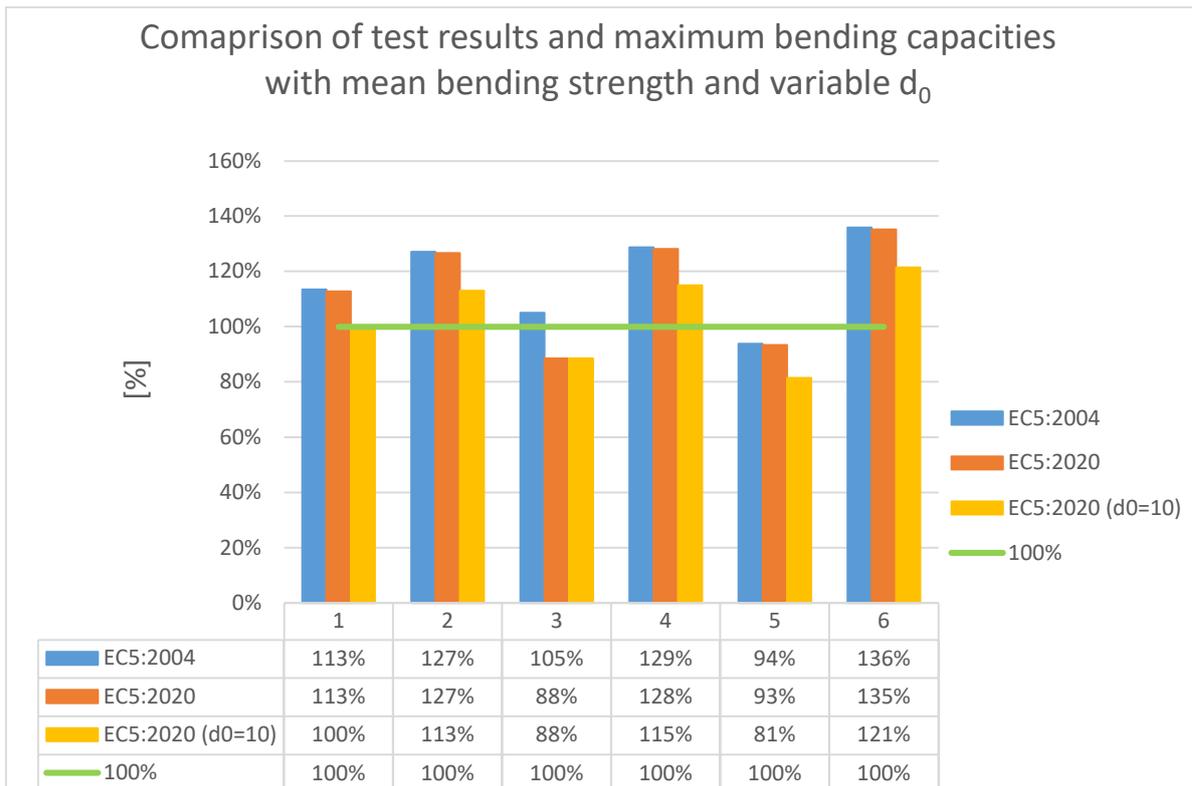


Figure 7.3 Comparison of test results and maximum bending capacities with mean bending strength and variable d_0

As can be seen in Figure 7.3, calculations with mean bending strength according to EN 1995-1-2:2004 and EN 1995-1-2:2020 are mostly above the test results. With the bending strength according to the strength class, only the calculation results of beams 2 and 6 were above the test results. As seen in Figure 7.3, in calculations with mean bending strength, 10 mm depth of the zero-strength layer gives more realistic results than calculations, where the depth of the zero-strength layer before 60 minutes is 7 mm.

In conclusion, the calculations estimate quite well the maximum bending moment of the beams. However, the calculation results are not very conservative, and, in some cases, calculations can overestimate the maximum bending capacity. This could be improved by increasing the depth of the zero-strength layer not only after 60 minutes of fire, but during the entire fire exposure time.

8. USER EXPERIENCE EVALUATION

8.1 Improvements in EN 1995-1-2:2020

EN 1995-1-2:2020 has more content than EN 1995-1-2:2004 and many aspects have been improved.

One of the improvements in EN 1995-1-2:2020 is the reference to coefficients. For example, in the calculation of the strength property, previously there was no reference where to find the value or formula for $k_{mod,fi}$. The user had to search through the standard to find the value for it. However, in EN 1995-1-2:2020, formulas have clear references to the sections where the modification factors for the strength of material can be found.

In addition, table 5.1 in EN 1995-1-2:2020 includes modification factors for charring and gives both a short designation for them and a reference to where each modification factor can be found. Consequently, the 2020 version of Eurocode 5 has a better structure and is more convenient for users.

Moreover, formula (3.3) in EN 1995-1-2:2004 that allows for applying the one-dimensional charring rate to non-planar surfaces has been removed from EN 1995-1-2:2020. To apply that formula, the rounding of corners had to be taken into account, but it was unclear as to what was the radius for corner roundings. Furthermore, rounded corners make it harder to find the characteristics for the effective cross-section. Therefore, the removal of this formula makes EN 1995-1-2:2020 more understandable and easier to use.

Another improvement in EN 1995-1-2:2020 is the charring phases. While the charring process was previously described by t_{ch} , t_f , t_a and charring between those times was described by the multiplication of modification factors and β_n , in the 2020 version of Eurocode 5, in addition to these, charring is also described by charring phases. The concept of charring phases makes the charring process easier to understand and describe.

One of the biggest obstacles in calculations according to EN 1995-1-2:2004 was the absence of the formula for the failure time of protective cladding made of GtF. However, this problem is solved in EN 1995-1-2:2020. To calculate the fire resistance for timber members with GtF, the user previously had to search the value of t_f for GtF by

themselves, but there are formulas to calculate it in EN 1995-1-2:2020. This is an important improvement for user experience.

Besides the formulas for the failure time of GtF, another improvement in the user experience in the calculation of the failure time is to eliminate the failure time of anchors. According to EN 1995-1-2:2004, the failure time of protection was the minimum of the failure time of anchors and the failure time of the protective cladding. In EN 1995-1-2:2020, the failure time is the time when the protective cladding fails and the anchors have to be long enough so that they do not become decisive for the failure of protection.

Furthermore, there have been some smaller improvements. One of them is the formula of modification factor k_2 . In the newer version of Eurocode 5, the coefficient in the formula of k_2 that is multiplied by the thickness of protective cladding is given as a fraction not as a decimal, as it was given in the previous version. This change does not affect the value of the formula but makes the formula simpler and more user-friendly.

8.2 Deficiencies in EN 1995-1-2:2020

Although there are many improvements in EN 1995-1-2:2020, there are also some deficiencies in user experience.

First, under table 6.4 in EN 1995-1-2:2020, there is a condition, that to apply the failure time $t_{f,pr}$ to linear or plane members, the failure time should be increased by 20%. However, the table does not include formulas for some gypsum plasterboard cladding types. In these cases, the failure time is taken equal with the charring time, but it can be unclear as to whether the value should be increased by 20% or not. Also, it is unclear, how to calculate the failure times of fire protection on beams. There are separate formulas for walls and floors. When adapting those formulas to beams, should the lower side be considered as floor and the vertical sides as walls? When to apply permission that $t_{f,pr}=t_{ch}$ (that is valid for walls)?

Second, the user of EN 1995-1-2:2020 has to identify whether the bond line integrity in glulam timber members is maintained or not during fire exposure. Based on that, there are different calculation models for glulam members.

Third, in both versions there is no reference to which strength property should be used when calculating the stability of a member. There can be a temptation to use the strength property for fire temperature design and stiffness property for normal temperature design, but they should be taken either for fire temperature or for normal temperature. As the ratio of strength and stiffness is the same for both fire and normal temperature design, it does not matter which one is chosen.

Finally, EN 1995-1-2:2020 can be confusing for the user at first, as it more thorough and contains more formulas than EN 1995-1-2:2004. However, after familiarising with it and using it, it is more logical and user-friendly than EN 1995-1-2:2004 was.

SUMMARY

As the Eurocode 5 part 1-2 is being revised, there is a necessity to evaluate the proposed changes. In this thesis, fire resistance after 30, 60 and 90 minutes was calculated on 4 beams and 3 columns with 3 different protection systems. The calculations were performed according to EN 1995-1-2:2004 and EN 1995-1-2:2020. The results were compared to each other and to the test results. In addition, the user experience and the changes among calculation models were evaluated.

From analysis of the calculation models, the following conclusions could be drawn:

- the most significant changes are in the start time of charring, the failure time of protection and the depth of the zero-strength layer;
- the failure time of gypsum plasterboard type F is added.

During the analysis of the calculation results, the following points were noted:

- the fire resistance of beams has decreased in fire durations longer than 30 minutes, but they have increased for beams with one layer of GtA 12.5 after 30 minutes of fire;
- the change in the fire resistance of beams is due to t_{ch} , t_f and d_0 ;
- the fire resistance of columns has decreased in all cases, because of a significantly deeper zero-strength layer.

The comparison of fire resistance in tests and calculation models gave the following results:

- the results of calculations are close to the test results;
- changing the depth of the zero-strength layer on beams to 10 mm would give more conservative results.

EN 1995-1-2:2020 was evaluated to be more user-friendly than EN 1995-1-2:2004, although some improvements can be added.

Further research and more data are needed to compare the calculations with the tested columns. Furthermore, linear interpolation of d_0 in EN 1995-1-2:2020 and permission 3.4.2 (3) in EN 1995-1-2:2004 were not applied in this thesis.

KOKKUVÕTE

Kuna hetkel kirjutatakse Eurokoodeks 5 osa 1-2st uut versiooni, siis on oluline hinnata planeeritud muudatusi. Selles töös on arvatud kolme erineva kattega nelja tala ja kolme posti kandevõimed 30-, 60- ja 90-minutilise tule järel. Arvutused on tehtud EN 1995-1-2:2004 ja EN 1995-1-2:2020 põhjal. Arvutustulemused võrreldi nii omavahel kui ka katsetulemustega. Lisaks sellele hinnati kasutajakogemust.

EN 1995-1-2:2004 ja EN 1995-1-2:2020 arvutusmodelite analüüsis selgus järgnev:

- kõige suuremad muutused on söestumise algusajas, tõrketekkeajas, ja nulltugevusega kihi paksuses;
- lisatud on F tüüpi kipsplaadi tõrketekkeaeg.

Arvutustulemuste võrdluses olid järgnevad tulemused:

- liimpuittalade tulepüsivus on vähenenud pikema, kui 30-minutilise, tule puhul, aga kasvanud ühe kihi A tüüpi kipsplaadiga kaetud liimpuittaladel 30-minutilise tule järel;
- liimpuittalade tulepüsivuse erinevus tuleneb söestumise algusaja, tõrketekkeaja, ja nulltugevusega kihi paksuse erinevustest arvutusmodelites;
- liimpuitpostide tulepüsivus on vähenenud kõikidel uuritud juhtudel, kuna koormust mitte vastu võtev kiht on oluliselt paksenenud.

Arvutustulemusi võrreldi katsetulemustega. Võrdluses selgus järgnev:

- arvutustulemused on ligilähedased katsetulemustele;
- võttes liimpuittaladel nulltugevusega kihi paksuseks 10mm, on saadud tulemused rohkem tagavara kasuks;

Kasutaja kogemuse hindamisel selgus, et EN 1995-1-2:2020 on kasutajasõbralikum kui EN 1995-1-2:2004.

Edasine uurimustöö on vajalik, et hinnata arvutustulemusi tules katsetatud postidega. Lisaks ei kasutatud selles töös lineaarset interpoleerimist EN 1995-1-2:2020 põhjal d_0 arvutamisel ning EN 1995-1-2:2004 põhjal tehtud arvutustes luba 3.4.2 (3).

LIST OF REFERENCES

- [1] Fire Safety in Timber Buildings: Technical Guideline for Europe, Stockholm: SP Technical Research Institute of Sweden, 2010.
- [2] Östman, B., Brandon, D., Frantziach, H., „Fire safety engineering in timber buildings,“ *Fire Safety Journal*, kd. 91, pp. 11-20, 2017.
- [3] *EN 520+A1:2010 Gypsum plasterboards. Definitions, requirements and test methods*, 2010.
- [4] Schmid, J., Just, A., Klippel, M., Fragiacom, M., “Reduced Cross-Section Method for Evaluation of the Fire Resistance of Timber Members: Discussion and Determination of the Zero-Strength Layer,” *Fire Technology*, vol. 51, 2014.
- [5] Schmid, J., Klippel, M., Just, A., Frangi, A., “Comparison of the fire resistance of timber members in tests and calculation models,” in *CIB-W18 Meeting*, Vancouver, 2012.
- [6] *Eurocode 5 – Design of timber structures. Part 1-2: General rules – Structural fire design : EN 1995-1-2:2020 (E). 3rd draft.*, 2020.
- [7] Klippel, M., Schmid, J., Frangi, A., “The Reduced Cross-Section Method for timber members subjected to compression, tension and bending in fire,” in *CIB-W15 Meeting 45*, Växjö, 2012.
- [8] Schmid, J., König, J., Just, A., “The Reduced Cross-Section Method for the Design of Timber Structures Exposed to Fire—Background, Limitations and New Developments,” *Structural Engineering International*, vol. 22, pp. 514-522, 2012.
- [9] Just, E-J., Õiger, K., Just, A., Puit- ja puidupõhised konstruktsioonid : õpik kõrgkoolidele. 2nd edition ., Tallinn: Tallinna Tehnikaülikooli Kirjastus, 2018.
- [10] *Eurocode 5: Design of timber structures - Part 1-2: General - Structural fire design : EVS-EN 1995-1-2:2005*, Tallinn: Estonian Centre for Standardisation, 2005.
- [11] *Timber structures - Glued laminated timber and glued solid timber - Requirements : EVS-EN 14080:2013*, Tallinn: Estonian Centre for Standardisation, 2013.
- [12] Östman, B., Just, A., Tuleohutud puitmajad. 3. : Põhja- ja Baltimaade teadmisi koondav juhendmaterjal, Tallinn: ET Infokeskus, 2014.
- [13] Klauson, A., Põdra, P., Metsaveer, J., Raukas, U., Tugevusõpetus : õpik kõrgkoolidele. 2nd edition, Tallinn: Tallinna Tehnikaülikooli Kirjastus, 2017.
- [14] *Eurocode 5: Design of timber structures - Part 1-1: General - Common rules and rules for buildings : EVS-EN 1995-1-1:2005+NA:2007-A1:2008+NA:2009*, Tallinn: Estonian Centre for Standardisation, 2009.
- [15] Fahrni, R., Klippel, M., Just, A., Ollino, A., Frangi, A., “Fire tests on glued-laminated timber beams with specific local material properties,” *Fire Safety Journal*, vol. 107, pp. 161-169, 2017.
- [16] Brandon, D., Schmid, J., Just, A., “Eurocode 5 design in comparison with fire resistance tests of unprotected timber beams,” in *SFPE conference on performance based design and fire safety design methods*, Warsaw, 2016.

APPENDICES

**Appendix 1 Calculations of the strength parameters according to 2004
version of Eurocode 5**

Table 3.x Materials used in this research and their characteristic values of strength properties for normal temperature

| Materials | Design compressive strength along the grain for normal temperature | Design bending strength for normal temperature |
|-----------|--|--|
| GL24c | Is not used in this research | $f_{m,g,k} = 24,0 \frac{N}{mm^2}$ |
| GL24h | $f_{c,0,g,k} = 21,5 \frac{N}{mm^2}$ | Is not used in this research |

$$\gamma_{M,fi} = 1,0$$

$$k_{fi} = 1,15$$

$$k_{mod,fi} = 1,0$$

$$f_{d,fi} = k_{mod,fi} \frac{f_{20}}{\gamma_{M,fi}}$$

$$f_{20} = k_{fi} f_k$$

Table 4.x Materials used in this research and their characteristic values of strength properties for fire exposure

| Materials | Design compressive strength along the grain for fire exposure | | Design bending strength for fire exposure | |
|-----------|---|---|--|---|
| | The 20% fractile of strength | The fire design value of strength | The 20% fractile of strength | The fire design value of strength |
| GL24c | Is not used in this research | | $f_{20} = 1,15 * 24,0 = 27,6 \frac{N}{mm^2}$ | $f_{d,fi} = 1,0 \frac{27,6}{1,0} = 27,6 \frac{N}{mm^2}$ |
| GL24h | $f_{20} = 1,15 * 21,5 = 24,75 \frac{N}{mm^2}$ | $f_{d,fi} = 1,0 \frac{24,75}{1,0} = 24,75 \frac{N}{mm^2}$ | Is not used in this research | |

**Appendix 2 Calculations of unprotected glulam beam according to 2004
version of Eurocode 5**

| | |
|--------------------|----------------------|
| height | $h = 200 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24c |
| time | 30 min |
| sides open to fire | 3 |
| protection | none |

$$\begin{aligned}
 d_{char,n} &= \beta_n t & d_{char,n} &= 0,7 * 30 = 21 \text{ mm} \\
 d_{ef} &= d_{char,n} + k_0 d_0 & d_{ef} &= 21 + 1 * 7 = 28 \text{ mm} \\
 b_{fi} &= b - 2d_{ef} & b_{fi} &= 80 - 2 * 28 = 24 \text{ mm} \\
 h_{fi} &= h - d_{ef} & h_{fi} &= 200 - 28 = 172 \text{ mm} \\
 W_{ef} &= \frac{b_{fi} h_{fi}^2}{6} & W_{ef} &= \frac{24 * 172^2}{6} = 118336 \text{ mm}^3 \\
 M_{max,fi} &= W_{ef} f_{d,fi} 10^{-6} & M_{max,fi} &= 118336 * 27,6 * 10^{-6} = 3,2 \text{ kNm}
 \end{aligned}$$

Table. Glulam beam without protective layer according to 2004 version of Eurocode 5 after 30 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-----------------------------|------------|-------------|--------------|--------------|
| Protective layer | none | none | none | none |
| Result / kNm | 3.2 | 91.6 | 216.7 | 625.8 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 21 | 21 | 21 | 21 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 28 | 28 | 28 | 28 |
| b_{fi} / mm | 24 | 144 | 144 | 144 |
| h_{fi} / mm | 172 | 372 | 572 | 972 |
| W_{fi} / mm^3 | 118336 | 3321216 | 7852416 | 22674816 |
| $M_{max,fi} / \text{kNm}$ | 3.2 | 91.6 | 216.7 | 625.8 |

Table. Glulam beam without protective layer according to 2004 version of Eurocode 5 after 60 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-----------------------------|----------|-------------|--------------|--------------|
| Protective layer | none | none | none | none |
| Result / kNm | 0 | 57.8 | 142.4 | 424.3 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 42 | 42 | 42 | 42 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 49 | 49 | 49 | 49 |
| b_{fi} / mm | 0 | 102 | 102 | 102 |
| h_{fi} / mm | 151 | 351 | 551 | 951 |
| W_{fi} / mm^3 | 0 | 2094417 | 5161217 | 15374817 |
| $M_{max,fi} / \text{kNm}$ | 0 | 57.8 | 142.4 | 424.3 |

Table. Glulam beam without protective layer according to 2004 version of Eurocode 5 after 90 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-----------------------------|----------|-----------|-------------|--------------|
| Protective layer | none | none | none | none |
| Result / kNm | 0 | 30 | 77.5 | 238.7 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 63 | 63 | 63 | 63 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 70 | 70 | 70 | 70 |
| b_{fi} / mm | 0 | 60 | 60 | 60 |
| h_{fi} / mm | 130 | 330 | 530 | 930 |
| W_{fi} / mm^3 | 0 | 1089000 | 2809000 | 8649000 |
| $M_{max,fi} / \text{kNm}$ | 0 | 30 | 77.5 | 238.7 |

Appendix 3 Calculations of glulam beam with one layer of GtA 12,5 according to 2004 version of Eurocode 5

| | |
|---------------------------------|-------------------------|
| height | $h = 200 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24c |
| time | 30 min |
| sides open to fire | 3 |
| protection | GtA 12,5 |
| fire protective panel thickness | $h_p = 12,5 \text{ mm}$ |

$$t_{ch} = 2,8 h_p - 14$$

$$t_{ch} = 2,8 * 12,5 - 14 = 21 \text{ min}$$

$$t_f = t_{ch}$$

$$t_f = 21 \text{ min}$$

$$k_3 = 2$$

$$t_a = \min \left\{ \frac{2t_f}{k_3\beta_n} + t_f \right.$$

$$t_a = \min \left\{ \frac{2 * 21 = 42 \text{ min}}{2 * 0,7} + 21 = 38,8 \text{ min} = 38,8 \text{ min} > t \right.$$

$$\left. = 30 \text{ min} \right.$$

$$d_{char,n,t_f} = (t_f - t_{ch})k_2\beta_n$$

$$d_{char,n,t_f} = (21 - 21)k_2 * 0,7 = 0 \text{ mm}$$

$$d_{char,n,t_a} = d_{char,n,t_f} + (t_a - t_f)k_3\beta_n$$

$$d_{char,n,t_a} = 0 + (38,8 - 21)2 * 0,7 = 25 \text{ mm}$$

$$d_{char,n,t} = d_{char,n,t_f} + (t - t_{ch})k_3\beta_n$$

$$d_{char,n,t} = 0 + (30 - 21)2 * 0,7 = 12,6 \text{ mm}$$

$$d_{ef} = d_{char,n,t} + k_0d_0$$

$$d_{ef} = 12,6 + 1 * 7 = 19,6 \text{ mm}$$

$$b_{fi} = b - 2d_{ef}$$

$$b_{fi} = 80 - 2 * 19,6 = 40,8 \text{ mm}$$

$$h_{fi} = h - d_{ef}$$

$$h_{fi} = 200 - 19,6 = 180,4 \text{ mm}$$

$$W_{ef} = \frac{b_{fi}h_{fi}^2}{6}$$

$$W_{ef} = \frac{40,8 * 180,4^2}{6} = 221300,3 \text{ mm}^3$$

$$M_{max,fi} = W_{ef}f_{d,fi}10^{-6}$$

$$M_{max,fi} = 221300,3 * 27,6 * 10^{-6} = 6,1 \text{ kNm}$$

Table. Glulam beam with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 30 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-------------------------------|------------|------------|--------------|--------------|
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 6.1 | 107 | 249.1 | 710.9 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - | - |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 | 21 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2$ | - | - | - | - |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n\ t_f} / \text{mm}$ | 0 | 0 | 0 | 0 |
| $d_{char,n\ t_a} / \text{mm}$ | 25 | 25 | 25 | 25 |
| $d_{char,n\ t} / \text{mm}$ | 12.6 | 12.6 | 12.6 | 12.6 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 19.6 | 19.6 | 19.6 | 19.6 |
| b_{fi} / mm | 40.8 | 160.8 | 160.8 | 160.8 |
| h_{fi} / mm | 180.4 | 380.4 | 580.4 | 980.4 |
| W_{fi} / mm^3 | 221300.3 | 3878072 | 9027960 | 25759736 |
| $M_{max,fi} / \text{kNm}$ | 6.1 | 107 | 249.1 | 710.9 |

Table. Glulam beam with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 60 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-------------------------|----------|-----------|--------------|--------------|
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 61 | 149.7 | 444.7 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - | - |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 | 21 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2$ | - | - | - | - |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n\ tf} / mm$ | 0 | 0 | 0 | 0 |
| $d_{char,n\ ta} / mm$ | 25 | 25 | 25 | 25 |
| $d_{char,n\ t} / mm$ | 39.8 | 39.8 | 39.8 | 39.8 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 46.8 | 46.8 | 46.8 | 46.8 |
| b_{fi} / mm | 0 | 106.4 | 106.4 | 106.4 |
| h_{fi} / mm | 153.2 | 353.2 | 553.2 | 953.2 |
| W_{fi} / mm^3 | 0 | 2212238 | 5426936 | 16112334 |
| $M_{max,fi} / kNm$ | 0 | 61 | 149.7 | 444.7 |

Table. Glulam beam with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 90 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|-------------------------------|----------|-------------|-------------|--------------|
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 32.6 | 83.9 | 257.4 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - | - |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 | 21 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2$ | - | - | - | - |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n\ t_f} / \text{mm}$ | 0 | 0 | 0 | 0 |
| $d_{char,n\ t_a} / \text{mm}$ | 25 | 25 | 25 | 25 |
| $d_{char,n\ t} / \text{mm}$ | 60.8 | 60.8 | 60.8 | 60.8 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 67.8 | 67.8 | 67.8 | 67.8 |
| b_{fi} / mm | 0 | 64.4 | 64.4 | 64.4 |
| h_{fi} / mm | 132.2 | 332.2 | 532.2 | 932.2 |
| W_{fi} / mm^3 | 0 | 1184497 | 3040075 | 9327233 |
| $M_{max,fi} / \text{kNm}$ | 0 | 32.6 | 83.9 | 257.4 |

**Appendix 4 Calculations of glulam beam with one layer of GtF 15 according to
2004 version of Eurocode 5**

| | |
|------------------------------------|------------------------|
| height | h = 200 mm |
| width | b = 80 mm |
| material | GL24c |
| time | 30 min |
| sides open to fire | 3 |
| protection | GtF 15 |
| fire protective panel thickness | h _p = 15 mm |

$$t_{ch} = 2,8 h_p - 14$$

$$t_{ch} = 2,8 * 15 - 14 = 28 \text{ min}$$

$$t_f = 4,5 h_p - 24$$

$$t_f = 4,5 * 15 - 24 = 43,5 \text{ min} > t = 30 \text{ min}$$

$$k_2 = 1 - 0,018 h_p$$

$$k_2 = 1 - 0,018 * 15 = 0,73$$

$$k_3 = 2$$

$$t_a = \frac{25 - (t_f - t_{ch})k_2\beta_n}{k_3\beta_n} + t_f$$

$$t_a = \frac{25 - (43,5 - 28)0,73 * 0,7}{2 * 0,7} + 43,5 = 55,7 \text{ min}$$

$$d_{char,n,t_f} = (t_f - t_{ch})k_2\beta_n$$

$$d_{char,n,t_f} = (43,5 - 28)0,73 * 0,7 = 7,9 \text{ mm}$$

$$d_{char,n,t_a} = d_{char,n,t_f} + (t_a - t_f)k_3\beta_n$$

$$d_{char,n,t_a} = 7,9 + (55,7 - 43,5)2 * 0,7 = 25 \text{ mm}$$

$$d_{char,n,t} = d_{char,n,t_f} + (t - t_{ch})k_2\beta_n$$

$$d_{char,n,t} = 0 + (30 - 28)0,73 * 0,7 = 1,0 \text{ mm}$$

$$d_{ef} = d_{char,n,t} + k_0 d_0$$

$$d_{ef} = 1,0 + 1 * 7 = 8,0 \text{ mm}$$

$$b_{fi} = b - 2d_{ef}$$

$$b_{fi} = 80 - 2 * 8 = 64 \text{ mm}$$

$$h_{fi} = h - d_{ef}$$

$$h_{fi} = 200 - 8 = 192 \text{ mm}$$

$$W_{ef} = \frac{b_{fi} h_{fi}^2}{6}$$

$$W_{ef} = \frac{64 * 192^2}{6} = 392855,6 \text{ mm}^3$$

$$M_{max,fi} = W_{ef} f_{d,fi} 10^{-6}$$

$$M_{max,fi} = 392855,6 * 27,6 * 10^{-6} = 10,8 \text{ kNm}$$

Table. Glulam beam with one layer of GtF 15 according to 2004 version of Eurocode 5 after 30 minutes of fire

| | | | | |
|------------------------------|-------------|------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 10.8 | 130 | 296.5 | 832.6 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 28 | 28 | 28 | 28 |
| t_f / min | 43.5 | 43.5 | 43.5 | 43.5 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 55.69964 | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2$ | 0.511 | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n t_f} / \text{mm}$ | 7.9205 | 7.9205 | 7.9205 | 7.9205 |
| $d_{char,n t_a} / \text{mm}$ | 25 | 25 | 25 | 25 |
| $d_{char,n t} / \text{mm}$ | 1.022 | 1.022 | 1.022 | 1.022 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 8.022 | 8.022 | 8.022 | 8.022 |
| b_{fi} / mm | 63.956 | 183.956 | 183.956 | 183.956 |
| h_{fi} / mm | 191.978 | 391.978 | 591.978 | 991.978 |
| W_{fi} / mm^3 | 392855.6 | 4710707 | 10744194 | 30169408 |
| $M_{max,fi} / \text{kNm}$ | 10.8 | 130 | 296.5 | 832.6 |

Table. Glulam beam with one layer of GtF 15 according to 2004 version of Eurocode 5 after 60 minutes of fire

| | | | | |
|-------------------------------|------------|-------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 1.2 | 79.6 | 190.8 | 556.7 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 28 | 28 | 28 | 28 |
| t_f / min | 43.5 | 43.5 | 43.5 | 43.5 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 55.69964 | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2$ | 0.511 | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n\ t_f} / \text{mm}$ | 7.9205 | 7.9205 | 7.9205 | 7.9205 |
| $d_{char,n\ t_a} / \text{mm}$ | 25 | 25 | 25 | 25 |
| $d_{char,n\ t} / \text{mm}$ | 28.01025 | 28.01025 | 28.01025 | 28.01025 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 35.01025 | 35.01025 | 35.01025 | 35.01025 |
| b_{fi} / mm | 9.9795 | 129.9795 | 129.9795 | 129.9795 |
| h_{fi} / mm | 164.9898 | 364.9898 | 564.9898 | 964.9898 |
| W_{fi} / mm^3 | 45276.4 | 2885924 | 6915200 | 20172931 |
| $M_{max,fi} / \text{kNm}$ | 1.2 | 79.6 | 190.8 | 556.7 |

Table. Glulam beam with one layer of GtF 15 according to 2004 version of Eurocode 5 after 90 minutes of fire

| | | | | |
|------------------------------|----------|-------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 47.8 | 119.7 | 360.6 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| t_{ch} / min | 28 | 28 | 28 | 28 |
| t_f / min | 43.5 | 43.5 | 43.5 | 43.5 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 |
| t_a / min | 55.69964 | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2$ | 0.511 | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3$ | 1.4 | 1.4 | 1.4 | 1.4 |
| $d_{char,n t_f} / \text{mm}$ | 7.9205 | 7.9205 | 7.9205 | 7.9205 |
| $d_{char,n t_a} / \text{mm}$ | 25 | 25 | 25 | 25 |
| $d_{char,n t} / \text{mm}$ | 49.01025 | 49.01025 | 49.01025 | 49.01025 |
| k_0 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 56.01025 | 56.01025 | 56.01025 | 56.01025 |
| b_{fi} / mm | 0 | 87.9795 | 87.9795 | 87.9795 |
| h_{fi} / mm | 143.9898 | 343.9898 | 543.9898 | 943.9898 |
| W_{fi} / mm^3 | 0 | 1735087 | 4339220 | 13066666 |
| $M_{max,fi} / \text{kNm}$ | 0 | 47.8 | 119.7 | 360.6 |

**Appendix 5 Calculations of unprotected glulam column according to 2004
version of Eurocode 5**

| | |
|---|-------------------------------------|
| column height | $l=3m=3000mm$ |
| height | $h = 80 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24h |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{mm^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire | 4 |
| protection | none |

Effective cross-section method

| | |
|--|---|
| $d_{char,n} = \beta_n t$ | $d_{char,n} = 0,7 * 30 = 21 \text{ mm}$ |
| $d_{ef} = d_{char,n} + k_0 d_0$ | $d_{ef} = 21 + 1 * 7 = 28 \text{ mm}$ |
| $b_{fi} = b - 2d_{ef}$ | $b_{fi} = 80 - 2 * 28 = 24 \text{ mm}$ |
| $h_{fi} = h - 2d_{ef}$ | $h_{fi} = 80 - 2 * 28 = 24 \text{ mm}$ |
| $A_{fi} = b_{fi} h_{fi}$ | $A_{fi} = 24 * 24 = 576 \text{ mm}^2$ |
| $N_{max,fi} = A_{fi} f_{d,fi} 10^{-3}$ | $N_{max,fi} = 576 * 24,7 * 10^{-3} = 14,2 \text{ kN}$ |

Slenderness

| | |
|---|---|
| $I = \frac{b_{fi} h_{fi}^3}{12}$ | $I = \frac{24 * 24^3}{12} = 27648 \text{ mm}^4$ |
| $i = \sqrt{\frac{I}{A_{fi}}}$ | $i = \sqrt{\frac{27648}{576}} = 6,9 \text{ mm}$ |
| $l_0 = \mu l$ | $l_0 = 0,7 * 3000 = 2100 \text{ mm}$ |
| $\lambda_y = \frac{l_0}{i}$ | $\lambda_y = \frac{2100}{6,9} = 303,1$ |
| $\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$ | $\lambda_{rel,y} = \frac{303,1}{\pi} \sqrt{\frac{21,5}{9600}} = 4,57$ |
| $\beta_c = 0,1$ | |
| $k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$ | $k_y = 0,5 (1 + 0,1(4,57 - 0,3) + 4,57^2) = 11,1$ |
| $k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$ | $k_{cy} = \frac{1}{11,1 + \sqrt{11,1^2 - 4,57^2}} = 0,047$ |
| $\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$ | $\sigma_{c,0,d} = 0,047 * 21,5 = 1,01 \frac{N}{mm^2}$ |
| $N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$ | $N_{max,fi} = 576 * 1,01 * 10^{-3} = 0,581 \text{ kN}$ |

Table. Glulam column without protective layer according to 2004 version of Eurocode 5 after 30 minutes of fire

| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
|---------------------------------------|------------|--------------|---------------|
| Protective layer | none | none | none |
| Result / kN | 0.5 | 406.1 | 2538.9 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k}$ / kN/mm ² | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi}$ / kN/mm ² | 24.725 | 24.725 | 24.725 |
| β_n / mm/min | 0.7 | 0.7 | 0.7 |
| $d_{char,n}$ / mm | 21 | 21 | 21 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 28 | 28 | 28 |
| b_{fi} / mm | 24 | 144 | 344 |
| h_{fi} / mm | 24 | 144 | 344 |
| A_{fi} / mm ² | 576 | 20736 | 118336 |
| $N_{max,fi}$ / kN | 14.2 | 512.6 | 2925.8 |
| I / mm ⁴ | 27648 | 35831808 | 1166950741 |
| i / mm | 6.92820323 | 41.5692194 | 99.3042463 |
| I_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 303.108891 | 50.5181486 | 21.147132 |
| $E_{0,05}$ / kN/mm ² | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 4.5659633 | 0.76099388 | 0.31855558 |
| k_y | 11.1373086 | 0.81260554 | 0.55166661 |
| k_{cy} | 0.04695798 | 0.91108712 | 0.99793961 |
| $\sigma_{c,0,d}$ / kN/mm ² | 1.0095965 | 19.5883731 | 21.4557017 |
| $N_{max,fi}$ / kN | 0.58152759 | 406.184504 | 2538.98191 |

Table. Glulam column without protective layer according to 2004 version of Eurocode 5 after 60 minutes of fire

| | | | |
|-----------------------------------|------------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | none | none | none |
| Result / kN | 0 | 157.8 | 1946.8 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 42 | 42 | 42 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 49.00 | 49 | 49 |
| b_{fi} / mm | 0 | 102 | 302 |
| h_{fi} / mm | 0 | 102 | 302 |
| A_{fi} / mm^2 | 0 | 10404 | 91204 |
| $N_{max,fi} / \text{kN}$ | 0 | 257.2 | 2255 |
| I / mm^4 | 0 | 9020268 | 693180801 |
| i / mm | 0 | 29.4448637 | 87.1798906 |
| I_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 71.3197391 | 24.0881238 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.07434431 | 0.36285801 |
| k_y | 0.485 | 1.11582506 | 0.56897587 |
| k_{cy} | 1.03092784 | 0.70559769 | 0.99282086 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 15.1703504 | 21.3456486 |
| $N_{max,fi} / \text{kN}$ | 0 | 157.832326 | 1946.80853 |

Table. Glulam column without protective layer according to 2004 version of Eurocode 5 after 90 minutes of fire

| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
|-----------------------------------|------------|-------------|---------------|
| Protective layer | none | none | none |
| Result / kN | 0 | 21.8 | 1432.3 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 63 | 63 | 63 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 70 | 70 | 70 |
| b_{fi} / mm | 0 | 60 | 260 |
| h_{fi} / mm | 0 | 60 | 260 |
| A_{fi} / mm^2 | 0 | 3600 | 67600 |
| $N_{max,fi} / \text{kN}$ | 0 | 89 | 1671.4 |
| I / mm^4 | 0 | 1080000 | 380813333 |
| i / mm | 0 | 17.3205081 | 75.055535 |
| I_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 121.243557 | 27.9792823 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.82638532 | 0.42147354 |
| k_y | 0.485 | 2.24416094 | 0.59489365 |
| k_{cy} | 1.03092784 | 0.2818313 | 0.98548851 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 6.05937302 | 21.188003 |
| $N_{max,fi} / \text{kN}$ | 0 | 21.8137429 | 1432.309 |

**Appendix 6 Calculations of glulam column with one layer of GtA 12,5
according to 2004 version of Eurocode 5**

| | |
|---|--|
| column height | $l = 3\text{m} = 3000\text{mm}$ |
| height | $h = 80\text{ mm}$ |
| width | $b = 80\text{ mm}$ |
| material | GL24h |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{\text{mm}^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire protection | 4 |
| fire protective panel thickness | GtA 12,5 $h_p = 12,5\text{ mm}$ |

Effective cross-section method

$$t_{ch} = 2,8 h_p - 14$$

$$t_{ch} = 2,8 * 12,5 - 14 = 21\text{ min}$$

$$t_f = t_{ch}$$

$$t_f = 21\text{ min}$$

$$k_3 = 2$$

$$t_a = \min \left\{ \begin{array}{l} 2t_f \\ \frac{25}{k_3\beta_n} + t_f \end{array} \right.$$

$$t_a = \min \left\{ \begin{array}{l} 2 * 21 = 42\text{ min} \\ \frac{25}{2 * 0,7} + 21 = 38,8\text{ min} \\ = 30\text{ min} \end{array} \right. = 38,8\text{ min} > t$$

$$d_{char,n,t_f} = (t_f - t_{ch})k_2\beta_n$$

$$d_{char,n,t_f} = (21 - 21)k_2 * 0,7 = 0\text{ mm}$$

$$d_{char,n,t_a} = d_{char,n,t_f} + (t_a - t_f)k_3\beta_n$$

$$d_{char,n,t_a} = 0 + (38,8 - 21)2 * 0,7 = 25\text{ mm}$$

$$d_{char,n,t} = d_{char,n,t_f} + (t - t_{ch})k_3\beta_n$$

$$d_{char,n,t} = 0 + (30 - 21)2 * 0,7 = 12,6\text{ mm}$$

$$d_{ef} = d_{char,n,t} + k_0d_0$$

$$d_{ef} = 12,6 + 1 * 7 = 19,6\text{ mm}$$

$$b_{fi} = b - 2d_{ef}$$

$$b_{fi} = 80 - 2 * 19,6 = 40,8\text{ mm}$$

$$h_{fi} = h - 2d_{ef}$$

$$h_{fi} = 80 - 2 * 19,6 = 40,8\text{ mm}$$

$$A_{fi} = b_{fi}h_{fi}$$

$$A_{fi} = 40,8 * 40,8 = 1664,6\text{ mm}^2$$

$$N_{max,fi} = A_{fi}f_{d,fi}10^{-3}$$

$$N_{max,fi} = 1664,6 * 24,7 * 10^{-3} = 41,1\text{ kN}$$

Slenderness

$$I = \frac{b_{fi}h_{fi}^3}{12}$$

$$I = \frac{40,8 * 40,8^3}{12} = 230919\text{ mm}^4$$

$$i = \sqrt{\frac{I}{A_{fi}}}$$

$$i = \sqrt{\frac{230919}{1664,6}} = 11,8\text{ mm}$$

$$l_0 = \mu l$$

$$\lambda_y = \frac{l_0}{i}$$

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$$

$$\beta_c = 0,1$$

$$k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$$

$$k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$$

$$\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$$

$$N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$$

$$l_0 = 0,7 * 3000 = 2100 \text{ mm}$$

$$\lambda_y = \frac{2100}{11,8} = 178,3$$

$$\lambda_{rel,y} = \frac{178,3}{\pi} \sqrt{\frac{21,5}{9600}} = 2,69$$

$$k_y = 0,5 (1 + 0,1(2,69 - 0,3) + 2,69^2) = 4,23$$

$$k_{cy} = \frac{1}{4,23 + \sqrt{4,23^2 - 2,69^2}} = 0,113$$

$$\sigma_{c,0,d} = 0,113 * 21,5 = 2,87 \frac{N}{mm^2}$$

$$N_{max,fi} = 1664,6 * 2,87 * 10^{-3} = 4,78 \text{ kN}$$

Table. Glulam column with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 30 minutes of fire

| | | | |
|---------------------------------------|------------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kN | 4.7 | 520.7 | 2797.6 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k}$ / kN/mm ² | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi}$ / kN/mm ² | 24.725 | 24.725 | 24.725 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - |
| k_3 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| β_n / mm/min | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2$ / mm/min | | | |
| $\beta_n \cdot k_3$ / mm/min | 1.4 | 1.4 | 1.4 |
| $d_{char,n tf}$ / mm | 0 | 0 | 0 |
| $d_{char,n ta}$ / mm | 25 | 25 | 25 |
| $d_{char,n t}$ / mm | 12.6 | 12.6 | 12.6 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 19.6 | 19.6 | 19.6 |
| b_{fi} / mm | 40.8 | 160.8 | 360.8 |
| h_{fi} / mm | 40.8 | 160.8 | 360.8 |
| A_{fi} / mm ² | 1664.64 | 25856.64 | 130176.6 |
| $N_{max,fi}$ / kN | 41.1 | 639.3 | 3218.6 |
| I / mm ⁴ | 230918.9 | 55713819 | 1.41E+09 |
| i / mm | 11.77795 | 46.41896 | 104.154 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 178.2993 | 45.24013 | 20.16245 |
| $E_{0,05}$ / kN/mm ² | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 2.685861 | 0.681487 | 0.303723 |
| k_y | 4.226217 | 0.751287 | 0.54631 |
| k_{cy} | 0.133526 | 0.936746 | 0.99959 |
| $\sigma_{c,0,d}$ / kN/mm ² | 2.8708 | 20.14003 | 21.49119 |
| $N_{max,fi}$ / kN | 4.778849 | 520.7536 | 2797.651 |

Table. Glulam column with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 60 minutes of fire

| | | | |
|-------------------------------------|----------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kN | 0 | 180.9 | 2005.1 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - |
| k_3 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2 / \text{mm/min}$ | | | |
| $\beta_n \cdot k_3 / \text{mm/min}$ | 1.4 | 1.4 | 1.4 |
| $d_{char,n t_f} / \text{mm}$ | 0 | 0 | 0 |
| $d_{char,n t_a} / \text{mm}$ | 25 | 25 | 25 |
| $d_{char,n t} / \text{mm}$ | 39.8 | 39.8 | 39.8 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 46.8 | 46.80 | 46.8 |
| b_{fi} / mm | 0 | 106.4 | 306.4 |
| h_{fi} / mm | 0 | 106.4 | 306.4 |
| A_{fi} / mm^2 | 0 | 11320.96 | 93880.96 |
| $N_{max,fi} / \text{kN}$ | 0 | 279.9 | 2321.2 |
| I / mm^4 | 0 | 10680345 | 7.34E+08 |
| i / mm | 0 | 30.71503 | 88.45006 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 68.37043 | 23.74221 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.029917 | 0.357647 |
| k_y | 0.485 | 1.06686 | 0.566838 |
| k_{cy} | 1.030928 | 0.743395 | 0.993439 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 15.983 | 21.35895 |
| $N_{max,fi} / \text{kN}$ | 0 | 180.9429 | 2005.199 |

Table. Glulam column with one layer of GtA 12,5 according to 2004 version of Eurocode 5 after 90 minutes of fire

| | | | |
|-------------------------------------|----------|-------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kN | 0 | 28.7 | 1482.5 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | - | - | - |
| k_3 | 2 | 2 | 2 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| t_a / min | 38.85714 | 38.85714 | 38.85714 |
| $\beta_n \cdot k_2 / \text{mm/min}$ | | | |
| $\beta_n \cdot k_3 / \text{mm/min}$ | 1.4 | 1.4 | 1.4 |
| $d_{char,n\ t_f} / \text{mm}$ | 0 | 0 | 0 |
| $d_{char,n\ t_a} / \text{mm}$ | 25 | 25 | 25 |
| $d_{char,n\ t} / \text{mm}$ | 60.8 | 60.8 | 60.8 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 67.8 | 67.8 | 67.8 |
| b_{fi} / mm | 0 | 64.4 | 264.4 |
| h_{fi} / mm | 0 | 64.4 | 264.4 |
| A_{fi} / mm^2 | 0 | 4147.36 | 69907.36 |
| $N_{max,fi} / \text{kN}$ | 0 | 102.5 | 1728.4 |
| I / mm^4 | 0 | 1433383 | 4.07E+08 |
| i / mm | 0 | 18.59068 | 76.32571 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 112.9598 | 27.51367 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.701601 | 0.41446 |
| k_y | 0.485 | 2.017803 | 0.591611 |
| k_{cy} | 1.030928 | 0.322344 | 0.986406 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 6.930392 | 21.20774 |
| $N_{max,fi} / \text{kN}$ | 0 | 28.74283 | 1482.577 |

Appendix 7 Calculations of glulam column with one layer of GtF 15 according to 2004 version of Eurocode 5

| | |
|---|--|
| column height | $l = 3\text{m} = 3000\text{mm}$ |
| height | $h = 80\text{ mm}$ |
| width | $b = 80\text{ mm}$ |
| material | GL24h |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{\text{mm}^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire | 4 |
| protection | GtF 15 |
| fire protective panel thickness | $h_p = 15\text{ mm}$ |

Effective cross-section method

| | |
|--|---|
| $t_{ch} = 2,8 h_p - 14$ | $t_{ch} = 2,8 * 15 - 14 = 28\text{ min}$ |
| $t_f = 4,5 h_p - 24$ | $t_f = 4,5 * 15 - 24 = 43,5\text{ min} > t = 30\text{ min}$ |
| $k_2 = 1 - 0,018 h_p$ | $k_2 = 1 - 0,018 * 15 = 0,73$ |
| $k_3 = 2$ | |
| $t_a = \frac{25 - (t_f - t_{ch})k_2\beta_n}{k_3\beta_n} + t_f$ | $t_a = \frac{25 - (43,5 - 28)0,73 * 0,7}{2 * 0,7} + 43,5 = 55,7\text{ min}$ |
| $d_{char,n,t_f} = (t_f - t_{ch})k_2\beta_n$ | $d_{char,n,t_f} = (43,5 - 28)0,73 * 0,7 = 7,9\text{ mm}$ |
| $d_{char,n,t_a} = d_{char,n,t_f} + (t_a - t_f)k_3\beta_n$ | $d_{char,n,t_a} = 7,9 + (55,7 - 43,5)2 * 0,7 = 25\text{ mm}$ |
| $d_{char,n,t} = d_{char,n,t_f} + (t - t_{ch})k_2\beta_n$ | $d_{char,n,t} = 0 + (30 - 28)0,73 * 0,7 = 1,0\text{ mm}$ |
| $d_{ef} = d_{char,n,t} + k_0 d_0$ | $d_{ef} = 1,0 + 1 * 7 = 8,0\text{ mm}$ |
| $b_{fi} = b - 2d_{ef}$ | $b_{fi} = 80 - 2 * 8 = 64,0\text{ mm}$ |
| $h_{fi} = h - d_{ef}$ | $h_{fi} = 80 - 2 * 8 = 64,0\text{ mm}$ |
| $A_{fi} = b_{fi}h_{fi}$ | $A_{fi} = 64,0 * 64,0 = 4090,4\text{ mm}^2$ |
| $N_{max,fi} = A_{fi}f_{d,fi}10^{-3}$ | $N_{max,fi} = 4090,4 * 24,7 * 10^{-3} = 101,1\text{ kN}$ |

Slenderness

| | |
|---------------------------------|--|
| $I = \frac{b_{fi}h_{fi}^3}{12}$ | $I = \frac{64,0 * 64,0^3}{12} = 1394261\text{mm}^4$ |
| $i = \sqrt{\frac{I}{A_{fi}}}$ | $i = \sqrt{\frac{1394261}{4090,4}} = 18,5\text{ mm}$ |

$$l_0 = \mu l$$

$$\lambda_y = \frac{l_0}{i}$$

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$$

$$\beta_c = 0,1$$

$$k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$$

$$k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$$

$$\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$$

$$N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$$

$$l_0 = 0,7 * 3000 = 2100 \text{ mm}$$

$$\lambda_y = \frac{2100}{18,5} = 113,7$$

$$\lambda_{rel,y} = \frac{113,7}{\pi} \sqrt{\frac{21,5}{9600}} = 1,71$$

$$k_y = 0,5 (1 + 0,1(1,71 - 0,3) + 1,71^2) = 2,04$$

$$k_{cy} = \frac{1}{2,04 + \sqrt{2,04^2 - 1,71^2}} = 0,318$$

$$\sigma_{c,0,d} = 0,318 * 21,5 = 21,49 \frac{N}{mm^2}$$

$$N_{max,fi} = 4090,4 * 21,49 * 10^{-3} = 28,0 \text{ kN}$$

Table. Glulam column with one layer of GtF 15 according to 2004 version of Eurocode 5 after 30 minutes of fire

| | | | |
|-------------------------------------|-------------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 27.9 | 696.3 | 3169.5 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| h_p / mm | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 |
| t_{ch} / min | 28 | 28 | 28 |
| t_f / min | 43.5 | 43.5 | 43.5 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| t_a / min | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2 / \text{mm/min}$ | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3 / \text{mm/min}$ | 1.4 | 1.4 | 1.4 |
| $d_{char,n t_f} / \text{mm}$ | 7.9205 | 7.9205 | 7.9205 |
| $d_{char,n t_a} / \text{mm}$ | 25 | 25 | 25 |
| $d_{char,n t} / \text{mm}$ | 1.022 | 1.022 | 1.022 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 8.022 | 8.022 | 8.022 |
| b_{fi} / mm | 63.956 | 183.956 | 383.956 |
| h_{fi} / mm | 63.956 | 183.956 | 383.956 |
| A_{fi} / mm^2 | 4090.37 | 33839.81 | 147422.2 |
| $N_{max,fi} / \text{kN}$ | 101.1 | 836.6 | 3645 |
| I / mm^4 | 1394261 | 95427728 | 1.81E+09 |
| i / mm | 18.46251 | 53.10352 | 110.8385 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 113.744 | 39.5454 | 18.94648 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 1.713414 | 0.595703 | 0.285405 |
| k_y | 2.038565 | 0.692216 | 0.539998 |
| k_{cy} | 0.318159 | 0.957139 | 1.001592 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 6.84042 | 20.5785 | 21.5 |
| $N_{max,fi} / \text{kN}$ | 27.97985 | 696.3724 | 3169.578 |

Table. Glulam column with one layer of GtF 15 according to 2004 version of Eurocode 5 after 60 minutes of fire

| | | | |
|-------------------------------------|----------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 317.6 | 2332.6 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| h_p / mm | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 |
| t_{ch} / min | 28 | 28 | 28 |
| t_f / min | 43.5 | 43.5 | 43.5 |
| $\beta_n / \text{mm/min}$ | 0.7 | 0.7 | 0.7 |
| t_a / min | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2 / \text{mm/min}$ | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3 / \text{mm/min}$ | 1.4 | 1.4 | 1.4 |
| $d_{char,n t_f} / \text{mm}$ | 7.9205 | 7.9205 | 7.9205 |
| $d_{char,n t_a} / \text{mm}$ | 25 | 25 | 25 |
| $d_{char,n t} / \text{mm}$ | 28.01025 | 28.01025 | 28.01025 |
| k_0 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 |
| d_{ef} / mm | 35.01025 | 35.01025 | 35.01025 |
| b_{fi} / mm | 9.9795 | 129.9795 | 329.9795 |
| h_{fi} / mm | 9.9795 | 129.9795 | 329.9795 |
| A_{fi} / mm^2 | 99.59042 | 16894.67 | 108886.5 |
| $N_{max,fi} / \text{kN}$ | 2.4 | 417.7 | 2692.2 |
| I / mm^4 | 826.521 | 23785824 | 9.88E+08 |
| i / mm | 2.880834 | 37.52185 | 95.25688 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 728.9557 | 55.96739 | 22.04565 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 10.98082 | 0.84308 | 0.332091 |
| k_y | 61.32327 | 0.882546 | 0.556747 |
| k_{cy} | 0.00822 | 0.874499 | 0.996408 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 0.176729 | 18.80172 | 21.42277 |
| $N_{max,fi} / \text{kN}$ | 0.0176 | 317.6489 | 2332.649 |

Table. Glulam column with one layer of GtF 15 according to 2004 version of Eurocode 5 after 90 minutes of fire

| | | | |
|---|----------|-----------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 94 | 1766.4 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24h | GL24h |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k _{fi} | 1.15 | 1.15 | 1.15 |
| f _{c,0,g,k} / kN/mm ² | 21.5 | 21.5 | 21.5 |
| k _{mod,fi} | 1 | 1 | 1 |
| f _{d,fi} / kN/mm ² | 24.725 | 24.725 | 24.725 |
| h _p / mm | 15 | 15 | 15 |
| k ₂ | 0.73 | 0.73 | 0.73 |
| k ₃ | 2 | 2 | 2 |
| t _{ch} / min | 28 | 28 | 28 |
| t _f / min | 43.5 | 43.5 | 43.5 |
| β_n / mm/min | 0.7 | 0.7 | 0.7 |
| t _a / min | 55.69964 | 55.69964 | 55.69964 |
| $\beta_n \cdot k_2$ / mm/min | 0.511 | 0.511 | 0.511 |
| $\beta_n \cdot k_3$ / mm/min | 1.4 | 1.4 | 1.4 |
| d _{char,n t_f} / mm | 7.9205 | 7.9205 | 7.9205 |
| d _{char,n t_a} / mm | 25 | 25 | 25 |
| d _{char,n t} / mm | 49.01025 | 49.01025 | 49.01025 |
| k ₀ | 1 | 1 | 1 |
| d ₀ / mm | 7 | 7 | 7 |
| def / mm | 56.01025 | 56.01025 | 56.01025 |
| b _{fi} / mm | 0 | 87.9795 | 287.9795 |
| h _{fi} / mm | 0 | 87.9795 | 287.9795 |
| A _{fi} / mm ² | 0 | 7740.392 | 82932.19 |
| N _{max,fi} / kN | 0 | 191.3 | 2050.4 |
| I / mm ⁴ | 0 | 4992806 | 5.73E+08 |
| i / mm | 0 | 25.39749 | 83.13252 |
| I ₀ / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 82.68532 | 25.26087 |
| E _{0,05} / kN/mm ² | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.245553 | 0.380524 |
| k _y | 0.485 | 1.322979 | 0.576425 |
| k _{cy} | 1.030928 | 0.565314 | 0.990687 |
| $\sigma_{c,0,d}$ / kN/mm ² | 21.5 | 12.15426 | 21.29976 |
| N _{max,fi} / kN | 0 | 94.07872 | 1766.436 |

**Appendix 8 Calculations of the strength parameters according to 2020
version of Eurocode 5**

Table 4.x Materials used in this research and their characteristic values of strength properties for normal temperature

| Materials | Design compressive strength along the grain for normal temperature | Design bending strength for normal temperature |
|-----------|--|--|
| GL24c | Is not used in this research | $f_{m,g,k} = 24,0 \frac{N}{mm^2}$ |
| GL24h | $f_{c,0,g,k} = 21,5 \frac{N}{mm^2}$ | Is not used in this research |

$$\gamma_{M,fi} = 1,0$$

$$k_{fi} = 1,15$$

$$k_{\theta} = 1,0$$

$$f_{d,fi} = \frac{k_{\theta} k_{fi} f_k}{\gamma_{M,fi}}$$

Table 4.x Materials used in this research and their characteristic values of strength properties for fire exposure

| Materials | Design compressive strength along the grain for fire exposure | Design bending strength for fire exposure |
|-----------|--|--|
| GL24c | Is not used in this research | $f_{d,fi} = \frac{1,0 * 1,15 * 24}{1,0} = 27,6 \frac{N}{mm^2}$ |
| GL24h | $f_{d,fi} = \frac{1,0 * 1,15 * 21,5}{1,0} = 24,7 \frac{N}{mm^2}$ | Is not used in this research |

**Appendix 9 Calculations of unprotected glulam beam according to 2020
version of Eurocode 5**

| | |
|----------------------|----------------------------------|
| height | $h = 200 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24c |
| design fire strength | $f_{d,fi} = 27,6 \frac{N}{mm^2}$ |
| time | 30 min |
| sides open to fire | 3 |
| protection | none |

$$k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases} \quad k_{gd} = 1,0$$

$$k_n = \begin{cases} 1,23 \\ 1,08 \end{cases} \quad k_n = 1,08$$

$$\beta_n = \prod_{k_i} k_i \beta_0 \quad \beta_n = 1,0 * 1,08 * 0,65 = 0,702 \text{ mm/min}$$

$$d_{char,n} = \beta_n t \quad d_{char,n} = 0,70 * 30 = 21,1 \text{ mm}$$

$$d_{ef} = d_{char,n} + d_0 \quad d_{ef} = 21,1 + 7 = 28,1 \text{ mm}$$

$$b_{ef} = b - k_{sides} d_{ef} \quad b_{ef} = 80 - 2 * 28,1 = 23,8 \text{ mm}$$

$$h_{ef} = h - k_{sides} d_{ef} \quad h_{ef} = 200 - 1 * 28,1 = 171,9 \text{ mm}$$

$$W_{ef} = \frac{b_{ef} h_{ef}^2}{6} \quad W_{ef} = \frac{23,8 * 171,9^2}{6} = 117662 \text{ mm}^3$$

$$M_{max,fi} = W_{ef} f_{d,fi} 10^{-6} \quad M_{max,fi} = 117662 * 27,6 * 10^{-6} = 3,2 \text{ kN}$$

Table. Glulam beam without protective layer according to 2020 version of Eurocode 5 after 30 minutes of fire

| | | | | |
|-----------------------------|------------|-------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | none | none | none | none |
| Result / kNm | 3.2 | 91.5 | 216.5 | 625.2 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| k_{θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $\beta_n / \text{mm/min}$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 21.06 | 21.06 | 21.06 | 21.06 |
| d_0 / mm | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 28.06 | 28.06 | 28.06 | 28.06 |
| b_{fi} / mm | 23.88 | 143.88 | 143.88 | 143.88 |
| h_{fi} / mm | 171.94 | 371.94 | 571.94 | 971.94 |
| W_{fi} / mm^3 | 117662.2 | 3317377.9 | 7844226.4 | 22653123.4 |
| $M_{max,fi} / \text{kNm}$ | 3.2 | 91.5 | 216.5 | 625.2 |

Table. Glulam beam without protective layer according to 2020 version of Eurocode 5 after 60 minutes of fire

| | | | | |
|-----------------------------|----------|-------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | none | none | none | none |
| Result / kNm | 0 | 53.3 | 132.2 | 395.7 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| k_{θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $\beta_n / \text{mm/min}$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 42.12 | 42.12 | 42.12 | 42.12 |
| d_0 / mm | 10 | 10 | 10 | 10 |
| d_{ef} / mm | 52.12 | 52.12 | 52.12 | 52.12 |
| b_{fi} / mm | 0 | 95.76 | 95.76 | 95.76 |
| h_{fi} / mm | 147.88 | 347.88 | 547.88 | 947.88 |
| W_{fi} / mm^3 | 0 | 1931487.1 | 4790753 | 14339684.9 |
| $M_{max,fi} / \text{kNm}$ | 0 | 53.3 | 132.2 | 395.7 |

Table. Glulam beam without protective layer according to 2020 version of Eurocode 5 after 90 minutes of fire

| | | | | |
|-------------------------|----------|-------------|-------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | none | none | none | none |
| Result / kNm | 0 | 26.3 | 68.4 | 211.9 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| k_{θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / mm/min$ | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $\beta_n / mm/min$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / mm$ | 63.18 | 63.18 | 63.18 | 63.18 |
| d_0 / mm | 10 | 10 | 10 | 10 |
| d_{ef} / mm | 73.18 | 73.18 | 73.18 | 73.18 |
| b_{fi} / mm | 0 | 53.64 | 53.64 | 53.64 |
| h_{fi} / mm | 126.82 | 326.82 | 526.82 | 926.82 |
| W_{fi} / mm^3 | 0 | 954893.1 | 2481201.5 | 7679418.1 |
| $M_{max,fi} / kNm$ | 0 | 26.3 | 68.4 | 211.9 |

**Appendix 10 Calculations of glulam beam with one layer of GtA 12,5
according to 2020 version of Eurocode 5**

| | |
|---------------------------------|----------------------------------|
| height | $h = 200 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24c |
| design strength in fire | $f_{d,fi} = 27,6 \frac{N}{mm^2}$ |
| time | 30 min |
| sides open to fire | 3 |
| protection | GtA 12,5 |
| fire protective panel thickness | $h_p = 15 \text{ mm}$ |

Reduced cross-section method

$$k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases} \quad k_{gd} = 1,0$$

$$k_n = \begin{cases} 1,23 \\ 1,08 \end{cases} \quad k_n = 1,08$$

$$k_g = \begin{cases} 1,0 \\ 2,0 \end{cases} \quad k_g = 1,0$$

$$k_2 = 1 - 0,018h_p \quad k_2 = 1 - 0,018 * 12,5 = 0,775$$

$$k_3 = 2,0$$

$$k_4 = 1,0$$

$$\beta_{n,phase2} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_2 \beta_0 \quad \beta_{n,phase2} = 1,0 * 1,08 * 0,775 * 0,65 = 0,54$$

$$\beta_{n,phase3} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_3 \beta_0 \quad \beta_{n,phase3} = 1,0 * 1,08 * 2,0 * 0,65 = 1,40$$

$$\beta_{n,phase4} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_4 \beta_0 \quad \beta_{n,phase4} = 1,0 * 1,08 * 1,0 * 0,65 = 0,70$$

$$t_{f,pr} = t_{ch} = \sum t_{prot}$$

$$\sum t_{prot} = 30 \left(\frac{h_p}{15} \right)^{1,2} \quad \sum t_{prot} = 30 \left(\frac{12,5}{15} \right)^{1,2} = 24,1 \text{ min}$$

$$t_a = \min \left\{ \begin{array}{l} 2 t_{f,pr} \\ t_{f,pr} + \frac{25 - (t_f - t_{ch}) \beta_{n,phase2}}{\beta_{n,phase3}} \end{array} \right. \quad t_a = \min \left\{ \begin{array}{l} 2 * 24,1 = 48,2 \text{ min} \\ 24,1 + \frac{25 - (24,1 - 24,1) * 0,54}{1,40} = 41,9 \text{ min} \end{array} \right. = 41,9 \text{ min}$$

$$d_{char,n,t_f} = (t_f - t_{ch}) \beta_{n,phase2} \quad d_{char,n,t_f} = (24,1 - 24,1) * 0,54 = 0 \text{ mm}$$

$$d_{char,n,t} = d_{char,n,t_f} + (t - t_f)\beta_{n,phase3}$$

$$d_{ef} = d_{char,n} + d_0$$

$$b_{ef} = b - k_{sides}d_{ef}$$

$$h_{ef} = h - k_{sides}d_{ef}$$

$$W_{ef} = \frac{b_{ef}h_{ef}^2}{6}$$

$$M_{max,fi} = W_{ef}f_{d,fi}10^{-6}$$

$$d_{char,n,t} = 0 + (30 - 24,1) * 1,4 = 8,28 \text{ mm}$$

$$d_{ef} = 8,28 + 7 = 15,28 \text{ mm}$$

$$b_{ef} = 80 - 2 * 15,28 = 49,45 \text{ mm}$$

$$h_{ef} = 200 - 1 * 15,28 = 184,72 \text{ mm}$$

$$W_{ef} = \frac{49,45 * 184,72^2}{6} = 281207 \text{ mm}^3$$

$$M_{max,fi} = 281207 * 27,6 * 10^{-6} = 7,7 \text{ kN}$$

Table. Glulam beam with one layer of GtA 12,5 according to 2020 version of Eurocode 5 after 30 minutes of fire

| | | | | |
|-----------------------------------|------------|--------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 7.7 | 115.3 | 266.4 | 755.8 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| k_{Θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / \text{mm/min}$ | 0.54 | 0.54 | 0.54 | 0.54 |
| $k_3 k_n \beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 \text{ mm/min}$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | - | - | - | - |
| $t_{prot,i} / \text{min}$ | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_f / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_a / min | 41.91 | 41.91 | 41.91 | 41.91 |
| $d_{char,n tf} / \text{mm}$ | 0.00 | 0.00 | 0.00 | 0.00 |
| $d_{char,n ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / \text{mm}$ | 8.28 | 8.28 | 8.28 | 8.28 |
| d_o / mm | 7.00 | 7.00 | 7.00 | 7.00 |
| d_{ef} / mm | 15.28 | 15.28 | 15.28 | 15.28 |
| b_{fi} / mm | 49.45 | 169.45 | 169.45 | 169.45 |
| h_{fi} / mm | 184.72 | 384.72 | 584.72 | 984.72 |
| W_{fi} / mm^3 | 281206.5 | 4180012 | 9655649 | 27384775 |
| $M_{max,fi} / \text{kNm}$ | 7.7 | 115.3 | 266.4 | 755.8 |

Table. Glulam beam with one layer of GtA 12,5 according to 2020 version of Eurocode 5 after 60 minutes of fire

| | | | | |
|----------------------------|----------|-------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 59.7 | 146.7 | 436.3 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| k_{Θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / mm/min$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / mm/min$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / mm/min$ | 0.54 | 0.54 | 0.54 | 0.54 |
| $k_3 k_n \beta_0 / mm/min$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / mm/min$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / min$ | - | - | - | - |
| $t_{prot,i} / min$ | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_f / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_a / min | 41.91 | 41.91 | 41.91 | 41.91 |
| $d_{char,n tf} / mm$ | 0.00 | 0.00 | 0.00 | 0.00 |
| $d_{char,n ta} / mm$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / mm$ | 37.70 | 37.70 | 37.70 | 37.70 |
| d_0 / mm | 10.00 | 10.00 | 10.00 | 10.00 |
| d_{ef} / mm | 47.70 | 47.70 | 47.70 | 47.70 |
| b_{fi} / mm | 0.00 | 104.60 | 104.60 | 104.60 |
| h_{fi} / mm | 152.30 | 352.30 | 552.30 | 952.30 |
| W_{fi} / mm^3 | 0 | 2163828 | 5317973 | 15810389 |
| $M_{max,fi} / kNm$ | 0 | 59.7 | 146.7 | 436.3 |

Table. Glulam beam with one layer of GtA 12,5 according to 2020 version of Eurocode 5 after 90 minutes of fire

| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
|----------------------------|----------|-------------|-------------|--------------|
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 31.5 | 81.1 | 249.2 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| k_{θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / mm/min$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / mm/min$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / mm/min$ | 0.54 | 0.54 | 0.54 | 0.54 |
| $k_3 k_n \beta_0 / mm/min$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / mm/min$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / min$ | - | - | - | - |
| $t_{prot,i} / min$ | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_f / min | 24.10481 | 24.10481 | 24.10481 | 24.10481 |
| t_a / min | 41.91 | 41.91 | 41.91 | 41.91 |
| $d_{char,n tf} / mm$ | 0.00 | 0.00 | 0.00 | 0.00 |
| $d_{char,n ta} / mm$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / mm$ | 58.76 | 58.76 | 58.76 | 58.76 |
| d_o / mm | 10.00 | 10.00 | 10.00 | 10.00 |
| d_{ef} / mm | 68.76 | 68.76 | 68.76 | 68.76 |
| b_{fi} / mm | 0.00 | 62.48 | 62.48 | 62.48 |
| h_{fi} / mm | 131.24 | 331.24 | 531.24 | 931.24 |
| W_{fi} / mm^3 | 0 | 1142619 | 2938975 | 9031012 |
| $M_{max,fi} / kNm$ | 0 | 31.5 | 81.1 | 249.2 |

Appendix 11 Calculations of glulam beam with one layer of GtF 15 according to 2020 version of Eurocode 5

| | |
|---------------------------------|----------------------------------|
| height | $h = 200 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24c |
| design strength in fire | $f_{d,fi} = 27,6 \frac{N}{mm^2}$ |
| time | 30 min |
| sides open to fire | 3 |
| protection | GtF 15 |
| fire protective panel thickness | $h_p = 15 \text{ mm}$ |

Reduced cross-section method

| | |
|---|---|
| $k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases}$ | $k_{gd} = 1,0$ |
| $k_n = \begin{cases} 1,23 \\ 1,08 \end{cases}$ | $k_n = 1,08$ |
| $k_2 = 1 - 0,018h_p$ | $k_2 = 1 - 0,018 * 15 = 0,73$ |
| $k_3 = 2,0$ | |
| $k_4 = 1,0$ | |
| $\beta_{n,phase2} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_2 \beta_0$ | $\beta_{n,phase2} = 1,0 * 1,08 * 0,73 * 0,65 = 0,51$ |
| $\beta_{n,phase3} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_3 \beta_0$ | $\beta_{n,phase3} = 1,0 * 1,08 * 2,0 * 0,65 = 1,40$ |
| $\beta_{n,phase4} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_4 \beta_0$ | $\beta_{n,phase4} = 1,0 * 1,08 * 1,0 * 0,65 = 0,70$ |
| $t_{f,pr} = 1,2 (1,6h_p + 3)$ | $t_{f,pr} = 1,2(1,6 * 15 + 3) = 32,4 \text{ min}$ |
| $t_{prot} = 30 \left(\frac{h_p}{15} \right)^{1,2}$ | $t_{prot} = 30 \left(\frac{15}{15} \right)^{1,2} = 30,0 \text{ min}$ |
| $t_{ch} = \min \left\{ \sum t_{prot} \right. \\ \left. t_{f,pr} \right\}$ | $t_{ch} = \min \left\{ \begin{matrix} 30,0 \text{ min} \\ 32,4 \text{ min} \end{matrix} \right. = 30,0 \text{ min}$ |
| $t_a = \min \left\{ \begin{matrix} 2 t_{f,pr} \\ t_{f,pr} + \frac{25 - (t_f - t_{ch}) \beta_{n,phase2}}{\beta_{n,phase3}} \end{matrix} \right.$ | $t_a = \min \left\{ \begin{matrix} 2 * 32,4 = 54 \text{ min} \\ 32,4 + \frac{25 - (32,4 - 30) * 0,51}{1,40} = 49,33 \text{ min} \end{matrix} \right. = 49,33 \text{ min}$ |
| $d_{char,n,t} = (t - t_{ch}) \beta_{n,phase2}$ | $d_{char,n,t} = (30 - 30) * 0,51 = 0 \text{ mm}$ |
| $d_{ef} = d_{char,n} + d_0$ | $d_{ef} = 0 + 7 = 7 \text{ mm}$ |

$$b_{ef} = b - k_{sides}d_{ef}$$

$$h_{ef} = h - k_{sides}d_{ef}$$

$$W_{ef} = \frac{b_{ef}h_{ef}^2}{6}$$

$$M_{max,fi} = W_{ef}f_{d,fi}10^{-6}$$

$$b_{ef} = 80 - 2 * 7 = 66 \text{ mm}$$

$$h_{ef} = 200 - 1 * 7 = 193 \text{ mm}$$

$$W_{ef} = \frac{66 * 193^2}{6} = 409739 \text{ mm}^3$$

$$M_{max,fi} = 409739 * 27,6 * 10^{-6} = 11,3 \text{ kN}$$

Table. Glulam beam with one layer of GtF 15 according to 2020 version of Eurocode 5 after 30 minutes of fire

| | | | | |
|-----------------------------------|-------------|--------------|--------------|--------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 11.3 | 132.1 | 300.8 | 843.6 |
| Required time / min | 30 | 30 | 30 | 30 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 24 | 24 | 24 |
| k_{Θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / \text{mm/min}$ | 0.51 | 0.51 | 0.51 | 0.51 |
| $k_3 k_n \beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 \text{ mm/min}$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 32.4 | 32.4 | 32.4 | 32.4 |
| $t_{prot,i} / \text{min}$ | 30 | 30 | 30 | 30 |
| t_{ch} / min | 30 | 30 | 30 | 30 |
| t_f / min | 32.4 | 32.4 | 32.4 | 32.4 |
| t_a / min | 49.33 | 49.33 | 49.33 | 49.33 |
| $d_{char,n tf} / \text{mm}$ | 1.23 | 1.23 | 1.23 | 1.23 |
| $d_{char,n ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / \text{mm}$ | 0.00 | 0.00 | 0.00 | 0.00 |
| d_0 / mm | 7.00 | 7.00 | 7.00 | 7.00 |
| d_{ef} / mm | 7.00 | 7.00 | 7.00 | 7.00 |
| b_{fi} / mm | 66.00 | 186.00 | 186.00 | 186.00 |
| h_{fi} / mm | 193.00 | 393.00 | 593.00 | 993.00 |
| W_{fi} / mm^3 | 409739 | 4787919 | 10901119 | 30567519 |
| $M_{max,fi} / \text{kNm}$ | 11.3 | 132.1 | 300.8 | 843.6 |

Table. Glulam beam with one layer of GtF 15 according to 2020 version of Eurocode 5 after 60 minutes of fire

| | | | | |
|----------------------------|----------|-------------|--------------|------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 67.6 | 164.4 | 485 |
| Required time / min | 60 | 60 | 60 | 60 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| k_{Θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / mm/min$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / mm/min$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / mm/min$ | 0.51 | 0.51 | 0.51 | 0.51 |
| $k_3 k_n \beta_0 / mm/min$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / mm/min$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / min$ | 32.4 | 32.4 | 32.4 | 32.4 |
| $t_{prot,i} / min$ | 30 | 30 | 30 | 30 |
| t_{ch} / min | 30 | 30 | 30 | 30 |
| t_f / min | 32.4 | 32.4 | 32.4 | 32.4 |
| t_a / min | 49.33 | 49.33 | 49.33 | 49.33 |
| $d_{char,n tf} / mm$ | 1.23 | 1.23 | 1.23 | 1.23 |
| $d_{char,n ta} / mm$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / mm$ | 32.49 | 32.49 | 32.49 | 32.49 |
| d_0 / mm | 10.00 | 10.00 | 10.00 | 10.00 |
| d_{ef} / mm | 42.49 | 42.49 | 42.49 | 42.49 |
| b_{fi} / mm | 0.00 | 115.02 | 115.02 | 115.02 |
| h_{fi} / mm | 157.51 | 357.51 | 557.51 | 957.51 |
| W_{fi} / mm^3 | 0 | 2450174 | 5958351 | 17575491 |
| $M_{max,fi} / kNm$ | 0 | 67.6 | 164.4 | 485 |

Table. Glulam beam with one layer of GtF 15 according to 2020 version of Eurocode 5 after 90 minutes of fire

| | | | | |
|----------------------------|----------|-------------|-------------|------------|
| Cross-section / mm x mm | 80x200 | 200x400 | 200x600 | 200x1000 |
| Protective layer | GtF15 | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 37.9 | 96.5 | 294 |
| Required time / min | 90 | 90 | 90 | 90 |
| Strength class | GL24c | GL24c | GL24c | GL24c |
| b / mm | 80 | 200 | 200 | 200 |
| h / mm | 200 | 400 | 600 | 1000 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / N/mm^2$ | 24 | 24 | 24 | 24 |
| k_{Θ} | 1 | 1 | 1 | 1 |
| $f_{d,fi} / N/mm^2$ | 27.6 | 27.6 | 27.6 | 27.6 |
| $\beta_0 / mm/min$ | 0.65 | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / mm/min$ | 0.70 | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / mm/min$ | 0.51 | 0.51 | 0.51 | 0.51 |
| $k_3 k_n \beta_0 / mm/min$ | 1.40 | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / mm/min$ | 0.702 | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / min$ | 32.4 | 32.4 | 32.4 | 32.4 |
| $t_{prot,i} / min$ | 30 | 30 | 30 | 30 |
| t_{ch} / min | 30 | 30 | 30 | 30 |
| t_f / min | 32.4 | 32.4 | 32.4 | 32.4 |
| t_a / min | 49.33 | 49.33 | 49.33 | 49.33 |
| $d_{char,n tf} / mm$ | 1.23 | 1.23 | 1.23 | 1.23 |
| $d_{char,n ta} / mm$ | 25.00 | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / mm$ | 53.55 | 53.55 | 53.55 | 53.55 |
| d_0 / mm | 10.00 | 10.00 | 10.00 | 10.00 |
| d_{ef} / mm | 63.55 | 63.55 | 63.55 | 63.55 |
| b_{fi} / mm | 0.00 | 72.90 | 72.90 | 72.90 |
| h_{fi} / mm | 136.45 | 336.45 | 536.45 | 936.45 |
| W_{fi} / mm^3 | 0 | 1375356 | 3496494 | 10654756 |
| $M_{max,fi} / kNm$ | 0 | 37.9 | 96.5 | 294 |

**Appendix 12 Calculations of unprotected glulam column according to 2020
version of Eurocode 5**

| | |
|---|-------------------------------------|
| column height | $l=3m=3000mm$ |
| height | $h = 80 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24h |
| design strength in fire | $f_{d,fi} = 24,7 \frac{N}{mm^2}$ |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{mm^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire | 4 |
| protection | none |

Reduced cross-section method

| | |
|---|--|
| $k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases}$ | $k_{gd} = 1,0$ |
| $k_n = \begin{cases} 1,23 \\ 1,08 \end{cases}$ | $k_n = 1,08$ |
| $\beta_n = \prod_{k_i} k_i \beta_0$ | $\beta_n = 1,0 * 1,08 * 0,65 = 0,70 \text{ mm/min}$ |
| $d_{char,n} = \beta_n t$ | $d_{char,n} = 0,70 * 30 = 21,0 \text{ mm}$ |
| $d_{ef} = d_{char,n} + d_0$ | $d_{ef} = 21 + 14 = 35 \text{ mm}$ |
| $b_{ef} = b - k_{sides} d_{ef}$ | $b_{ef} = 80 - 2 * 35 = 10 \text{ mm}$ |
| $h_{ef} = h - k_{sides} d_{ef}$ | $h_{ef} = 80 - 2 * 35 = 0 \text{ mm}$ |
| $A_{ef} = b_{ef} h_{ef}$ | $A_{ef} = 10 * 10 = 100 \text{ mm}^2$ |
| $N_{max,fi} = A_{ef} f_{d,fi} 10^{-3}$ | $N_{max,fi} = 100 * 24,7 * 10^{-3} = 2,4 \text{ kN}$ |

Slenderness

| | |
|----------------------------------|---|
| $I = \frac{b_{ef} h_{ef}^3}{12}$ | $I = \frac{10 * 10^3}{12} = 794 \text{ mm}^4$ |
| $i = \sqrt{\frac{I}{A_{fi}}}$ | $i = \sqrt{\frac{794}{100}} = 2,9 \text{ mm}$ |
| $l_0 = \mu l$ | $l_0 = 0,7 * 3000 = 2100 \text{ mm}$ |
| $\lambda_y = \frac{l_0}{i}$ | $\lambda_y = \frac{2100}{2,9} = 736,2$ |

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$$

$$\beta_c = 0,1$$

$$k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$$

$$k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$$

$$\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$$

$$N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$$

$$\lambda_{rel,y} = \frac{736,2}{\pi} \sqrt{\frac{21,5}{9600}} = 11,1$$

$$k_y = 0,5 (1 + 0,1(11,1 - 0,3) + 11,1^2) = 62,5$$

$$k_{cy} = \frac{1}{62,5 + \sqrt{62,5^2 - 11,1^2}} = 0,01$$

$$\sigma_{c,0,d} = 0,01 * 21,5 = 0,17 \frac{N}{mm^2}$$

$$N_{max,fi} = 100 * 0,17 * 10^{-3} = 0,01 kN$$

Table. Glulam column with no protective layer according to 2020 version of Eurocode after 30 minutes of fire

| | | | |
|--|----------|------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | none | none | none |
| Result / kNm | 0 | 317 | 2331.2 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k}$ / kN/mm ² | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi}$ / kN/mm ² | 24.725 | 24.725 | 24.725 |
| β_0 / mm/min | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 |
| β_n / mm/min | 0.702 | 0.702 | 0.702 |
| $d_{char,n}$ / mm | 21.06 | 21.06 | 21.06 |
| d_0 / mm | 14 | 14 | 14 |
| d_{ef} / mm | 35.06 | 35.06 | 35.06 |
| b_{fi} / mm | 9.88 | 129.88 | 329.88 |
| h_{fi} / mm | 9.88 | 129.88 | 329.88 |
| A_{fi} / mm ² | 97.6 | 16868.8 | 108820.8 |
| $N_{max,fi}$ / kN | 2.4 | 417 | 2690.5 |
| I / mm ⁴ | 794.0476 | 23713075 | 9.87E+08 |
| i / mm | 2.852321 | 37.49314 | 95.22816 |
| I ₀ / mm | 2100 | 2100 | 2100 |
| λ_y | 736.2426 | 56.01024 | 22.0523 |
| E _{0,05} / kN/mm ² | 9600 | 9601 | 9602 |
| $\lambda_{rel,y}$ | 11.09059 | 0.843682 | 0.332156 |
| k_y | 62.54013 | 0.883083 | 0.556772 |
| k_{cy} | 0.008059 | 0.874184 | 0.9964 |
| $\sigma_{c,0,d}$ / kN/mm ² | 0.173263 | 18.79496 | 21.4226 |
| $N_{max,fi}$ / kN | 0.01691 | 317.0484 | 2331.225 |

Table. Glulam column with no protective layer according to 2020 version of Eurocode after 60 minutes of fire

| | | | |
|-----------------------------------|----------|-------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | none | none | none |
| Result / kNm | 0 | 78.4 | 1713.8 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 |
| $\beta_n / \text{mm/min}$ | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 42.12 | 42.12 | 42.12 |
| d_0 / mm | 16 | 16 | 16 |
| d_{ef} / mm | 58.12 | 58.12 | 58.12 |
| b_{fi} / mm | 0 | 83.76 | 283.76 |
| h_{fi} / mm | 0 | 83.76 | 283.76 |
| A_{fi} / mm^2 | 0 | 7015.7 | 80519.7 |
| $N_{max,fi} / \text{kN}$ | 0 | 173.4 | 1990.8 |
| I / mm^4 | 0 | 4101715 | 5.4E+08 |
| i / mm | 0 | 24.17949 | 81.91448 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 86.85045 | 25.63649 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.308295 | 0.386182 |
| k_y | 0.485 | 1.406233 | 0.578878 |
| k_{cy} | 1.030928 | 0.520333 | 0.98999 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 11.18717 | 21.28479 |
| $N_{max,fi} / \text{kN}$ | 0 | 78.48582 | 1713.845 |

Table. Glulam column with no protective layer according to 2020 version of Eurocode after 90 minutes of fire

| | | | |
|-----------------------------------|----------|------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | none | none | none |
| Result / kNm | 0 | 5.1 | 1231.7 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 |
| $\beta_n / \text{mm/min}$ | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 63.18 | 63.18 | 63.18 |
| d_0 / mm | 16 | 16 | 16 |
| d_{ef} / mm | 79.18 | 79.18 | 79.18 |
| b_{fi} / mm | 0 | 41.64 | 241.64 |
| h_{fi} / mm | 0 | 41.64 | 241.64 |
| A_{fi} / mm^2 | 0 | 1733.9 | 58389.9 |
| $N_{max,fi} / \text{kN}$ | 0 | 42.8 | 1443.6 |
| I / mm^4 | 0 | 250531.1 | 2.84E+08 |
| i / mm | 0 | 12.0204 | 69.75545 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 174.7031 | 30.10517 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9601 | 9602 |
| $\lambda_{rel,y}$ | 0 | 2.63155 | 0.45345 |
| k_y | 0.485 | 4.079105 | 0.610481 |
| k_{cy} | 1.030928 | 0.138969 | 0.981139 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 2.987837 | 21.0945 |
| $N_{max,fi} / \text{kN}$ | 0 | 5.18061 | 1231.706 |

**Appendix 13 Calculations of glulam column with one layer of GtA 12,5
according to 2020 version of Eurocode 5**

| | |
|--|-------------------------------------|
| column height | $l=3m=3000mm$ |
| height | $h = 80 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24h |
| design strength in fire | $f_{d,fi} = 24,7 \frac{N}{mm^2}$ |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{mm^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire | 4 |
| protection | GtA 12,5 |

Reduced cross-section method

$$k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases} \quad k_{gd} = 1,0$$

$$k_n = \begin{cases} 1,23 \\ 1,08 \end{cases} \quad k_n = 1,08$$

$$k_2 = 1 - 0,018h_p \quad k_2 = 1 - 0,018 * 12,5 = 0,775$$

$$k_3 = 2,0$$

$$k_4 = 1,0$$

$$\beta_{n,phase2} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_g k_2 \beta_0 \quad \beta_{n,phase2} = 1,0 * 1,08 * 1,0 * 0,775 * 0,65 = 0,54$$

$$\beta_{n,phase3} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_g k_3 \beta_0 \quad \beta_{n,phase3} = 1,0 * 1,08 * 1,0 * 2,0 * 0,65 = 1,40$$

$$\beta_{n,phase4} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_4 \beta_0 \quad \beta_{n,phase4} = 1,0 * 1,08 * 1,0 * 0,65 = 0,70$$

$$t_{f,pr} = 1,2(1,8h_p - 4,8) \quad t_{f,pr} = 1,2 * (1,8 * 12,5 - 4,8) = 21 \text{ min}$$

$$t_{prot} = 30 \left(\frac{h_p}{15} \right)^{1,2} \quad t_{prot} = 30 \left(\frac{12,5}{15} \right)^{1,2} = 24,1 \text{ min}$$

$$t_{ch} = \min \left\{ \sum t_{prot} \right. \quad \left. t_{f,pr} \right\} \quad t_{ch} = \min \left\{ \begin{matrix} 24,1 \text{ min} \\ 21 \text{ min} \end{matrix} \right. = 21 \text{ min}$$

$$t_a = \min \left\{ t_{f,pr} + \frac{2 t_{f,pr} - (t_f - t_{ch}) \beta_{n,phase}}{\beta_{n,phase3}} \quad t_a = \min \left\{ 21 + \frac{2 * 21 = 42 - (21 - 21) * 0,54}{1,40} = 38,8 = 38,8 \text{ min} \right. \right.$$

$$d_{char,n,t_f} = (t_f - t_{ch}) \beta_{n,phase2}$$

$$d_{char,n,t_f} = (21 - 21) * 0,54 = 0 \text{ mm}$$

$$d_{char,n,t} = d_{char,n,t_f} + (t - t_f) \beta_{n,phase3}$$

$$d_{char,n,t} = 0 + (30 - 21) * 1,40 = 12,6 \text{ mm}$$

$$d_{ef} = d_{char,n} + d_0$$

$$d_{ef} = 12,6 + 14 = 26,6 \text{ mm}$$

$$b_{ef} = b - k_{sides} d_{ef}$$

$$b_{ef} = 80 - 2 * 26,6 = 26,8 \text{ mm}$$

$$h_{ef} = h - k_{sides} d_{ef}$$

$$h_{ef} = 80 - 2 * 26,6 = 26,8 \text{ mm}$$

$$A_{ef} = b_{ef} h_{ef}$$

$$A_{ef} = 26,8 * 26,8 = 718,24 \text{ mm}^2$$

$$N_{max,fi} = A_{ef} f_{d,fi} 10^{-3}$$

$$N_{max,fi} = 718,24 * 24,7 * 10^{-3} = 7,5 \text{ kN}$$

Slenderness

$$I = \frac{b_{fi} h_{fi}^3}{12}$$

$$I = \frac{26,8 * 26,8^3}{12} = 42519 \text{ mm}^4$$

$$i = \sqrt{\frac{I}{A_{fi}}}$$

$$i = \sqrt{\frac{42519}{718,24}} = 7,7 \text{ mm}$$

$$l_0 = \mu l$$

$$l_0 = 0,7 * 3000 = 2100 \text{ mm}$$

$$\lambda_y = \frac{l_0}{i}$$

$$\lambda_y = \frac{2100}{7,7} = 272,2$$

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$$

$$\lambda_{rel,y} = \frac{272,2}{\pi} \sqrt{\frac{21,5}{9600}} = 4,10$$

$$\beta_c = 0,1$$

$$k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$$

$$k_y = 0,5 (1 + 0,1(4,10 - 0,3) + 4,10^2) = 9,09$$

$$k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$$

$$k_{cy} = \frac{1}{9,09 + \sqrt{9,09^2 - 4,10^2}} = 0,06$$

$$\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$$

$$\sigma_{c,0,d} = 0,06 * 21,5 = 1,25 \frac{\text{N}}{\text{mm}^2}$$

$$N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$$

$$N_{max,fi} = 718,24 * 1,25 * 10^{-3} = 0,9 \text{ kN}$$

Table. Glulam column with one layer of GtA 12,5 according to 2020 version of Eurocode after 30 minutes of fire

| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
|---------------------------------|------------|--------------|---------------|
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0.8 | 424.1 | 2580.1 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |
| $k_n\beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 |
| $k_2k_n\beta_0 / \text{mm/min}$ | 0.54 | 0.54 | 0.54 |
| $k_3k_n\beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 |
| $k_4k_n\beta_0 \text{ mm/min}$ | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 21 | 21 | 21 |
| $t_{prot,i} / \text{min}$ | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| t_a / min | 38.81 | 38.81 | 38.81 |
| $d_{char,n\ tf} / \text{mm}$ | 0.00 | 0.00 | 0.00 |
| $d_{char,n\ ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,n\ t} / \text{mm}$ | 12.64 | 12.64 | 12.64 |
| d_0 / mm | 14.00 | 14.00 | 14.00 |
| d_{ef} / mm | 26.64 | 26.64 | 26.64 |
| b_{fi} / mm | 26.73 | 146.73 | 346.73 |
| h_{fi} / mm | 26.73 | 146.73 | 346.73 |
| A_{fi} / mm^2 | 714.386 | 21529.11 | 120220.3 |
| $N_{max,fi} / \text{kN}$ | 17.6 | 532.3 | 2972.4 |

Table continues

| | | | |
|-----------------------------------|----------|----------|----------|
| I / mm^4 | 42528.94 | 38625200 | 1.2E+09 |
| i / mm | 7.715709 | 42.35673 | 100.0918 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 272.172 | 49.5789 | 20.98075 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 4.099937 | 0.746845 | 0.316049 |
| k_y | 9.094739 | 0.801231 | 0.550746 |
| k_{cy} | 0.058096 | 0.916261 | 0.99822 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 1.249062 | 19.6996 | 21.46174 |
| $N_{max,fi} / \text{kN}$ | 0.892312 | 424.1149 | 2580.137 |

Table. Glulam column with one layer of GtA 12,5 according to 2020 version of Eurocode after 60 minutes of fire

| | | | |
|-----------------------------------|----------|-------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 95.1 | 1769.7 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / \text{mm/min}$ | 0.54 | 0.54 | 0.54 |
| $k_3 k_n \beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / \text{mm/min}$ | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 21 | 21 | 21 |
| $t_{prot,i} / \text{min}$ | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| t_a / min | 38.81 | 38.81 | 38.81 |

Table continues

| | | | |
|-----------------------------------|----------|----------|----------|
| $d_{char,ntf} / \text{mm}$ | 0.00 | 0.00 | 0.00 |
| $d_{char,nta} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,nt} / \text{mm}$ | 39.88 | 39.88 | 39.88 |
| d_0 / mm | 16.00 | 16.00 | 16.00 |
| d_{ef} / mm | 55.88 | 55.88 | 55.88 |
| b_{fi} / mm | 0.00 | 88.24 | 288.24 |
| h_{fi} / mm | 0.00 | 88.24 | 288.24 |
| A_{fi} / mm^2 | 0 | 7787.004 | 83084.6 |
| $N_{max,fi} / \text{kN}$ | 0 | 192.5 | 2054.2 |
| I / mm^4 | 0 | 5053119 | 5.75E+08 |
| i / mm | 0 | 25.47385 | 83.20888 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 82.43748 | 25.23769 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.241819 | 0.380175 |
| k_y | 0.485 | 1.318149 | 0.576275 |
| k_{cy} | 1.030928 | 0.56812 | 0.990729 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 12.21459 | 21.30068 |
| $N_{max,fi} / \text{kN}$ | 0 | 95.11505 | 1769.759 |

Table. Glulam column with one layer of GtA 12,5 according to 2020 version of Eurocode after 90 minutes of fire

| | | | |
|--------------------------------|----------|------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtA12,5 | GtA12,5 | GtA12,5 |
| Result / kNm | 0 | 7.7 | 1279.3 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| h_p / mm | 12.5 | 12.5 | 12.5 |
| k_2 | 0.775 | 0.775 | 0.775 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |

Table continues

| | | | |
|-----------------------------------|----------|----------|----------|
| $k_n\beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 |
| $k_2k_n\beta_0 / \text{mm/min}$ | 0.54 | 0.54 | 0.54 |
| $k_3k_n\beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 |
| $k_4k_n\beta_0 \text{ mm/min}$ | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 21 | 21 | 21 |
| $t_{prot,i} / \text{min}$ | 24.10481 | 24.10481 | 24.10481 |
| t_{ch} / min | 21 | 21 | 21 |
| t_f / min | 21 | 21 | 21 |
| t_a / min | 38.81 | 38.81 | 38.81 |
| $d_{char,n tf} / \text{mm}$ | 0.00 | 0.00 | 0.00 |
| $d_{char,n ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / \text{mm}$ | 60.94 | 60.94 | 60.94 |
| d_0 / mm | 16.00 | 16.00 | 16.00 |
| d_{ef} / mm | 76.94 | 76.94 | 76.94 |
| b_{fi} / mm | 0.00 | 46.12 | 246.12 |
| h_{fi} / mm | 0.00 | 46.12 | 246.12 |
| A_{fi} / mm^2 | 0 | 2127.423 | 60577.02 |
| $N_{max,fi} / \text{kN}$ | 0 | 52.6 | 1497.7 |
| I / mm^4 | 0 | 377160.9 | 3.06E+08 |
| i / mm | 0 | 13.31485 | 71.04988 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 157.7186 | 29.5567 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 2.375837 | 0.445235 |
| k_y | 0.485 | 3.426093 | 0.606379 |
| k_{cy} | 1.030928 | 0.169647 | 0.982284 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 3.647408 | 21.11911 |
| $N_{max,fi} / \text{kN}$ | 0 | 7.75958 | 1279.333 |

**Appendix 14 Calculations of glulam column with one layer of GtF 15
according to 2020 version of Eurocode 5**

| | |
|---|-------------------------------------|
| column height | $l=3m=3000mm$ |
| height | $h = 80 \text{ mm}$ |
| width | $b = 80 \text{ mm}$ |
| material | GL24h |
| design strength in fire | $f_{d,fi} = 24,7 \frac{N}{mm^2}$ |
| design compressive strengths along the grain | $f_{c,o,g,k} = 21,5 \frac{N}{mm^2}$ |
| the fifth percentile value of the modulus of elasticity | $E_{0,g,05} = 9600$ |
| time | 30 min |
| sides open to fire | 4 |
| Protection | GtF15 |

Reduced cross-section method

| | |
|---|---|
| $k_{gd} = \begin{cases} 1,0 \\ 2,0 \end{cases}$ | $k_{gd} = 1,0$ |
| $k_n = \begin{cases} 1,23 \\ 1,08 \end{cases}$ | $k_n = 1,08$ |
| $k_2 = 1 - 0,018h_p$ | $k_2 = 1 - 0,018 * 15 = 0,73$ |
| $k_3 = 2,0$ | |
| $k_4 = 1,0$ | |
| $\beta_{n,phase2} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_2 \beta_0$ | $\beta_{n,phase2} = 1,0 * 1,08 * 0,73 * 0,65 = 0,51$ |
| $\beta_{n,phase3} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_3 \beta_0$ | $\beta_{n,phase3} = 1,0 * 1,08 * 2,0 * 0,65 = 1,40$ |
| $\beta_{n,phase4} = \prod_{k_i} k_i \beta_0 = k_{gd} k_n k_4 \beta_0$ | $\beta_{n,phase4} = 1,0 * 1,08 * 1,0 * 0,65 = 0,70$ |
| $t_{f,pr} = 1,2(3,9h_p - 16)$ | $t_{f,pr} = 1,2 * (3,9 * 15 - 16) = 51 \text{ min}$ |
| $t_{prot} = 30 \left(\frac{h_p}{15} \right)^{1,2}$ | $t_{prot} = 30 \left(\frac{15}{15} \right)^{1,2} = 30,0 \text{ min}$ |
| $t_{ch} = \min \left\{ \sum t_{prot} \right.$ | $t_{ch} = \min \left\{ \begin{matrix} 30,0 \text{ min} \\ 51 \text{ min} \end{matrix} \right. = 30 \text{ min}$ |
| $\left. t_{f,pr} \right.$ | |

$$t_a = \min \left\{ t_{f,pr} + \frac{2 t_{f,pr} - (t_f - t_{ch}) \beta_{n,phase2}}{\beta_{n,phase3}} \right.$$

$$d_{char,n,t_f} = (t_f - t_{ch}) \beta_{n,phase2}$$

$$d_{char,n,t_a} = d_{char,n,t_f} + (t_a - t_f) \beta_{n,phase3}$$

$$d_{char,n,t} = (t - t_{ch}) \beta_{n,phase2}$$

$$d_{ef} = d_{char,n} + d_0$$

$$b_{ef} = b - k_{sides} d_{ef}$$

$$h_{ef} = h - k_{sides} d_{ef}$$

$$A_{ef} = b_{ef} h_{ef}$$

$$N_{max,fi} = A_{ef} f_{d,fi} 10^{-3}$$

$$t_a = \min \left\{ \begin{array}{l} 2 * 51 = 102 \text{ min} \\ 51 + \frac{25 - (51 - 30) * 0,51}{1,40} = 61,14 \text{ min} \\ = 61,14 \text{ min} \end{array} \right.$$

$$d_{char,n,t_f} = (51 - 30) * 0,51 = 10,7 \text{ mm}$$

$$d_{char,n,t_a} = 10,7 + (61,14 - 51) * 1,40 = 24,9 \text{ mm}$$

$$d_{char,n,t} = (30 - 30) * 0,51 = 0 \text{ mm}$$

$$d_{ef} = 0 + 14 = 14 \text{ mm}$$

$$b_{ef} = 80 - 2 * 14 = 52 \text{ mm}$$

$$h_{ef} = 80 - 2 * 14 = 52 \text{ mm}$$

$$A_{ef} = 52 * 52 = 2704 \text{ mm}^2$$

$$N_{max,fi} = 2704 * 24,7 * 10^{-3} = 66,8 \text{ kN}$$

Slenderness

$$I = \frac{b_{fi} h_{fi}^3}{12}$$

$$i = \sqrt{\frac{I}{A_{fi}}}$$

$$l_0 = \mu l$$

$$\lambda_y = \frac{l_0}{i}$$

$$\lambda_{rel,y} = \frac{\lambda_y}{\pi} \sqrt{\frac{f_{c,o,g,k}}{E_{0,g,05}}}$$

$$\beta_c = 0,1$$

$$k_y = 0,5 (1 + \beta_c (\lambda_{rel,y} - 0,3) + \lambda_{rel,y}^2)$$

$$k_{cy} = \frac{1}{k_y + \sqrt{k_y^2 - \lambda_{rel,y}^2}}$$

$$\sigma_{c,0,d} = k_{cy} f_{c,o,g,k}$$

$$N_{max,fi} = A_{fi} \sigma_{c,0,d} 10^{-3}$$

$$I = \frac{52,0 * 52,0^3}{12} = 609301 \text{ mm}^4$$

$$i = \sqrt{\frac{609301}{2704}} = 15,0 \text{ mm}$$

$$l_0 = 0,7 * 3000 = 2100 \text{ mm}$$

$$\lambda_y = \frac{2100}{15,0} = 139,9$$

$$\lambda_{rel,y} = \frac{139,9}{\pi} \sqrt{\frac{21,5}{9600}} = 2,11$$

$$k_y = 0,5 (1 + 0,1 (2,11 - 0,3) + 2,11^2) = 2,81$$

$$k_{cy} = \frac{1}{2,81 + \sqrt{2,81^2 - 2,11^2}} = 0,21$$

$$\sigma_{c,0,d} = 0,21 * 21,5 = 4,60 \frac{\text{N}}{\text{mm}^2}$$

$$N_{max,fi} = 2704 * 4,60 * 10^{-3} = 12,4 \text{ kN}$$

Table. Glulam column with one layer of GtF 15 according to 2020 version of Eurocode after 30 minutes of fire

| | | | |
|---------------------------------|-------------|------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 12.4 | 603 | 2975.2 |
| Required time / min | 30 | 30 | 30 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |
| $k_n\beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 |
| $k_2k_n\beta_0 / \text{mm/min}$ | 0.51 | 0.51 | 0.51 |
| $k_3k_n\beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 |
| $k_4k_n\beta_0 \text{ mm/min}$ | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 51 | 51 | 51 |
| $t_{prot,i} / \text{min}$ | 30 | 30 | 30 |
| t_{ch} / min | 30 | 30 | 30 |
| t_f / min | 51 | 51 | 51 |
| t_a / min | 61.14 | 61.14 | 61.14 |
| $d_{char,n\ t f} / \text{mm}$ | 10.76 | 10.76 | 10.76 |
| $d_{char,n\ t a} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,n\ t} / \text{mm}$ | 0.00 | 0.00 | 0.00 |
| d_0 / mm | 14.00 | 14.00 | 14.00 |
| d_{ef} / mm | 14.00 | 14.00 | 14.00 |
| b_{fi} / mm | 52.00 | 172.00 | 372.00 |
| h_{fi} / mm | 52.00 | 172.00 | 372.00 |
| A_{fi} / mm^2 | 2704 | 29584 | 138384 |
| $N_{max,fi} / \text{kN}$ | 66.8 | 731.4 | 3421.5 |
| I / mm^4 | 609301.3 | 72934421 | 1.6E+09 |
| i / mm | 15.01111 | 49.65212 | 107.3872 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 139.8964 | 42.29426 | 19.55541 |

Table continues

| | | | |
|-----------------------------------|----------|----------|----------|
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 2.107368 | 0.637111 | 0.294578 |
| k_y | 2.810868 | 0.719811 | 0.543117 |
| k_{cy} | 0.214088 | 0.948048 | 1.000594 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 4.602899 | 20.38303 | 21.5 |
| $N_{max,fi} / \text{kN}$ | 12.44624 | 603.0116 | 2975.256 |

Table. Glulam column with one layer of GtF 15 according to 2020 version of Eurocode after 60 minutes of fire

| | | | |
|-----------------------------------|----------|--------------|---------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 264.9 | 2207.9 |
| Required time / min | 60 | 60 | 60 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k} / \text{kN/mm}^2$ | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi} / \text{kN/mm}^2$ | 24.725 | 24.725 | 24.725 |
| $\beta_0 / \text{mm/min}$ | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |
| $k_n \beta_0 / \text{mm/min}$ | 0.70 | 0.70 | 0.70 |
| $k_2 k_n \beta_0 / \text{mm/min}$ | 0.51 | 0.51 | 0.51 |
| $k_3 k_n \beta_0 / \text{mm/min}$ | 1.40 | 1.40 | 1.40 |
| $k_4 k_n \beta_0 / \text{mm/min}$ | 0.702 | 0.702 | 0.702 |
| $t_{f,degr} / \text{min}$ | 51 | 51 | 51 |
| $t_{prot,i} / \text{min}$ | 30 | 30 | 30 |
| t_{ch} / min | 30 | 30 | 30 |
| t_f / min | 51 | 51 | 51 |
| t_a / min | 61.14 | 61.14 | 61.14 |
| $d_{char,n tf} / \text{mm}$ | 10.76 | 10.76 | 10.76 |
| $d_{char,n ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,n t} / \text{mm}$ | 23.40 | 23.40 | 23.40 |
| d_0 / mm | 16.00 | 16.00 | 16.00 |
| d_{ef} / mm | 39.40 | 39.40 | 39.40 |

Table continues

| | | | |
|---------------------------------------|----------|----------|----------|
| b_{fi} / mm | 1.20 | 121.20 | 321.20 |
| h_{fi} / mm | 1.20 | 121.20 | 321.20 |
| A_{fi} / mm ² | 1.451254 | 14690.57 | 103172.4 |
| $N_{max,fi}$ / kN | 0 | 363.2 | 2550.9 |
| I / mm ⁴ | 0.175511 | 17984415 | 8.87E+08 |
| i / mm | 0.353565 | 34.98878 | 92.7238 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 5939.503 | 60.01925 | 22.64791 |
| $E_{0,05}$ / kN/mm ² | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 89.47131 | 0.904116 | 0.341163 |
| k_y | 4007.517 | 0.938919 | 0.560254 |
| k_{cy} | 0.000125 | 0.838798 | 0.995366 |
| $\sigma_{c,0,d}$ / kN/mm ² | 0.002683 | 18.03415 | 21.40037 |
| $N_{max,fi}$ / kN | 3.89E-06 | 264.932 | 2207.928 |

Table. Glulam column with one layer of GtF 15 according to 2020 version of Eurocode after 90 minutes of fire

| | | | |
|------------------------------------|----------|-------------|-------------|
| Cross-section / mm x mm | 80x80 | 200x200 | 400x400 |
| Protective layer | GtF15 | GtF15 | GtF15 |
| Result / kNm | 0 | 58.5 | 1637 |
| Required time / min | 90 | 90 | 90 |
| Strength class | GL24h | GL24c | GL24c |
| L / m | 3 | 3 | 3 |
| b / mm | 80 | 200 | 400 |
| h / mm | 80 | 200 | 400 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 |
| $f_{c,0,g,k}$ / kN/mm ² | 21.5 | 21.5 | 21.5 |
| $k_{mod,fi}$ | 1 | 1 | 1 |
| $f_{d,fi}$ / kN/mm ² | 24.725 | 24.725 | 24.725 |
| β_0 / mm/min | 0.65 | 0.65 | 0.65 |
| h_p / mm | 15 | 15 | 15 |
| k_2 | 0.73 | 0.73 | 0.73 |
| k_3 | 2 | 2 | 2 |
| k_4 | 1 | 1 | 1 |
| k_n | 1.08 | 1.08 | 1.08 |
| $k_n\beta_0$ / mm/min | 0.70 | 0.70 | 0.70 |
| $k_2k_n\beta_0$ / mm/min | 0.51 | 0.51 | 0.51 |
| $k_3k_n\beta_0$ / mm/min | 1.40 | 1.40 | 1.40 |
| $k_4k_n\beta_0$ mm/min | 0.702 | 0.702 | 0.702 |
| $t_{f,degr}$ / min | 51 | 51 | 51 |
| $t_{prot,i}$ / min | 30 | 30 | 30 |

Table continues

| | | | |
|-----------------------------------|----------|----------|----------|
| t_{ch} / min | 30 | 30 | 30 |
| t_f / min | 51 | 51 | 51 |
| t_a / min | 61.14 | 61.14 | 61.14 |
| $d_{char,n\ tf} / \text{mm}$ | 10.76 | 10.76 | 10.76 |
| $d_{char,n\ ta} / \text{mm}$ | 25.00 | 25.00 | 25.00 |
| $d_{char,n\ t} / \text{mm}$ | 45.26 | 45.26 | 45.26 |
| d_0 / mm | 16.00 | 16.00 | 16.00 |
| d_{ef} / mm | 61.26 | 61.26 | 61.26 |
| b_{fi} / mm | 0.00 | 77.48 | 277.48 |
| h_{fi} / mm | 0.00 | 77.48 | 277.48 |
| A_{fi} / mm^2 | 0 | 6003.513 | 76996.45 |
| $N_{max,fi} / \text{kN}$ | 0 | 148.4 | 1903.7 |
| I / mm^4 | 0 | 3003514 | 4.94E+08 |
| i / mm | 0 | 22.36722 | 80.10225 |
| l_0 / mm | 2100 | 2100 | 2100 |
| λ_y | 0 | 93.88737 | 26.21649 |
| $E_{0,05} / \text{kN/mm}^2$ | 9600 | 9600 | 9600 |
| $\lambda_{rel,y}$ | 0 | 1.414298 | 0.394919 |
| k_y | 0.485 | 1.555834 | 0.582727 |
| k_{cy} | 1.030928 | 0.453679 | 0.988902 |
| $\sigma_{c,0,d} / \text{kN/mm}^2$ | 21.5 | 9.754094 | 21.26139 |
| $N_{max,fi} / \text{kN}$ | 0 | 58.55883 | 1637.051 |

Appendix 15 Calculations of tested beams

Table Data of tests

| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
|------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| h / mm | 254 | 256 | 256 | 253 | 253 | 217 | 362 | 600 | 599 | 600 |
| b / mm | 157 | 158 | 158 | 158 | 157 | 157 | 120 | 140 | 140 | 140 |
| Protective layer | none |
| Strength class | GL24h | GL36h | GL36h | GL24h | GL36h | GL36h | GL24h | GL24h | GL32h | GL32h |
| t / min | 52 | 49.25 | 68.88 | 48.1 | 58.28 | 44.4 | 48.2 | 32 | 24.5 | 13.5 |
| M / kNm | 16.4 | 20.7 | 13.9 | 16 | 21 | 14.5 | 23 | 97 | 124.5 | 124.5 |

An example for following calculations can be seen in Appendix 2.

Table Reference calculations based on EN 1995-1-2:2004 with strength class bending strength

| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
|-----------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 36 | 36 | 24 | 36 | 36 | 24 | 24 | 32 | 32 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 41.4 | 41.4 | 27.6 | 41.4 | 41.4 | 27.6 | 27.6 | 36.8 | 36.8 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 36.4 | 34.48 | 48.22 | 33.67 | 40.8 | 31.08 | 33.74 | 22.4 | 17.15 | 9.45 |
| k_0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 43.4 | 41.48 | 55.22 | 40.67 | 47.8 | 38.08 | 40.74 | 29.4 | 24.15 | 16.45 |
| b_{fi} / mm | 70.2 | 75.05 | 47.56 | 76.66 | 61.4 | 80.84 | 38.52 | 81.2 | 91.7 | 107.1 |
| h_{fi} / mm | 210.6 | 214.5 | 200.8 | 212.3 | 205.2 | 178.9 | 321.3 | 570.6 | 574.9 | 583.6 |
| W_{fi} / mm^3 | 518923 | 575646 | 319572 | 576024 | 430926 | 431313 | 521685 | 316205 | 430713 | 431313 |
| $M_{max,fi} / \text{kNm}$ | 14.3 | 23.8 | 13.2 | 15.8 | 17.8 | 17.8 | 18.2 | 121.6 | 185.8 | 223.6 |
| $M-M_{max,fi} / \text{kNm}$ | 2.1 | -3.1 | 0.7 | 0.2 | 3.2 | -3.3 | 4.8 | -24.6 | -61.3 | -99.1 |

Table Reference calculations based on EN 1995-1-2:2004 with mean bending strength

| NR | 1 | 2 | 3 | 4 | 5 | 6 |
|-----------------------------|-------|-------|-------|-------|-------|-------|
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 31.2 | 39.8 | 39.8 | 31.2 | 39.8 | 39.8 |
| $k_{mod,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 35.88 | 45.77 | 45.77 | 35.88 | 45.77 | 45.77 |
| β_n | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 |
| $d_{char,n} / \text{mm}$ | 36.4 | 34.48 | 48.22 | 33.67 | 40.8 | 31.08 |

Table continued

| | | | | | | |
|------------------------------|--------|--------|--------|--------|--------|--------|
| NR | 1 | 2 | 3 | 4 | 5 | 6 |
| k_0 | 1 | 1 | 1 | 1 | 1 | 1 |
| d_0 / mm | 7 | 7 | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 43.4 | 41.48 | 55.22 | 40.67 | 47.8 | 38.08 |
| b_{fi} / mm | 70.2 | 75.05 | 47.56 | 76.66 | 61.4 | 80.84 |
| h_{fi} / mm | 210.6 | 214.5 | 200.8 | 212.3 | 205.2 | 178.9 |
| W_{fi} / mm^3 | 518923 | 575646 | 319572 | 576024 | 430926 | 431313 |
| $M_{\max,fi} / \text{kNm}$ | 18.6 | 26.3 | 14.6 | 20.6 | 19.7 | 19.7 |
| $M-M_{\max,fi} / \text{kNm}$ | -2.2 | -5.6 | -0.7 | -4.6 | 1.3 | -5.2 |

An example for following calculations can be seen in Appendix 9.

Table Reference calculations based on EN 1995-1-2:2020 with strength class bending strength

| | | | | | | | | | | |
|------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 36 | 36 | 24 | 36 | 36 | 24 | 24 | 32 | 32 |
| k_{Θ} | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 41.4 | 41.4 | 27.6 | 41.4 | 41.4 | 27.6 | 27.6 | 36.8 | 36.8 |
| β_0 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 |
| β_n | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 36.5 | 34.57 | 48.36 | 33.77 | 40.91 | 31.17 | 33.84 | 22.46 | 17.2 | 9.477 |
| d_0 / mm | 7 | 7 | 10 | 7 | 7 | 7 | 7 | 7 | 7 | 7 |
| d_{ef} / mm | 43.5 | 41.57 | 58.36 | 40.77 | 47.91 | 38.17 | 40.84 | 29.46 | 24.2 | 16.48 |
| b_{fi} / mm | 69.99 | 74.85 | 41.29 | 76.47 | 61.17 | 80.66 | 38.33 | 81.07 | 91.6 | 107 |
| h_{fi} / mm | 210.5 | 214.4 | 197.6 | 212.2 | 205.1 | 178.8 | 321.2 | 570.5 | 574.8 | 583.5 |
| W_{fi} / mm^3 | 516874 | 573608 | 268805 | 574057 | 428802 | 429939 | 519640 | 265909 | 428589 | 429939 |
| $M_{\max,fi} / \text{kNm}$ | 14.2 | 23.7 | 11.1 | 15.8 | 17.7 | 17.7 | 18.1 | 121.3 | 185.6 | 223.5 |
| $M-M_{\max,fi} / \text{kNm}$ | 2.2 | -3 | 2.8 | 0.2 | 3.3 | -3.2 | 4.9 | -24.3 | -61.1 | -99 |

Table Reference calculations based on EN 1995-1-2:2020 with strength class bending strength and $d_0=10\text{mm}$

| | | | | | | | | | | |
|-----------------------------|------|------|------|------|------|------|------|------|------|------|
| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 24 | 36 | 36 | 24 | 36 | 36 | 24 | 24 | 32 | 32 |
| k_{Θ} | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 27.6 | 41.4 | 41.4 | 27.6 | 41.4 | 41.4 | 27.6 | 27.6 | 36.8 | 36.8 |
| β_0 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 |

Table continued

| NR | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
|-----------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| k_n | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 |
| β_n | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 36.5 | 34.57 | 48.36 | 33.77 | 40.91 | 31.17 | 33.84 | 22.46 | 17.2 | 9.477 |
| d_o / mm | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| d_{ef} / mm | 46.5 | 44.57 | 58.36 | 43.77 | 50.91 | 41.17 | 43.84 | 32.46 | 27.2 | 19.48 |
| b_{fi} / mm | 63.99 | 68.85 | 41.29 | 70.47 | 55.17 | 74.66 | 32.33 | 75.07 | 85.6 | 101 |
| h_{fi} / mm | 207.5 | 211.4 | 197.6 | 209.2 | 202.1 | 175.8 | 318.2 | 567.5 | 571.8 | 580.5 |
| W_{fi} / mm^3 | 459192 | 512968 | 268805 | 514164 | 375510 | 384718 | 519640 | 313938 | 428589 | 429939 |
| $M_{max,fi} / \text{kNm}$ | 12.6 | 21.2 | 11.1 | 14.1 | 15.5 | 15.9 | 15 | 111.2 | 171.6 | 208.8 |
| $M-M_{max,fi} / \text{kNm}$ | 3.8 | -0.5 | 2.8 | 1.9 | 5.5 | -1.4 | 8 | -14.2 | -47.1 | -84.3 |

Table Reference calculations based on EN 1995-1-2:2020 with mean bending strength

| NR | 1 | 2 | 3 | 4 | 5 | 6 |
|-----------------------------|--------|--------|--------|--------|--------|--------|
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k}$ | 31.2 | 39.8 | 39.8 | 31.2 | 39.8 | 39.8 |
| k_{Θ} | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi}$ | 35.88 | 45.77 | 45.77 | 35.88 | 45.77 | 45.77 |
| β_0 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 |
| β_n | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 36.5 | 34.57 | 48.36 | 33.77 | 40.91 | 31.17 |
| d_o / mm | 7 | 7 | 10 | 7 | 7 | 7 |
| d_{ef} / mm | 43.5 | 41.57 | 58.36 | 40.77 | 47.91 | 38.17 |
| b_{fi} / mm | 69.99 | 74.85 | 41.29 | 76.47 | 61.17 | 80.66 |
| h_{fi} / mm | 210.5 | 214.4 | 197.6 | 212.2 | 205.1 | 178.8 |
| W_{fi} / mm^3 | 516874 | 573608 | 268805 | 574057 | 428802 | 429939 |
| $M_{max,fi} / \text{kNm}$ | 18.5 | 26.2 | 12.3 | 20.5 | 19.6 | 19.6 |
| $M-M_{max,fi} / \text{kNm}$ | -2.1 | -5.5 | 1.6 | -4.5 | 1.4 | -5.1 |

Table Refecernce calculations based on EN 1995-1-2:2020 with mean bending strength and $d_0=10\text{mm}$

| NR | 1 | 2 | 3 | 4 | 5 | 6 |
|-----------------------------|--------|--------|--------|--------|--------|--------|
| $\gamma_{M,fi}$ | 1 | 1 | 1 | 1 | 1 | 1 |
| k_{fi} | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 | 1.15 |
| $f_{m,g,k} / \text{N/mm}^2$ | 31.2 | 39.8 | 39.8 | 31.2 | 39.8 | 39.8 |
| k_{Θ} | 1 | 1 | 1 | 1 | 1 | 1 |
| $f_{d,fi} / \text{N/mm}^2$ | 35.88 | 45.77 | 45.77 | 35.88 | 45.77 | 45.77 |
| β_0 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 | 0.65 |
| k_n | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 | 1.08 |
| β_n | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 | 0.702 |
| $d_{char,n} / \text{mm}$ | 36.5 | 34.57 | 48.36 | 33.77 | 40.91 | 31.17 |
| d_0 / mm | 10 | 10 | 10 | 10 | 10 | 10 |
| d_{ef} / mm | 46.5 | 44.57 | 58.36 | 43.77 | 50.91 | 41.17 |
| b_{fi} / mm | 63.99 | 68.85 | 41.29 | 70.47 | 55.17 | 74.66 |
| h_{fi} / mm | 207.5 | 211.4 | 197.6 | 209.2 | 202.1 | 175.8 |
| W_{fi} / mm^3 | 459192 | 512968 | 268805 | 514164 | 375510 | 384718 |
| $M_{max,fi} / \text{kNm}$ | 16.4 | 23.4 | 12.3 | 18.4 | 17.1 | 17.6 |
| $M-M_{max,fi} / \text{kNm}$ | 0 | -2.7 | 1.6 | -2.4 | 3.9 | -3.1 |

Appendix 16 Interview with Alar Just

1. When did the revision of Eurocode 5 start?

In 2012.

2. Who is working on the revision of EN 1995-1-2 and where?

The revision is done in CEN TC250 SC5 WG4 (Fire) by project team 4 – Andrea Frangi, Alar Just, Jouni Hakkarainen, Norman Werther and Joachim Schmid.

3. How far gone is the process?

The first draft was released in May 2019, the second in May 2020 and the third in October 2020. The final version will be published in May 2021.

4. When will the official release be?

After balloting, comments, reviewing and synchronising with other parts of Eurocode, it is expected in 2025.

5. What are the main changes?

In some parts, the terms and symbols have changed a little bit. A concept of charring phases is being introduced. In the start time of charring, the start time of charring Separating Function Method is used. Also, the failure times of GtF have been added and the depth of the zero-strength layer has been increased to avoid overestimating the fire resistance.

6. Has the Reduced Properties Method also been revised?

No, TC250 SC5 WG4 made the decision not to revise this.